

Aqua Whisper DX Modular 450-1800 Owner's Manual



FOR MODELS

SRC Aqua Whisper DX 450-1	SRC Aqua Whisper DX 900-2
SRC Aqua Whisper DX 700-1	SRC Aqua Whisper DX 1400-2
SRC Aqua Whisper DX 900-1	SRC Aqua Whisper DX 1800-2



Aqua Whisper DX Modular 450-1800 Owner's Manual

PREFACE

Thank you for your purchase of a Sea Recovery Aqua Whisper Reverse Osmosis Desalination System. This manual contains instructions for the installation, operation, maintenance, and repair of the Sea Recovery Desalination System. This information is provided to ensure extended life and safe operation of your Sea Recovery system.

Please read this manual thoroughly before installation or operation, and keep it for future reference. A better understanding of the system ensures optimum performance and longer service life.

Sea Recovery's Reverse Osmosis Desalination Systems are designed and engineered to function as a complete working unit. Generally speaking, the performance of each component within the System is dependent on the component prior to it and governs the performance of all components after it. Proper performance of the system is thus dependent upon proper operation of every single component within the system. The intent of this manual is to allow the operator to become familiar with each component within the Sea Recovery system. By understanding the function, importance, and normal operation of each component within each subsystem of the unit, the operator can readily diagnose minor problems, which if detected early are usually easily corrected. However, if left unattended, a problem in one component eventually affects the rest of the system and leads to further repairs.

The manual is divided into sections that address different subject matter. Each section should be reviewed before operating the Reverse Osmosis Desalination system. The major documented cause of failures and problems are from the use of third party, non Sea Recovery, parts, from improper installation, and from improper operation:

The use of third party, non Sea Recovery, consumable, spares, and assemblies will damage the Sea Recovery system and/ or specific components within the system. Do not use parts, components from any source other than Sea Recovery. Use of third party, non Sea Recovery, components will void any and all warranty of the system and/or void the effected component within the system.

Sea Recovery maintains inventory for immediate shipment and our Service Dealers throughout the world maintain stock of Sea Recovery parts. Always insist on Sea Recovery supplied parts for your system in order to avoid failures, eliminate problems, and maintain your Sea Recovery Warranty.

Follow the Installation and Operation Instructions in this manual. From time to time, Sea Recovery may make programming changes to the Control Logic.

Other physical production changes may also be made from time to time and are tracked by Sea Recovery through the System Serial Number. Troubleshooting and repair method results can vary depending on the information that is displayed at the SYSTEM INFORMATION screen.

When requesting assistance from Sea Recovery or Sea Recovery's service dealers, always:

PROVIDE ALL INFORMATION DISPLAYED AT THE SYSTEM INFORMATION SCREEN.

SERIAL NUMBER helps us to determine the latest physical version and configuration of your system which is necessary to ensure that we provide you with the correct information or parts.

TYPE tells us the production capacity of your system which gives us a bench mark in diagnosing product water flow and pressure concerns.

TIME RUNNING assists us in diagnosing abnormalities that can occur at given operational time intervals such as required pump maintenance, or R.O. membrane element condition.

VERSION allows us to determine the specific sequential operation of the system based on the version of the programmed control logic.

COPYRIGHT NOTIFICATION

Copyright 2008® Sea Recovery Corporation. All content included within this manual, such as text, graphics, logos, and images, is the property of Sea Recovery Corporation and protected by U.S. and international copyright laws. The compilation (meaning the preparation, collection, arrangement, and assembly) of all content within this manual is the exclusive property of Sea Recovery Corporation and protected by U.S. and international copyright laws. All software used in the design and manufacture of the Sea Recovery Reverse Osmosis Desalination System is the property of Sea Recovery Corporation and protected by U.S. and international copyright laws. All computer and logic programming used in the design and manufacture of the Sea Recovery Reverse Osmosis Desalination System the property of Sea Recovery Corporation and protected by U.S. and international copyright laws.

The content of this manual and the software, programming, and graphic designs used in the design and manufacture of the Sea Recovery Reverse Osmosis Desalination System is for the purpose of operation, maintaining, and repair of the Sea Recovery Reverse Osmosis Desalination System. Any other use, including the reproduction, modification, distribution, transmission, republication, display, or performance, of the content within this manual is strictly prohibited.

TERMS AND CONDITIONS

The use of this manual acknowledges acceptance of the terms and conditions provided herewith and the agreement to comply with all applicable laws and regulations pertaining to the use of this manual.

In addition, the use of this manual forms an agreement that Sea Recovery's trademarked name or Sea Recovery's trademarked logo mark are not to be used in any form or manner except with Sea Recovery Corporation's written permission. Sea Recovery Corporation holds all rights to its copyrights and trademarks, and to the material contained in this manual. Any use of such requires the written permission from Sea Recovery Corporation.

PATENT INFORMATION

Certain aspects of the Sea Recovery Reverse Osmosis Desalination System are protected by U.S. and International Patent Laws.

NOTICE OF LIABILITY

The information contained in the manual is distributed on an "As is" basis, without warranty. While every effort has been taken in the preparation of this manual, Sea Recovery Corp. shall not be held liable with respect to any liability, loss, or damage caused by the instructions contained in this manual. The information contained in this manual is subject to change without notice.

TRADEMARKS

The Sea Recovery® logo mark is a U.S. Registered Trademark and belongs to Sea Recovery Corporation with all rights reserved. Sea Recovery® is a US Registered trademark of Sea Recovery Corporation. Aqua Whisper[™] is a trademark of Sea Recovery Corp.

REVISION HISTORY

Rev.	Date	Affected Pages	Description		
Ø	1-Dec-08	ALL	Initial Release of the 2008 DX Models.		
1	23-Sep-09	Pg.4-11 & Foldout	Revised Electrical Diagrams		
2	3-Dec-09	ALL, 5-2	General Re-formatting and Multi media filter installation		
3	21-Oct-10	10-42, 10-43	New Fresh Water Flush Drawing		
4	16-Jan-18	Electrical, certificates, controls, parts view	New and updated Information		

TABLE OF CONTENTS

1 1.1 1.2 1.3 1.4 1.5 1.6 1.7 1.8	INTRODUCTION	1-1 1-1 1-1 1-1 1-1 1-1 1-1
2 2.1 2.2 2.3 2.4 2.5 2.6 2.7 2.8 2.9 2.10	SYSTEM DESCRIPTION	2-1 2-1 2-1 2-1 2-1 2-1 2-1 2-1 2-1 2-1
3 3.1 3.2 3.3 3.5 3.6 3.7 3.8 3.9	PRE-INSTALLATION NOTES PRECAUTIONS PRECAUTIONS SPECIAL CONSIDERATIONS DISTANCE BETWEEN COMPONENTS OMPONENTS SUPPLIED BY INSTALLER PIPING AND INTERCONNECT DIAGRAMS PIPING AND INTERCONNECT DIAGRAMS EXPLANATION OF PRESSURE TRANSDUCERS 3 RO MEMBRANE ELEMENT NOTES 3 COMPONENT DESCRIPTIONS 3	3-1 3-2 3-2 3-3 3-3 3-18 3-19
4 4.1 4.2 4.3 4.4 4.5 4.6 4.7 4.8	ELECTRICAL INFORMATION	4-1 4-2 4-3 4-3 4-4 4-4 4-4
5 5.1 5.2 5.3 5.4 5.5	INSTALLATION REQUIREMENTS	5-1 5-1 5-5 5-5

5.6		CAL CONNECTIONS	
5.7		ED WATER PICK-UP	
5.8	UV STER	ILIZER INSTALLATION	
6	COMM	IISSIONING	6-1
6.1	CHECK II	NSTALLATION	6-1
6.2		RO MEMBRANE	
6.3		ONTROLLER	
		CONTROLLER UPDATE AS OF 10/30/2017	
		IISSIONING	
		NGS	
		EM CLOCK	
		EM RUN TIMERS	
		EM SALINITY	
		HWATER FLUSH	
6.4		SYSTEM MANUALLY	
6.5		ON NOTES	
6.6		STARTUP	
	6.6.1	POSITION SYSTEM VALVES	
	6.6.2	APPLY POWER TO THE SYSTEM	
	6.6.3	START THE SYSTEM	
	6.6.4	LOG SYSTEM READINGS	
	6.6.5	SHUTDOWN THE SYSTEM	
6.7	WARNIN	IGS AND CAUTIONS	6-23
7	OPER	ATION	
7.1		PERATION	
	7.1.1	POSITION VALVES	
	7.1.2	APPLY POWER TO THE SYSTEM	7-2
	7.1.3	START THE SYSTEM	
	7.1.5	LOG SYSTEM READINGS	
	7.1.6	SHUTDOWN THE SYSTEM	
7.2	SYSTEM	STORAGE AND CLEANING	
7.3		TERM SHUTDOWN	
7.4		ERM SHUTDOWN	
		ZING PROCEDURE	
7.6		MBRANE CLEANING	
8	ΜΔΙΝΙ	ENANCE AND REPAIR	8-1
8.1		QUICK CHECK	
8.2		OR MAINTENANCE INTERVALS	
8.3		JAL COMPONENT MAINTENANCE AND REPAIR	
8.4		ILIZER MAINTENANCE	
9		BLESHOOTING	Q_1
9 .1		AND ERROR SCREENS	
9.2		ESHOOTING COMPONENTS	
9.3		CAL TROUBLESHOOTING	
		CONTROLLER UPDATE AS OF 10/30/2017	
		ERROR MESSAGES	
		ING MESSAGES	

10	EXPLODED PARTS VIEW	
10.1	WHEN ORDERING	
10.2	TUBES AND FITTINGS	
10.3	INSTALLATION KIT B001940001	
10.4	MAJOR PARTS	
	1. SEA STRAINER	
	2. BOOSTER PUMP HEAD ASSY	
	3. BOOSTER PUMP ASSY 1 PHASE B016120001	
	4. BOOSTER PUMP ASSY 3 PHASE B016120002	
	5. MEDIA FILTER ASSY B071080002	
	6. Multi media filter piping	
	7. PLANKTON FILTER ASSY-SINGLE B008800001	
	8. PLANKTON FILTER ASSY-DOUBLE B008800002	
	9. PRE FILTER-DUAL ASSY B108140001	
	10. COMMERCIAL PREFILTER ASSY B109120001	
	11. OIL WATER SEPERATOR ASSY B111120001	
	12. HP PUMP ASSY-SINGLE PHASE-B156930003 (Standard)	
	13. HP PUMP ASSY-3 PHASE 50Hz- B156930005 (Standard)	
	14. HP PUMP ASSY-3 PHASE 60Hz- B156930004 (Standard)	
	15. HP PUMP ASSY-12180513CO-RIGHT	
	16. HP PUMP ASSY-SINGLE PHASE B156140001 (Optional)	
	17. HP PUMP ASSY-3 PHASE B156140002 (Optional)	
	18. HP HOSE ASSEMBLY B3901200XX	
	19. RO MEMBRANE-SINGLE ASSEMBLY B19800002X	10-27
	20. RO MEMBRANE-DOUBLE ASSEMBLY B19800002X	
	21. FRAME ASSEMBLY B586940002	
	22. CONTROLLER CHASSIS ASSY-SINGLE PHASE B619940001	
	23. CONTROLLER CHASSIS ASSY-THREE PHASE B619940002.	
	25. LP BACK PRESSURE PLATE ASSY B515150003	
	26.LP MANIFOLD-COMMERCIAL PREFILTER B502160001	
	27.LP MANIFOLD -DUAL PREFILTER B502160002	
	28.HP MANIFOLD ASSEMBLY B502930001	
	29.POST FILTER-DUAL ASSY B114140001	
	30.CLEAN AND RINSE KIT B591120001	
	31.FRESH WATER FLUSH (.50 INCH) B598000008	
	32.UV LIGHT ASSY B5262000CV	
	33. REMOTE KIT,100 FT CABLE,PARKER 61012029	
	34. 61012030 REMOTE KIT, 200 FT CABLE, PARKER	
	35. 61012032 REMOTE KIT,200 FT CBL,PRKR 4 IN HMI	
	36. SOFT START ASSY	
11	FOLDOUT	11-1

Aqua Whisper DX Modular 450-1800 Section 1 - INTRODUCTION

Introduction

Introduction

1 INTRODUCTION

1.1 PURPOSE

This manual is intended for Sea Recovery's system technicians, technical support, and training personnel. This manual contains technical information and instructions for the installation, operation, maintenance, and troubleshooting of the Sea Recovery Desalination System.

1.2 SAFETY IN GENERAL

Anyone responsible for the installation, operation, and maintenance of the Sea Recovery Desalination System must read this manual thoroughly and comply with the instructions, guidelines, and safety requirements at all times.

1.3 USING THIS MANUAL

Reading this manual in its entirety will help users to become familiar with each component within the system. By understanding the function, importance, and normal operation of each component, users can readily operate and diagnose problems.

Aside from this section, this manual is divided into ten majors sections.

- Section 2: System Description
- Section 3: Pre-installation Notes
- Section 4: Electrical Information
- Section 5: Installation Requirements
- Section 6: Commissioning
- Section 7: Operation
- Section 8: Maintenance and Repair
- Section 9: Troubleshooting
- Section 10: Exploded Parts View
- Section 11: Foldouts

Each section should be reviewed in the order provided before performing any system operations.

1.4 TERM USED

The term System refers to Aqua Whisper System in general and will be used throughout this manual.

1.5 REFERENCES

All references in this manual refers to other section within this manual unless specifically defined.

1.6 SAFETY NOTES

Safety issues that require users attention are highlight through out this manual as follows.



WARNING: A Warning note provides critical information users must comply with in order to prevent the possibility of injuries and/or death.

CAUTION: A Caution note provides important information users must know to prevent the possibility of damaging the device or equipment.

NOTE: A Note provides additional information users should know to properly and safely operate the equipment.

1.7 GRAPHICS

Graphics used are for reference and illustration purposes only, and may not represent the actual part or arrangement of parts in a customized system.

1.8 GLOSSARY

Following terms are helpful in becoming familiar with the Sea Recovery Reverse Osmosis System.

BOUNDARY LAYER / CONCENTRATION POLARIZATION

When water permeates through the membrane, nearly all the salt is left behind in the brine channel. In any dynamic hydraulic system, the fluid adjacent to the wall of the vessel is moving relatively slow. Even though the main body of the stream is turbulent, a thin film adjacent to the wall (membrane) is laminar. This thin film is called the boundary layer.

At the boundary layer the salts are saturated and can readily adhere to and pack into the R.O. membrane element surface if the Feed Water Flow is insufficient. For this reason it is important to maintain sufficient Feed Water flow, to prevent Concentration Polarization, through the R.O. membrane element.

BRINE VELOCITY

The brine flow over the membrane surface is very important to both product water quality and quantity. At low flows, concentration polarization occurs, causing the water quality to decline. In addition to inferior product water quality, low brine flows can increase the precipitation of sparingly soluble salts which will foul the R.O. membrane element surface (concentration polarization). If this occurs, the product water flux (production) will decline.

The Feed Pump integrated design provide a relatively smooth and continual flow of Feed Water across and through the R.O. membrane element.

COMPACTION

Some densification of the membrane structure may take place while operating at elevated pressures, above 1000 PSI. The change is known as compaction and is accompanied by a reduction in the water permeation rate.

When the R.O. membrane element is subjected to elevated pressures beyond 1000 PSI the Product Water Channel becomes squeezed which results in restriction and in turn product water recovery reduction.

OSMOTIC PRESSURE

The transfer of the water from one side of the membrane to the other will continue until the head (pressure) is great enough to prevent any net transfer of the solvent (water) to the more concentrated (feed water) solution.

At equilibrium, the quantity of water passing in either direction is equal, and the head pressure is then defined as the "Osmotic Pressure" of the solution having that particular concentration of dissolved solids.

PRESSURE

The operating pressure has a direct affect on product water quality and quantity. Both factors will increase as the system pressure increases (higher quantity and higher quality within design limits).

The system must be operated at the lowest pressure required to achieve the designed product water flow rate. This parameter also minimizes compaction, which proceeds at a faster rate at higher pressures as well as at higher temperatures.

The System self adjusts its operating pressure to maintain a precise amount of Product Water Flow. However in so doing, at low temperatures and or high salinity feed water conditions the system will operate at higher than normal pressure in maintaining the specified amount of product water flow. This is normal, to be expected, and is due to the design characteristics of the system.

SPIRAL-WOUND MEMBRANE

The spiral-wound membrane consists of multiple membrane envelopes each formed by enclosing a channelized product water carrying material between two large flat membrane sheets. The membrane envelope is sealed on three edges with a special adhesive and attached with the adhesive to a small diameter pipe.

A polypropylene screen is used to form the feed water channel between the membrane envelopes. A wrap is applied to the membrane element to maintain the cylindrical configuration. The center tube is also the permeate (product water) collecting channel. Several elements may be connected in series within a single or multiple pressure vessels).

WATER TEMPERATURE EFFECT

The product water flow through the membrane is significantly affected by the water temperature. At any given pressure this flow increases with increasing water temperature and is reduced at lower temperatures. The System over comes this factor by self adjusting the operating pressure to maintain a precise amount of Product Water Flow.

Aqua Whisper DX Modular 450-1800 Section 2 - SYSTEM DESCRIPTION

Description

2 SYSTEM DESCRIPTION

Since 1981, Sea Recovery Corporation has been producing water desalination systems for various applications to customers all around the world. Since then Sea Recovery has become one of the top leaders in advanced water desalination systems for leisure marine applications.



2.1 MODELS

Aqua Whisper Modular series are available in six models.

- SRC Aqua Whisper DX 450-1
- SRC Aqua Whisper DX 700-1
- SRC Aqua Whisper DX 900-1
- SRC Aqua Whisper DX 900-2
- SRC Aqua Whisper DX 1400-2
- SRC Aqua Whisper DX 1800-2

2.2 SPECIFICATIONS

Refer to Page 2-2 for System Specification details.

2.3 COMPLIANCE

Sea Recovery's Reverse Osmosis Desalination Systems are Type Accepted by the American Bureau of Shipping, ABS.

Sea Recovery's Reverse Osmosis Desalination Systems comply with FCC $\$ 15.105

Sea Recovery's Reverse Osmosis Desalination Systems have been independently tested and determined to be in compliance with European CE (Conformité Européne).

Refer to Page 2-5 for compliance certificates.

2.4 WARRANTY

Sea Recovery guarantees its product, components, and replacement parts and recommends customers to use only Sea Recovery parts. The majority of RO system problems derive from premature failure of unauthorized third party replacement parts. Using unauthorized third party components will lead to higher operating costs and maintenance costs and labor. Most importantly, using unauthorized parts will void Sea Recovery Warranty.

2.5 REGISTRATION

Sea Recovery recommends all customers to register their System immediately after delivery to ensure and guarantee product technical support and warranty.

2.6 PACKING LIST

For visual packing list and optional accessories refer to Page 2-13.

2.7 COMPONENT DIMENSIONS

Refer to Page 2-15 for system and component dimensions.

2.8 DAILY SYSTEM READING

Refer to Page 2-17 for daily system reading log sheet.

2.9 CHEMICAL SAFETY

Refer to Page 2-18 for chemical safety and first aid recommendations.

2.10 TEMPERATURE AND PRESSURE EFFECTS

Refer to Page 2-20 for temperature and pressure effects on RO membrane performance.

SYSTEM SPECIFICATIONS:

PERFORMANCE:

PRODUCT WATER PRODUCED PER HOUR AND PER DAY OF OPERATION:

(+-15% at 850 psig / 56 BAR, 77°F / 25°C & 35,000 PPM TDS Feed Water Salinity)

Model Number	per 1 hour of operation:		per 24 hours of operation:	
	U.S. Gallons / Liters		U.S. Gallons / Liters	
SRC Aqua Whisper 450-1	19 71 450 1703			
SRC Aqua Whisper 700-1	29	110	700	2650
SRC Aqua Whisper 900-1	38	142	900	3407
SRC Aqua Whisper 900-2	38	142	900	3407
SRC Aqua Whisper 1400-2	58	221	1400	5300
SRC Aqua Whisper 1800-2	75	284	1800	6814

SALT REJECTION (CHLORIDE ION): 99.4%

PRODUCT WATER TEMPERATURE: Ambient to feed water temperature

SPECIFICATIONS:

SALINITY MONITORING: Automatic computer controlled electronic monitoring. The salinity monitoring components of the system give a continuous readout in micro ohms per cubic centimeter, are temperature compensated and of a fail-safe design.

SALINITY RANGE OF FEED WATER:

Seawater up to 50,000 PPM TDS (NaCl) (typical seawater salinity is 35,000 PPM) TEMPERATURE RANGE: Max. 122°F / 50°C, Min. 33°F / .5°C

SYSTEM FEED WATER:

	Alternating Current 50 Hz	Alternating Current 60 Hz
Feed Water Flow Per Hour:	225 U.S. Gallons / 852 Liters	270 U.S. Gallons / 1,022 Liters

REVERSE OSMOSIS MEMBRANE:

TYPE: Specifically selected High Rejection / High Yield aromatic tri-polyamide, thin film composite, spiral wound, single pass reverse osmosis membrane element.

CHLORINE TOLERANCE: 0.1 PPM.

pH RANGE: 3-11 (typical seawater pH is 8)

SYSTEM PRESSURE:

FEED WATER: Minimum 6 psi / .42 Kg/cm2. / 41.4 kPa	Maximum 40 psi / 2.8 Kg/cm2 / 275.8 kPa
OPERATION: Seawater @ 35,000 PPM & 77° F / 25° C:	Nominal 800 psi / / 56.25 Kg/cm2 / 5516 kPa

EXTERNAL INSTALLATION WATER CONNECTIONS:

Pipe sizes to be supplied by the installer for connection of the Sea Recovery supplied components

Aqua Whisper

Feed Inlet:	3/4 in. (19 mm) MNPT Male National Pipe Thread U.S. Standard
Brine Discharge	3/4 in. (19 mm) MNPT Male National Pipe Thread U.S. Standard
Product	1/2 in. (12.7 mm) FNPT Female National Pipe Thread U.S. Standard

WEIGHT:

MODEL	Modular Style
Aqua Whisper 450-1	149 lbs / 68 kg
Aqua Whisper 700-1	152 lbs / 69 kg
Aqua Whisper 900-1	154 lbs / 70 kg
Aqua Whisper 900-2	161 lbs / 73 kg
Aqua Whisper 1400-2	167 lbs / 76 kg
Aqua Whisper 1800-2	172 lbs / 78 kg



CERTIFICATE NUMBER: LA2004823- X

PORT OFFICE: Los Angeles, CA

Certificate of MANUFACTURING ASSESSMENT

his is to certify that: The Undersigned did evaluate the relevant manufacturing quality procedures for the type of products of the manufacturer:

Parker Hannifin Corporation Filtration Group / Water Purification Plant at Carson CA

The methods of assuring and controlling quality during production as required by the ABS Rules or Guides for the product and the associated specifications or standard were verified to reflect the specific surveys, required by the Rules and Standards for the manufacture of:

Oil Filtering Equipment

The manufacturer presented a sample or specimen of the product, representative of the "type" approved, to the undersigned, for the purpose of verifying that the "type" has been manufactured in conformance with the Manufacturer's Product Design Assessments.

This Certificate of Manufacturing Assessment is an evaluation of the manufacturer alone and is neither an approval nor a rejection of the product described above. Unless cancelled, expired or revoked, this certificate remains valid subject to annual audits

Consult the ABS Type Approval website to confirm the continued validity of this certificate and the status of the particular products being manufactured.

ISSUE DATE	24 November 2014	EXPIRATION DATE	23 November 2019
SURVEYOR	atta	ABS	
FIRST ANNUAL ENDORSEMENT		S ANGELES	11
SECOND ANNUAL ENDORSEMENT		2. B. P.	
THIRD ANNUAL ENDORSEMENT	C. M	1959	
FOURTH ANNUAL ENDORSEMENT			


Note: This Certificate evidences compliance with one or more of the Rules, guides, standards or other criteria of American Bureau of Shipping and is issued solely for the use of the Bureau, its committees, its clients or other authorized entities. This Certificate is a representation only that the structure, item of material, equipment, machinery or any other item covered by this Certificate has met one or more of the Rules, guides, standards or other criteria of American Bureau of Shipping as of the date of issue. Parties are advised to review the Rules for the scope and conditions of classification and to review the survey records for a fuller description of any restrictions or limitation on the vessel's service or surveys. The validity, applicability and interpretation of this Certificate is governed by the Rules and standards of American Bureau of Shipping who shall remain the sole judge thereof. Nothing contained in this Certificate or in any notation made in contemplation of this Certificate shall be deemed to relieve any designer, builder, owner, manufacturer, seller, supplier, operator or other entity of any warranty express or implied.

AB 257 (09-11)

Note: This Certificate evidences compliance with one or more of the Rules, guides, standards or other criteria of American Bureau of Shipping and is issued solely for the use of the Bureau, its committees, its clients or other authorized entities. This Certificate is a representation only that the structure, item of material, equipment, machinery or any other item covered by this Certificate has met one or more of the Rules, guides, standards or other criteria of American Bureau of Shipping as of the date of issue. Parties are advised to review the Rules for the scope and conditions of classification and to review the survey records for a fuller description of any restrictions or limitation on the vessel's service or surveys. The validity, applicability and interpretation of this Certificate is governed by the Rules and standards of American Bureau of Shipping who shall remain the sole judge thereof. Nothing contained in this Certificate or in any notation made in contemplation of this Certificate shall be deemed to relieve any designer, builder, owner, manufacturer, selier, supplier, repairer, operator or other entity of any warranty express or implied.

``

.

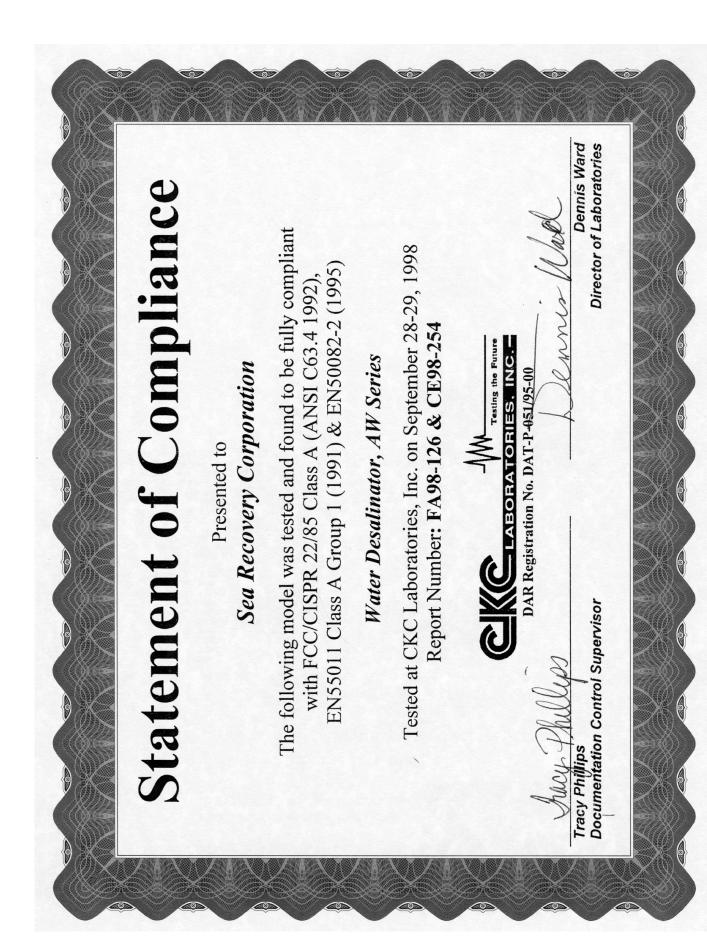

Description

FCC

Sea Recovery's Reverse Osmosis Desalination Systems comply with FCC § 15.105

United States Federal Communications Commission Compliance

FCC § 15.105

This equipment has been tested and found to comply with the limits for a Class A digital device, pursuant to Part 15 of the FCC Rules. These limits are designed to provide reasonable protection against harmful interference when the equipment is operated in a commercial environment. This equipment generates, uses, and can radiate radio frequency energy and, if not installed and used in accordance with the instruction manual, may cause harmful interference to radio communications. Operation of this equipment in a residential area is likely to cause harmful interference in which case the user will be required to correct the interference at his own expense.

Declaration of Conformity CE

SEA RECOVERY declares that the following models conform to the EN 55011A and EN 50082-2 standards:

Product Series:

Aqua Matic Series Aqua Whisper Series Aqua Whisper Mini Series Ultra Whisper Series Coral Sea Series

Model Names:

Aqua Matic Aqua Whisper / DX Aqua Whisper Mini Ultra Whisper Coral Sea



Manufacturer's Name: Sea Recovery Manufacturer's Address: 19610 South Rancho Way Rancho Dominguez, CA 90220 U.S.A.



Official Seal

Supplementary Information:

"The product complies with the Requirements of the EMC Directive 89/336/EEC."

Lisa Gomez Quality & Environmental Manager Manufacturer's Contact

European Conformité Européne (CE)

Sea Recovery's Reverse Osmosis Desalination Systems have been independently tested and determined to be in compliance with European CE (Conformité Européne)

The CE Mark ('Trade Passport to Europe') is a visible declaration by the manufacturer (or his representative, importer, etc.) that the equipment which is marked complies with all the requirements of all the applicable directives. This mark allows manufacturers and exporters to circulate products freely within the 15 European Union (EU) members. Having ensured that the equipment does indeed meet all these requirements (including all the administrative requirements involved in being able to demonstrate compliance), the CE Mark may then be affixed and the product released.

The letters, "CE", indicate that the manufacturer has undertaken all assessment procedures required for the product. The CE mark indicates conformity to the legal requirements of the EU Directives.

The "CE" mark is now mandatory for regulated products sold in the European Union.

Some of the damages that may not be covered by the warranty include:

- a) Use of non-authorized or misuse of authorized chemicals for storage will void any warranty.
- b) Rust fouling of the R.O. Membrane Element is not covered under warranty.
- c) Damage to the System caused by a blocked brine discharge or product line will not be covered by warranty.
- d) High temperature will cause up to 40% flux loss (loss of production) of the R.O. membrane element(s). This damage is irreversible to the R.O. membrane element and not covered by warranty.
- e) Freezing temperatures will cause mechanical damage to the System and R.O. membrane element due to the expansion of water as it freezes. This damage is irreversible and not covered by any warranty.
- f) Damage caused by excessive vibration will not be covered under warranty.

PACKING LIST


UNCRATING:

- 1. DO NOT DISCARD ANY PACKAGING UNTIL YOU HAVE FOUND AND IDENTIFIED ALL PARTS!
- 2. Remove the system from the shipping carton.
- 3. Some of the components are loose or separately packaged in the shipping container.



Installation Kit B0019400001

ITEM	PART NO	DESCRIPTION	QTY	UM
1	061100043000	WASHER FLAT OS 1/4"SS	12.00	EACH
2	061172143016	SC HEX "A" 1/4 X 1 SS	12.00	EACH
3	05181432AA	HOSE CLAMP 1/2"	4.00	EACH
4	05181434AA	HOSE CLAMP 3/4" SS	22.00	EACH
5	061170628016	SC PHIL PAN "A" 10 X 1 SS	5.00	EACH
6	061080028000	WASHER FLAT #10 SS	5.00	EACH
7	2115031700	RUBBER MOUNT 90 LB AQM	4.00	EACH
8	061110049000	WASHER FENDER 5/16"SS	4.00	EACH
9	061172149036	SC HEX "A" 5/16 2 3/8 SS	4.00	EACH
10	B651930002	OWNERS MANUAL AQWM-DX	1.00	EACH
11	B645800001	MCC-1 ALKALINE CLEANER	1.00	EACH
12	B645800002	MCC-2 ACID CLEANER	1.00	EACH
13	0328066666	HOSE CLEAR BRAID 3/4"	50.00	FEET
14	0101013783	ELB90 3/4 FPT X 3/4 FPT PVC	1.00	EACH
15	0101653783	ADAP 3/4 MPT X 3/4 BARB PVC	3.00	EACH
16	0421051239	SEA STRAINER-3/4 BRONZE	1.00	EACH
17	0101073783	ELB90 3/4 MPT X 3/4 BARB PVC	2.00	EACH
18	0101423783	TEE 3/4 FT X 3/4 FT X 3/4 FT P	2.00	EACH
19	0101293483	RB 3/4 MT X 1/4 FT PVC	2.00	EACH
20	0204020869	ELB90 1/4 TUBE X 1/4 MPT PLAST	2.00	EACH
21	0312121969	TUBE 1/4 BLACK	20.00	FEET
22	0101292383	RB 1/2 MT X 1/4 FT PVC	1.00	EACH
23	0101422583	TEE 1/2 FT X 1/2 FT X 1/2 FT P	1.00	EACH
24	0101652683	ADAP 1/2 MPT X 3/4 BARB PVC	2.00	EACH
25	0101652583	ADAP 1/2 MPT X 1/2 BARB PVC	1.00	EACH
26	0328065066	HOSE CLEAR BRAID 1/2"	50.00	FEET
27	0101012583	ELB90 1/2 FPT X 1/2 FPT PVC	1.00	EACH
28	0312123569	TUBE 3/8 BLACK	20.00	FEET

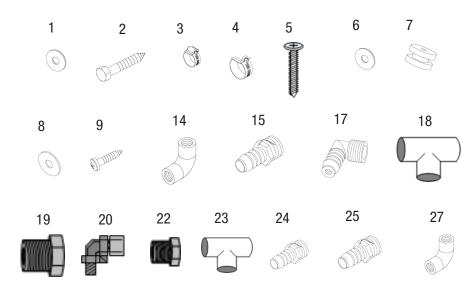











26

13

HOSE CLEAR BRAID 1/2" I.D. QTY: 50 FEET (15.24 METERS)




HOSE CLEAR BRAID 3/4" I.D. QTY: 50 FEET (15.24 METERS)



Tube 3/8 Black 20 Ft

OPTIONAL ACCESSORIES



MULTI-MEDIA FILTER ASSY P/N B071080002 MEDIA SAND A100 MEDIA GARNET 8-12 HOSE CLAMP 3/4" SS SC HEX "A" 1/4" x 1 SS WASHER FLAT OS 1/4" SS QTY: 25 LBS QTY: 17 LBS QTY: 8 QTY: 4 QTY: 4




DUAL PLANKTON FILTER P/N B008800002 HOSE CLAMP 3/4" SS QTY: QTY: 4 QTY: 8 SC HEX "A" 1/4" x 1" SS SC HEX "A" 1/4" x 1" SS QTY: 8



 PLANKTON FILTER SINGLE P/N B008800001

 HOSE CLAMP 3/4" SS
 QTY: 8


 SC HEX "A" 1/4 x 1" SS
 QTY: 4
 WASHER FLAT OS 1/4" SS QTY: 4




COMMERCIAL PREFILTER P/N E	3109120001
ADAP 3/4" MNPT x 3/4" BARB	QTY: 2
HOSE CLAMP 3/4" SS	QTY: 4
SC HEX "A" 1/4" x 1" SS	QTY: 4
WASHER FLAT OS 1/4" SS	QTY: 4
TUBE 1/4" OD BLACK NYLON	QTY: 15 FT
HOSE CLAMP 3/4" SS SC HEX "A" 1/4" x 1" SS WASHER FLAT OS 1/4" SS	QTY: 4 QTY: 4 QTY: 4

0000	
0000	
0 ⁰ 0	


OIL/WATER SEPERATOR P/N B1	11120001
ADAP 3/4" MNPT x 3/4" BARB	QTY: 2
HOSE CLAMP 3/4" SS	QTY: 4
SC HEX "A" 1/4" x 1" SS	QTY: 4
WASHER FLAT OS 1/4" SS	QTY: 4
TUBE 1/4" OD BLACK NYLON	QTY: 15 FT



CLEANING & RINSE VALVE KIT P/N B591080001 HOSE CLAMP 3/4" SS SC PHIL PAN "A" #10 X 1 SS QTY: 12 QTY: 8 WASHER FLAT OS #10 NYLON QTY: 8



UV Light SP Series




Remote Panel B610140005



SOFT START ASSY AW P/N B59680006	
SOFT START ASSY W/ 10 FOOT CABLE	QTY: 1
STRAIN RELIEF 90° CG90-6250 (FOR HPP MOTOR)	QTY: 1
STRAIN RELIEF PG-21 (FOR CONTROL BOX)	QTY: 1
SC PHIL PAN "A" #10 X 1 SS	QTY: 4
WASHER FLAT OS #10 SS	QTY: 4


MODULAR UNIT DIMENSIONS

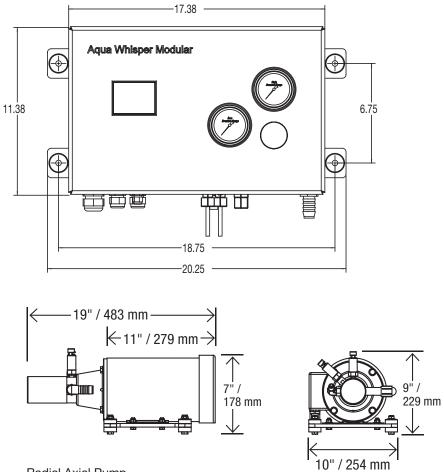

Radial Axial Pump

Note: Illustration shows the optional HP Pump.

COMPONENT DIMENSIONS

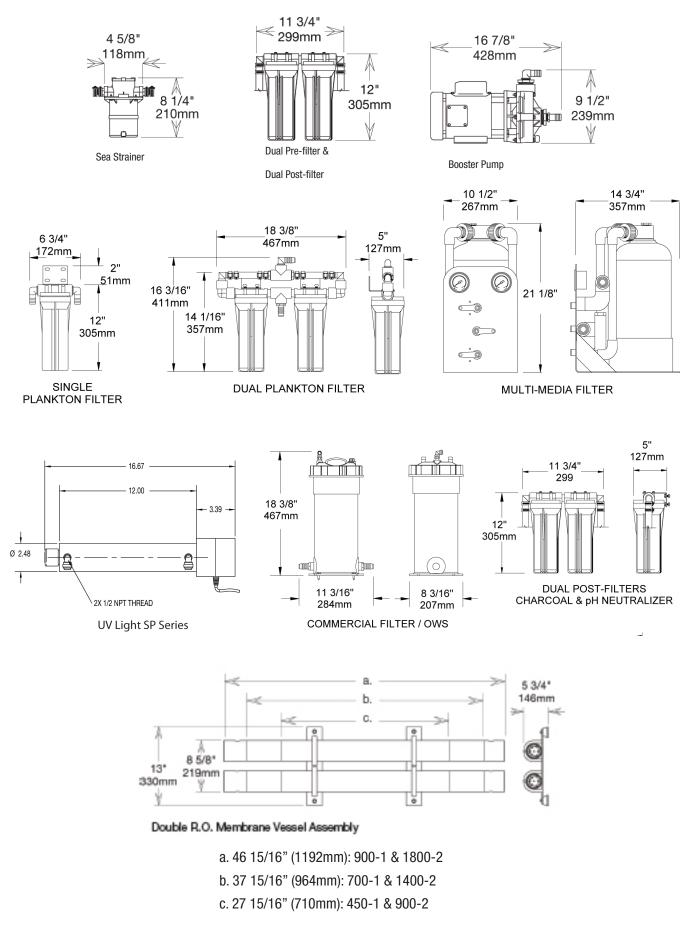

DAILY PERFORMANCE SHEET

Sea Recovery Aqua Whisper DX

DAILY READINGS

At the time of commissioning the NEW system, record the following information after one hour of continuous proper operation of the system.

Retain this form in this Owner's Manual for the owner and operator's future reference. This information is valuable to the servicing technicians in providing technical support to the owner and future operators of the Aqua Whisper. Provide this information to service technicians when requesting technical assistance.

Date Installed:		Date Commissioned:				_
Model Information:						
System Serial Number:						
Style: Compact Vertical						
R.O. Membrane/Vessel Assy Quantity:	1 (one)	2 (two)			
System Capacity: 450 GPD				1400 G	PD 1800 GP	'nD
Who Installed the System:						
Company						
Street Address						
City, State						
Country, postal code			Te	elephone		_
Name of Installer						
Who Commissioned the System:						
Company						
Street Address						
City, State						
Country, postal code			Te	elephone		
Name of Installer						
System Power: Volts AC	Hz		Phase			
Feed Water Temperature: Fahre	nheit or	C	elsius			
Hour Meter Reading: Hours						
PRESSURE READINGS:						
Low Pressure Transducer #1 ps	si or		kPa			
Pressure Differential Pressure	psi	or _		kPa		
Low Pressure Transducer #2 ps	si or		kPa			
High Pressure Transducer ps	si or		kPa			
WATER FLOW METER READINGS:						
Flow Meter Product Water: US	Gallons Per H	lour o	r _	l	_iters Per Hour	
Flow Meter Brine Discharge: US			r	I	Liters Per Minute	
WATER QUALITY:						
Feed Water Salinity: ppm	or Location	of use:				
Product Water Salinity:						
Problems, Unusual Occurrences, or Unusua						

CHEMICAL SAFETY AND FIRST AID

Sea Recovery SRC SC Storage Chemical

WARNING! CONTAINS SODIUM METABISULFITE. HARMFUL IF SWALLOWED, AVOID BREATHING DUST AND FUMES. CAUSES IRRITATION TO EYES AND MUCOUS MEMBRANES. DO NOT TAKE INTERNALLY. KEEP AWAY FROM FOOD.

FIRST AID: IF SWALLOWED, CALL A PHYSICIAN, GIVE TAP WATER AND INDUCE VOMITING. IN CASE OF CONTACT IMMEDIATELY FLUSH EYES WITH WATER FOR 15 MINUTES AND GET IMMEDIATE MEDICAL ATTENTION. THOROUGHLY WASH AFFECTED SKIN AFTER HANDLING PRODUCT.

MEDICAL PERSONNEL FAMILIAR WITH Sea Recovery "SRC SC", SYSTEM AND MEMBRANE STORAGE CHEMICAL, ARE AVAILABLE 24 HOURS A DAY, 7 DAYS A WEEK, U.S.A. TOLL FREE MEDICAL EMERGENCY NUMBER: 1-800-228-5635.

FOR INDUSTRIAL USE ONLY.

Use with adequate ventilation. Prevent breathing dust and prevent contact with eyes. Thoroughly wash contacted parts after handling. Do not allow powder to become wetted with small amounts of water. Adding small amounts of water to power may liberate irritating sulfur dioxide gas. Add powder to above specified amount of water only. Do not mix with other chemicals or cleaners. If spilled, sweep up as much as possible then flush with water to drain.

KEEP OUT OF REACH OF CHILDREN

NET CONTENTS 1.5 POUNDS (.68 Kg)

Sea Recovery SRC MCC-1 Membrane Cleaning Chemical

WARNING: CONTAINS SODIUM METASILICATE. HARMFUL IF SWALLOWED. MAY CAUSE BURNS. AVOID CONTACT WITH EYES. AVOID PROLONGED CONTACT WITH SKIN. DO NOT TAKE INTERNALLY. KEEP AWAY FROM FOOD.

FIRST AID: IF SWALLOWED, CALL A PHYSICIAN, DO NOT INDUCE VOMITING, GIVE ONE GLASS OF TAP WATER OR MILK. IN CASE OF CONTACT IMMEDIATELY FLUSH EYES WITH WATER FOR 15 MINUTES AND GET IMMEDIATE MEDICAL ATTENTION. THOROUGHLY WASH AFFECTED SKIN AFTER HANDLING PRODUCT. CONTACT A PHYSICIAN IF IRRITATION PERSISTS.

MEDICAL PERSONNEL FAMILIAR WITH Sea Recovery "SRC MCC1", R.O. MEMBRANE ELEMENT ALKALINE DETERGENT CLEANING CHEMICAL, ARE AVAILABLE 24 HOURS A DAY, 7 DAYS A WEEK, U.S.A. TOLL FREE MEDICAL EMERGENCY NUMBER: 1-800-228-5635.

FOR INDUSTRIAL USE ONLY.

Use with adequate ventilation. Prevent breathing dust and prevent contact with eyes. Thoroughly wash contacted parts after handling. Do not allow powder to become wetted with small amounts of water. Add powder to above specified amount of water only. Do not mix with other chemicals or cleaners. If spilled, sweep up as much as possible then flush with water to drain.

KEEP OUT OF REACH OF CHILDREN

NET CONTENTS 1.5 POUNDS (.68 Kg)

Sea Recovery SRC MCC-2 Membrane Cleaning Chemical

DANGER: CONTAINS SULFAMIC ACID. CAUSES BURNS, EYE AND SKIN IRRITATION. HARMFUL IF SWALLOWED. AVOID BREATHING DUST. DO NOT TAKE INTERNALLY. KEEP AWAY FROM FOOD.

FIRST AID: IF SWALLOWED, CALL A PHYSICIAN, DO NOT INDUCE VOMITING, GIVE ONE GLASS OF TAP WATER OR MILK. IN CASE OF CONTACT IMMEDIATELY FLUSH EYES WITH WATER FOR 15 MINUTES AND GET IMMEDIATE MEDICAL ATTENTION. THOROUGHLY WASH AFFECTED SKIN AFTER HANDLING PRODUCT. CONTACT A PHYSICIAN IF IRRITATION PERSISTS.

MEDICAL PERSONNEL FAMILIAR WITH Sea Recovery "SRC MCC2", R.O. MEMBRANE ELEMENT ACID CLEANING CHEMICAL, ARE AVAILABLE 24 HOURS A DAY, 7 DAYS A WEEK, U.S.A. TOLL FREE MEDICAL EMERGENCY NUMBER: 1-800-228-5635. FOR INDUSTRIAL USE ONLY.

DO NOT MIX WITH CHLORINATED SOLUTIONS OR COMPOUNDS. Use with adequate ventilation. Prevent breathing dust and prevent contact with eyes. Thoroughly wash contacted parts after handling. Do not allow powder to become wetted with small amounts of water. Add powder to above specified amount of water only. Do not mix with other chemicals or cleaners. If spilled, sweep up as much as possible then flush with water to drain.

KEEP OUT OF REACH OF CHILDREN

NET CONTENTS 1.5 POUNDS (.68 Kg)

Sea Recovery SRC MCC-3 Membrane Cleaning Chemical

WARNING: CONTAINS SODIUM METABISULFITE. HARMFUL IF SWALLOWED. AVOID BREATHING DUST AND FUMES. CAUSES IRRITATION TO EYES AND MUCOUS MEMBRANES. DO NOT TAKE INTERNALLY. KEEP AWAY FROM FOOD.

FIRST AID: IF SWALLOWED, CALL A PHYSICIAN, GIVE TAP WATER AND INDUCE VOMITING. IN CASE OF CONTACT IMMEDIATELY FLUSH EYES WITH WATER FOR 15 MINUTES AND GET IMMEDIATE MEDICAL ATTENTION. THOROUGHLY WASH AFFECTED SKIN AFTER HANDLING PRODUCT. CONTACT A PHYSICIAN IF IRRITATION PERSISTS.

MEDICAL PERSONNEL FAMILIAR WITH Sea Recovery "SRC MCC3", R.O. MEMBRANE ELEMENT RUST REMOVER CLEANING CHEMICAL, ARE AVAILABLE 24 HOURS A DAY, 7 DAYS A WEEK, U.S.A. TOLL FREE MEDICAL EMERGENCY NUMBER: 1-800-228-5635.

FOR INDUSTRIAL USE ONLY.

Use with adequate ventilation. Prevent breathing dust and prevent contact with eyes. Thoroughly wash contacted parts after handling. Do not allow powder to become wetted with small amounts of water. Adding small amounts of water to powder may liberate irritating sulfur dioxide gas. Add powder to above specified amount of water only. Do not mix with other chemicals or cleaners. If spilled, sweep up as much as possible then flush with water to drain.

KEEP OUT OF REACH OF CHILDREN

NET CONTENTS 1.5 POUNDS (.68 Kg)

TEMPERATURE AND PRESSURE EFFECTS

Sea Recovery® TEMPERATURE EFFECT COMPARISON CHART

(At 820 psi and 35,000 ppm feedwater TDS conditions)

The Temperature Effect Chart on this page illustrates the loss or gain of productivity across the R.O. Membrane.

To determine what normal (in spec.) flow of the system is at 77° F (25° C), follow these directions:

- 1. Determine feed temperature.
- 2. Locate the corresponding temperature on the chart.
- 3. Follow the corresponding temperature in a vertical line up to the plotted production line.
- 4. From this temperature point at the production line, move left horizontally to the plotted productivity percent.


5. Calculate the system's present productivity in U.S. gallons per day by multiplying the gallon per hour product water flow meter reading by 24.

6. Divide the figure reached in step 5 above, present gallon per day productivity, by the plotted productivity percentage from step 4 above. The answer will be equivalent to the membranes present productivity at specification test parameters, 820 psi & 77° F (25° C).

Example:

- 1. With the system operating at 820 psi (57 bar).
- 2. The present feed temperature is 61° F (16° C).
- 3. Plotted productivity is therefore 72% of normal.
- 4. The system is a 14,530 gallon per day model and it is presently producing 9,000 gallons per day.


5. 9,000 per day divided by .72 equals 12,500 gallons per day calculated productivity. The system is rated at 14,530 gallons per day \pm 15% (12,350 to 16,709 gallons per day). Therefore the system is within specifications at 12,500 gallons per day actual productivity at 61° F (16° C), 820 psi (57 bar), and 35,000 ppm feed.

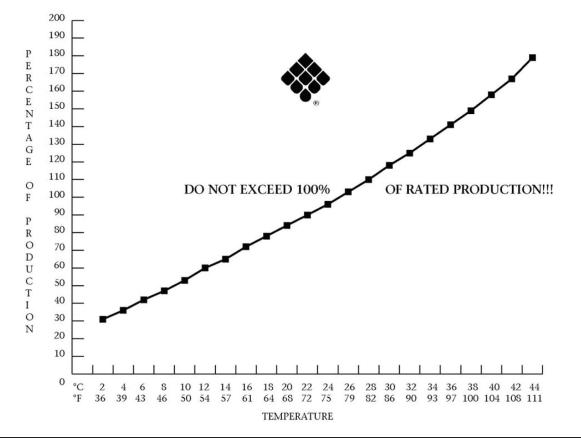

Sea Recovery® TEMPERATURE EFFECT COMPARISON CHART

(Do not use this chart for brackish water systems & applications)

As the seawater temperature increases, the Sea Recovery system pressure must be adjusted so that the system achieves no greater than 100% of rated product water flow. Product water flow greater than 100% of rated capacity causes premature fouling of the R.O. Membrane Element. This leads to more frequent required cleaning and voids all warranties of the SRC R.O. Membrane Elements.

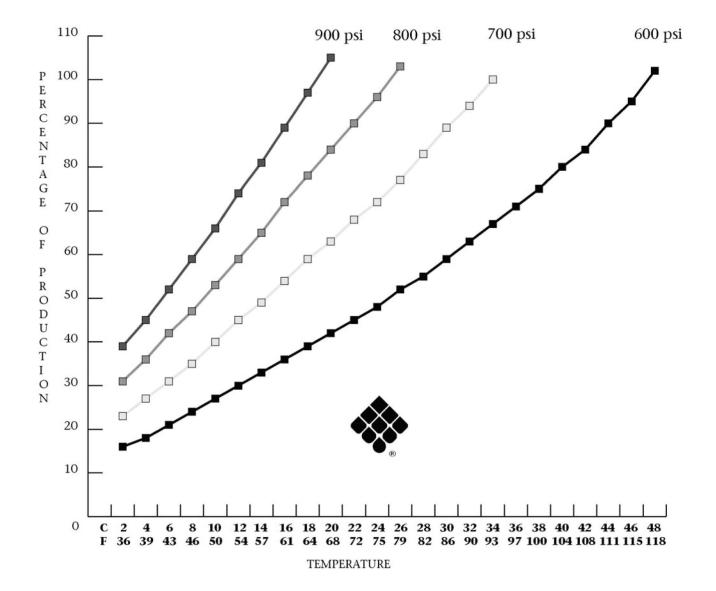

DO NOT EXCEED 100% OF RATED PRODUCTION !!!

This page is intentionally left blank.

Aqua Whisper DX Compact 450-1800 Section 3 - PRE-INSTALLATION NOTES

Pre-installation

3 PRE-INSTALLATION NOTES

3.1 PRECAUTIONS

STORAGE PRIOR TO UNCRATING

- 1. Adhere to crate markings:
 - DO NOT store in direct sunlight;
 - D0 NOT store above 120° F (50° C);
 - DO NOT freeze;
 - D0 N0T store longer than 4 months without flushing with storage chemical;
 - STORE ONLY on base with ARROWS UP.
 - KEEP THE R.O. MEMBRANE ELEMENT WET AT ALL TIMES.
- 2. Refer to Section 3.10 for further cautions of the R.O. Membrane Element.

REVERSE OSMOSIS MEMBRANE ELEMENT SUSCEPTIBILITY TO CHEMICAL ATTACK

CAUTION: Do Not expose the Sea Recovery System to intake Feed Water from any chemical, not approved in writing by Sea Recovery or any of the following chemicals:

Hydrogen peroxide	chloramines-T
Chlorine dioxide	chlorine
Bromine	phenolic disinfectants
chloramines	N-chlorioisocyanurates
hypochlorite	iodine
Bromide	petroleum products

USE OF NON-AUTHORIZED OR MISUSE OF AUTHORIZED CHEMICALS VOIDS SYSTEM WARRANTY

Do not connect any water line to the System that may contain any of the above chemicals. Example: Do not connect the inlet of the System to the ship's potable water system if the ships system contains chlorinated or brominated water. These chemicals destroy the copolymer components within the RO system. These oxidants and others also damage the RO Membrane Element. The Sea Recovery Optional Fresh Water Flush Accessory removes chlorine and bromine from the ship's potable water system.

DO NOT PERFORM INSTALLATION UNLESS:

1. The System Feed Water Sea Cock Valve is closed.

- 2. The system main electrical disconnect switch is switched "OFF", LOCKED, and TAGGED.
- 3. A Volt / Ohm Meter will be necessary.
 - **WARNING:** ELECTRICAL SHOCK HAZARD. The installation procedures expose the installer to High Voltage and electrical shock hazard. Only attempt installation if you are a qualified electrician and only if surrounding conditions are safe.

QUALIFICATIONS

Technicians must have technical knowledge and ability in the following fields:

- bility in bility
- a) Electrical, Electronic, Electric Motors and Circuits
- b) Electromechanical and Mechanical Systems
- c) Hydraulic and Liquid Pressure and Flow Systems
- d) Piping and Plumbing Systems
- e) Water Suction and Pressure Lines
- f) Thru-Hull Fitting below and above water level
 - **WARNING**: Do not attempt Installation, Commissioning, Troubleshooting, or Repair if you are not proficient in the above fields of expertise.

3.2 SPECIAL CONSIDERATIONS

INSTALLATION CAUTIONS

Do not over tighten PVC fittings. If threaded pipe fittings leak after installation, remove the fitting, clean the mating threads, apply 3 to 4 wraps of Teflon tape to the male threads, apply liquid Teflon pipe sealer sparingly, and thread the parts back together. PVC fittings should only be hand tight without the use of a wrench.

The Sea Cock Valve, Inline Pressure Gauge, Sea Strainer, Rinse Clean Inlet Valve, and Booster Pump should be installed below water level. This will aid the Booster Pump in priming.

Always allow hoses and tubes to enter and exit straight from the connection for a minimum of one inch prior to a bend. If stress is placed on the fitting due to a tight bend the fitting will leak and may break.

Avoid skin and eye contact with the membrane packaging solution. In case of skin contact, rinse the skin thoroughly with water. In case of eye contact, flush repeatedly with water and notify a physician immediately. R.O. Membrane Elements are stored in "sodium bisulfite".

NEVER mount liquid holding component above any electrical or electronic device. Extensive damage to the electronic device will result if liquid enters device during maintenance and or component failure.

CONNECTION LINE CAUTIONS

All connection lines should be as short and straight as possible using minimum fittings.

The connection lines must not be "kinked".

ACCESSIBILITY CAUTIONS

This is a simple rule: Install the system and its supporting components in an accessible manner.

The Electrical Control Touch Panel must be accessible for operation and monitoring of the system.

ELECTRICAL POWER REQUIREMENTS

Refer to System Specifications on Page 2-2 and the Electrical information on Section 4 for electrical power requirements. Ensure that the power source is sufficiently sized to provide the correct voltage and cycles during Start Up and Operation.

3.3 DISTANCE BETWEEN COMPONENTS

50 feet (15 meters) of 3/4 in. (19 mm) I.D. clear braided hose is supplied for connecting the Suction Line, Low Pressure Line, and Brine Discharge Line.

50 feet (15 meters) of 1/2 in. (12.7mm) I.D. clear braided hose is supplied for connecting the Product Water Line.

20 feet (6 meters) 1/4 in. (6.35 mm) OD nylon tubing is supplied with applicable components for connecting Pressure Pick Up points for the Low Pressure Transducers.

20 feet (6 meters) of 3/8 in. (9.5mm) OD nylon tubing is supplied with Fresh Water Flush for connection to the boats pressurized fresh water line.

3.5 COMPONENTS SUPPLIED BY INSTALLER

CAUTION: All fittings, valves, and piping installed prior to, within, and after the Sea Recovery system must not contain iron. The resulting failure of the R.O. Membrane Element is attributed to improper installation, is the liability of the installer.


1. Water Connections to be supplied by the installer:

	i.
Feed Inlet at the Sea	3/4 in. (19 mm) MNPT
Cock Valve:	(Male National Pipe Thread
	U.S. Standard)
Brine Discharge at the	3/4 in. (19 mm) MNPT
Thru Hull Discharge	(Male National Pipe Thread
fitting:	U.S. Standard)
Product at the Product	1/2 in. (12.7 mm) FNPT
Water Connector:	(Female National Pipe
	Thread U.S. Standard)
Pressurized Fresh Water	3/8 in. (9.5 mm) FNPT
at the Cleaning Bucket::	(Female National Pipe
	Thread U.S. Standard)

2. Ilnlet Thru Hull Fitting with Forward Facing Scoop. The inlet Thru Hull Fitting must be minimum 3/4 in. (19 mm) and dedicated to only the Sea Recovery system. It is important that the installer utilizes a forward facing scoop so that the system receives a positive flow of water as the boat is under way. The fitting must be installed on the boats hull in a position that provides continual feed water flow without air to the system.



CAUTION: A flush inlet thru-hull fitting will cause a vacuum as the boat is under way, and this will cause loss of feed water flow and cavitation of the Booster Pump and High Pressure Pump resulting in continual system shut down.



CAUTION: The Sea Recovery System must not be tied into another existing auxiliary water line already supplying another accessory on the boat.



CAUTION: If the Sea Recovery System is connected to a Sea Chest or Stand Up Pipe, do not plumb the Sea Recovery System feed line to the "top" of the Sea Chest or Stand Up Pipe. Plumb the Sea Recovery System to the "bottom" of such feed water arrangements to ensure a continual air free supply of feed water to the system.

- Inlet Sea Cock Valve Quarter turn ball valve minimum 3/4 in. (19 mm) size, with a 3/4 in. (19 mm) MNPT connection for mating to the supplied 3/4 in. (19 mm) FNPT Inlet Connection fitting.
- Brine Discharge Thru Hull Fitting minimum 3/4 in. (19 mm) size with a 3/4 in. (19 mm) MNPT connection for mating to the supplied 3/4 in. (19 mm) FNPT Brine Discharge Connector fitting. The Brine Discharge Thru Hull Fitting must be installed above water level.

Do not install any valve in the Brine Discharge line. A blockage or closed valve will cause damage to the System.

5. Connection of the Sea Recovery Product Water Line to the boat's UNPRESSURIZED Potable Water Storage Tank requires a 1/2 in. (12.7 mm) FNPT connection for mating to the supplied 1/2 in. (12.7 mm) MNPT Product Water Connector fitting. In order to avoid problems such as reverse flow (osmosis) from the tank to the system and chlorination attack of the R.O. Membrane Element, the fitting must terminate above the maximum water level.

> No valves should be installed in this line. A blockage or closed valve in the Product Water Line will cause extensive damage to the System and R.O. Membrane Element.

- Connection of the Sea Recovery Fresh Water Flush subassembly to the boat's PRESSURIZED Potable Water Line requires a 3/4 in. (19 mm) FNPT connection for mating to the 3/4 in. (19 mm) MNPT fitting supplied with the Fresh Water Flush sub assembly.
- 7. Circuit Breaker with appropriate Amperage Rating. Refer to Section 4 for details.
- 8. Properly sized Power Cables. Refer to Section 4 for details.
- 9. An electrical power source capable of delivering the required constant voltage and cycles during start up and operation of the System. Refer to Section 4 for details.

3.6 PIPING AND INTERCONNECT DIAGRAMS


Different Piping and Interconnect Diagrams are illustrated in this section. These illustrations include Standard and Optional Accessory configurations.

Determine the Prefiltration and Post Filtration components that were supplied with the system being installed. Locate the appropriate diagram from the following pages. Interconnect the components as per the appropriate diagram.

Note: Symbol Used in this Section.

- ** Indicates items supplied by owner/installer
- *** Indicates optional equipment.

System P&ID-Dual Prefilters

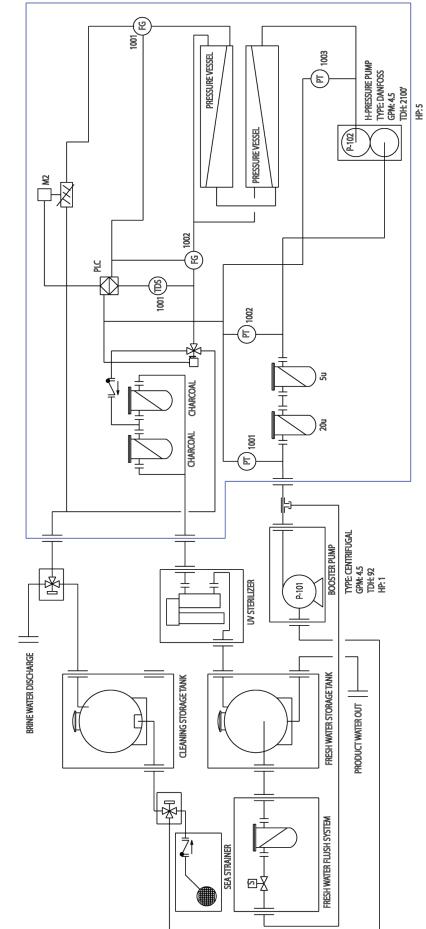

Note: Illustration shows the optional HP Pump.

PT-Pressure Transducer PI-Pressure Indicator


M-Meter FG-Flow Gauge

гч-гюм чаиде TDS-TDS Meter


P-Pump PLC-Program Loogic Controller


Note: Refer to the bigger drawing foldout at the end of this manual.

Note: Refer to the bigger drawing foldout at the end of this manual.

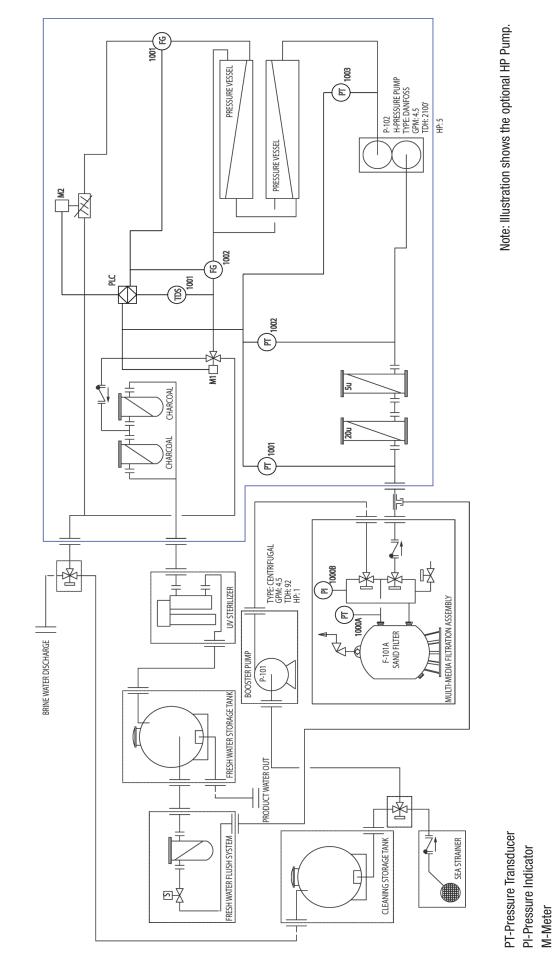


FG-Flow Gauge TDS-TDS Meter P-Pump PLC-Program Loogic Controller

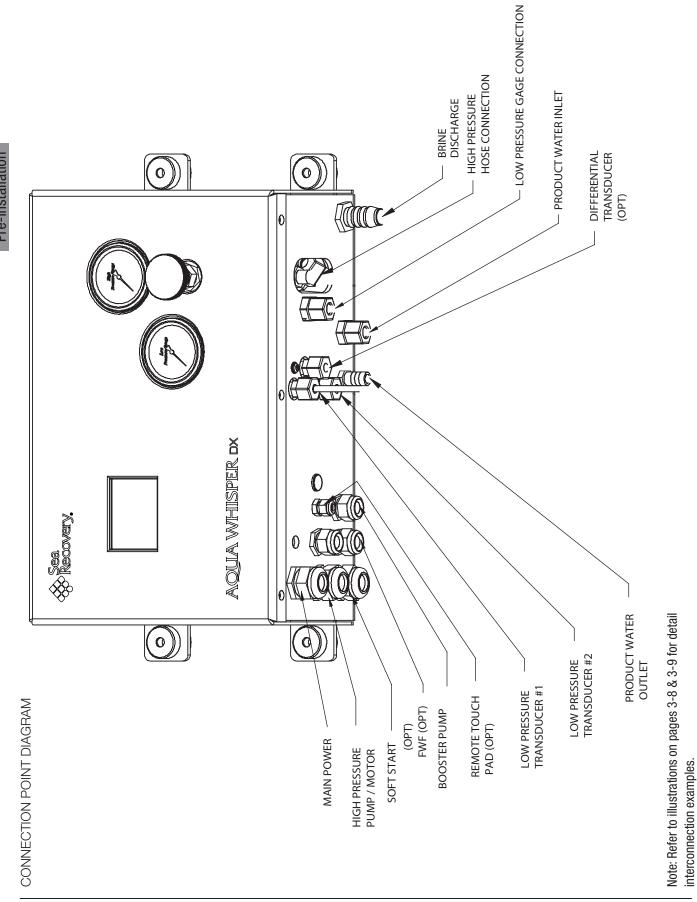


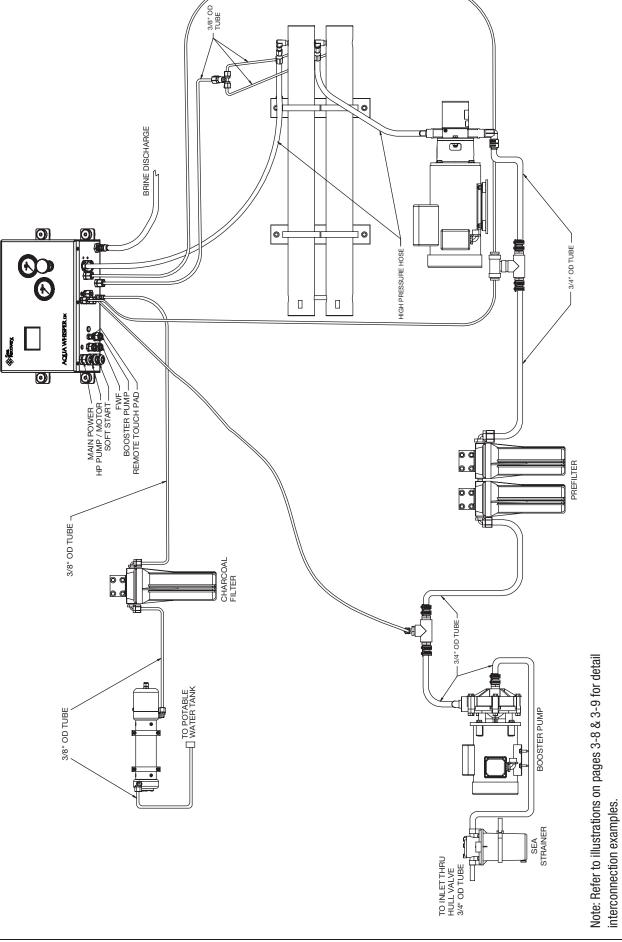



STANDARD PREFILTER INSTALLATION

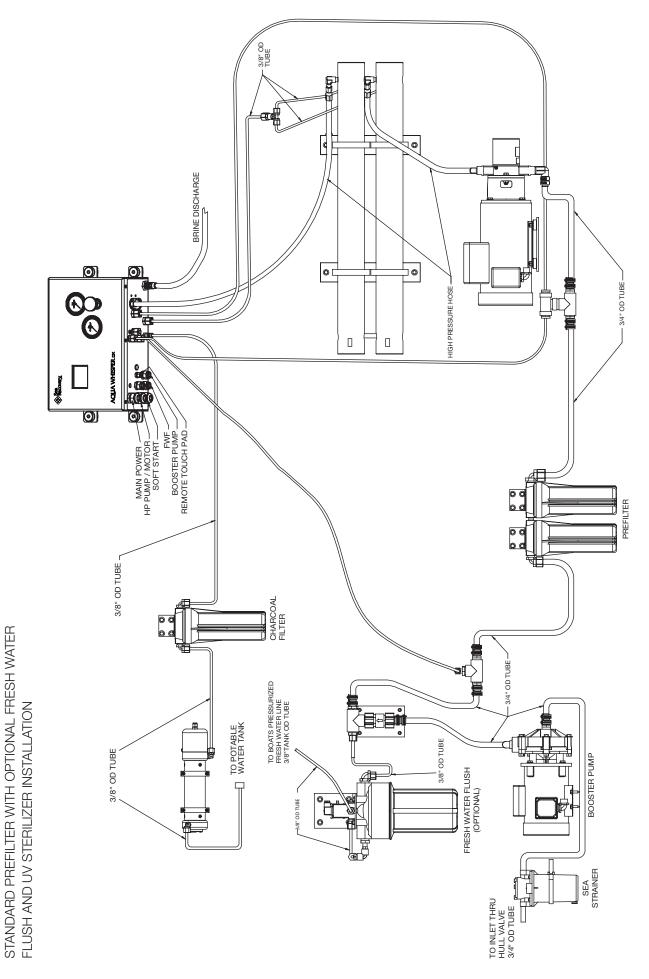


Note: Refer to illustrations on pages 3-8 & 3-9 for detail interconnection examples.

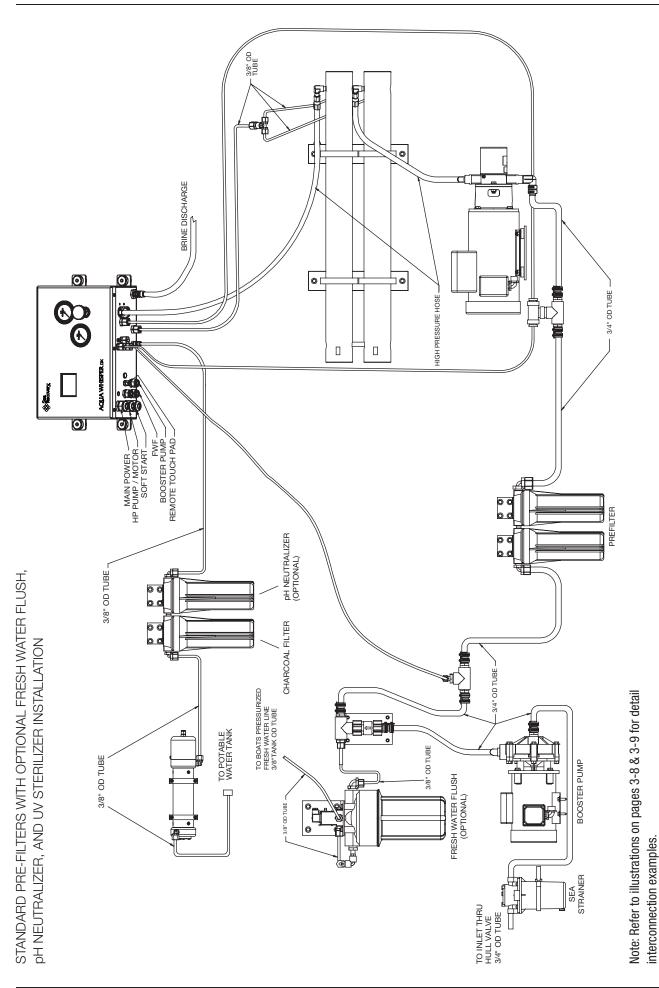

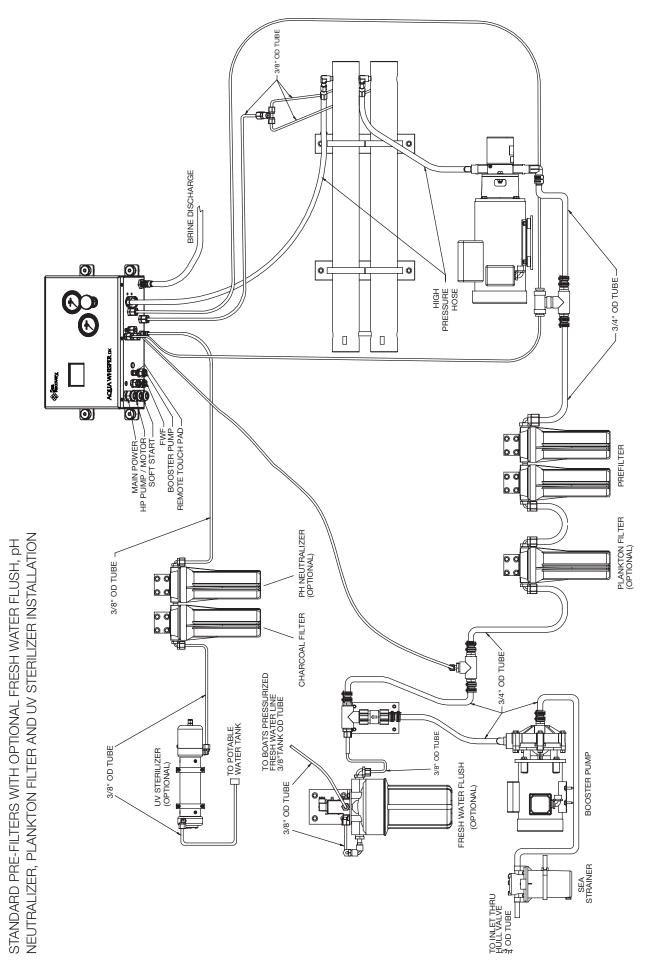

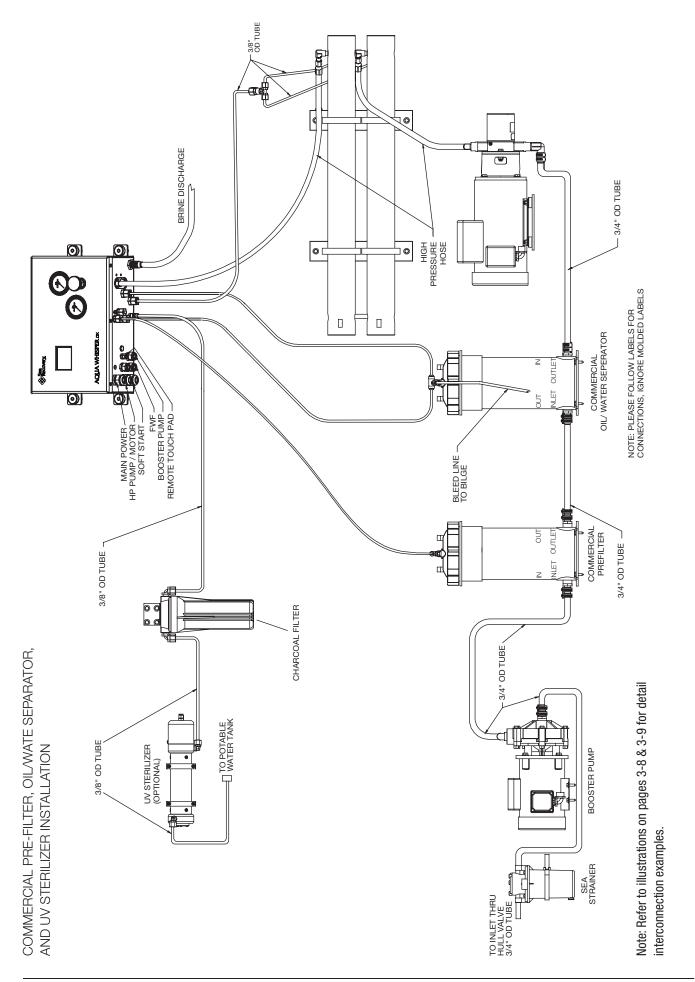


Aqua Whisper DX Modular 450-1800

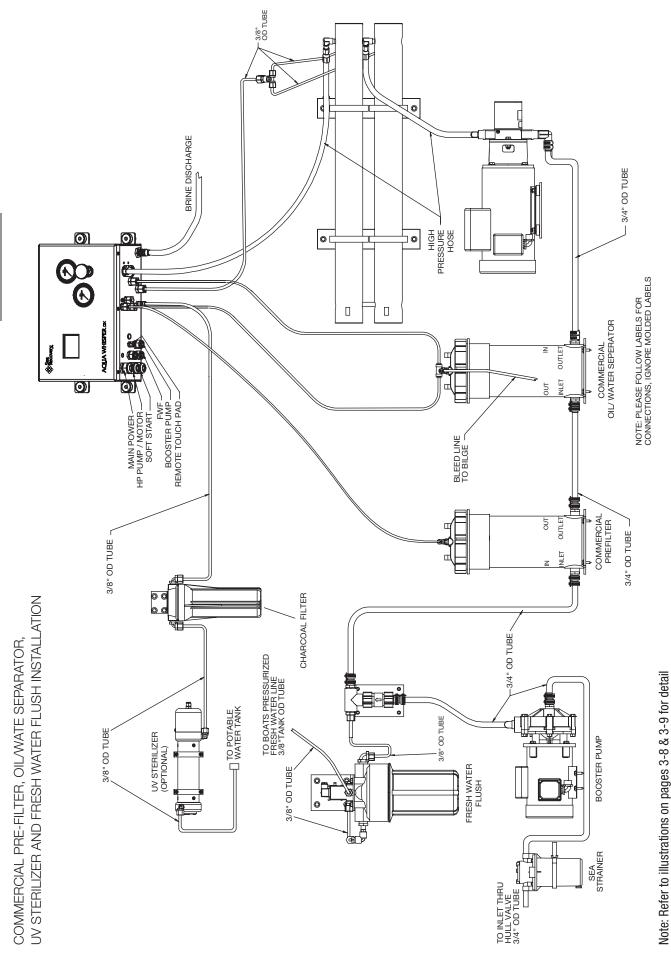


interconnection examples.


Page 3-12

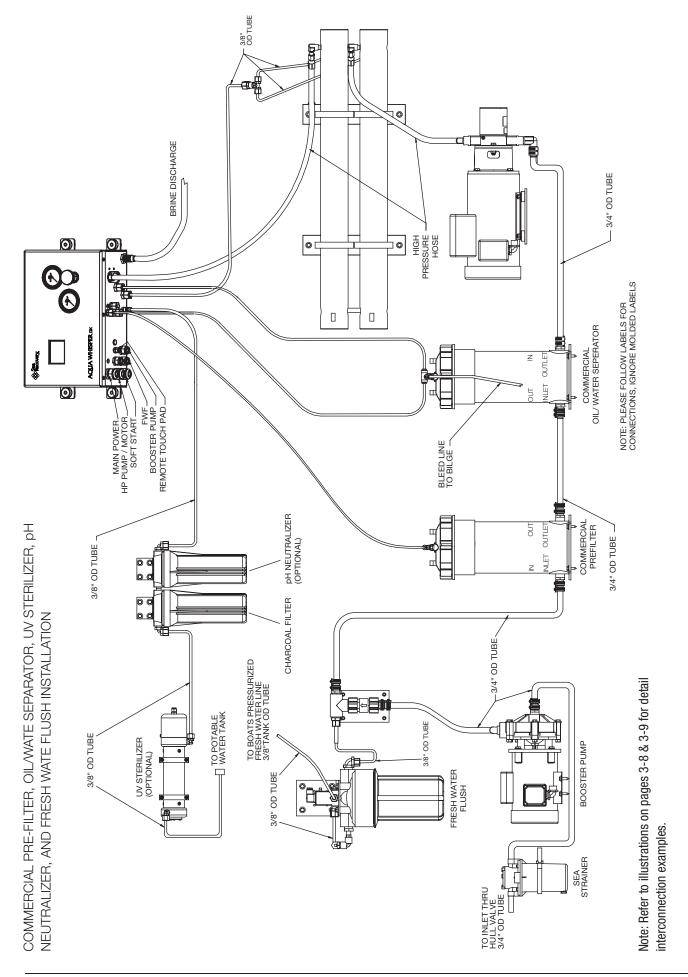



COMMERCIAL PRE-FILTER, OIL/WATE SEPARATOR, UV STERILIZER, FRESH WATER FLUSH, AND PLANKTON FILTER INSTALLATION

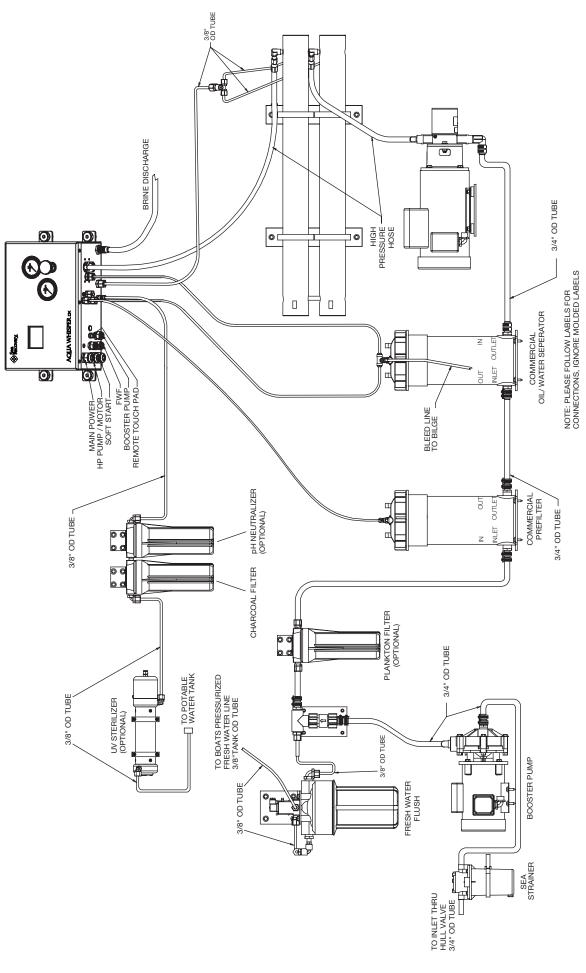

Note: Refer to illustrations on pages 3-8 & 3-9 for detail interconnection examples.

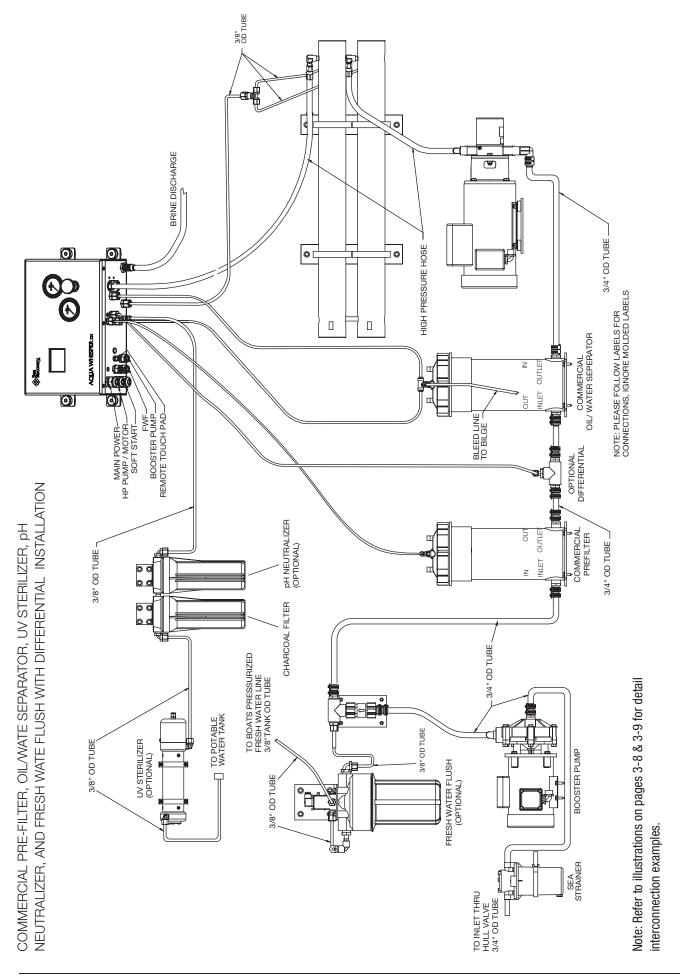

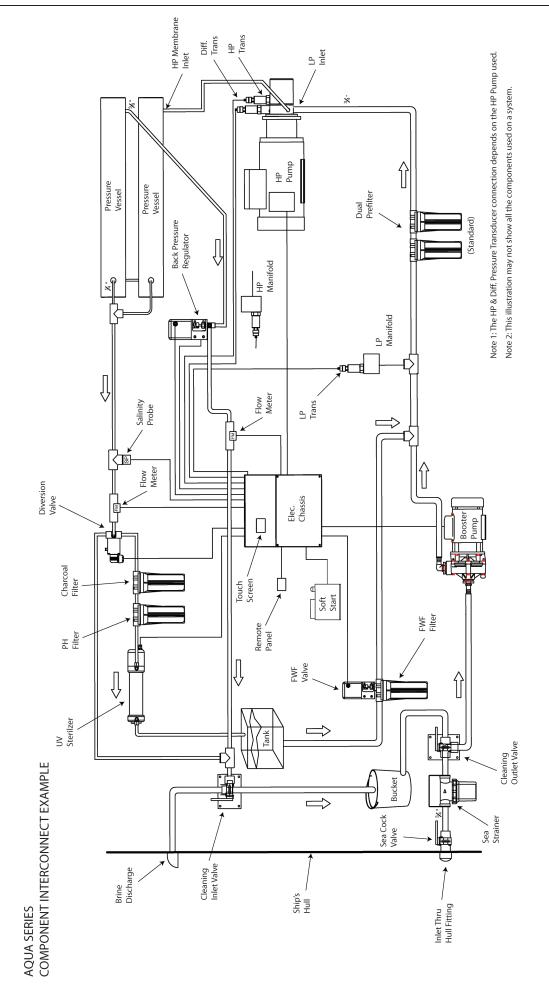

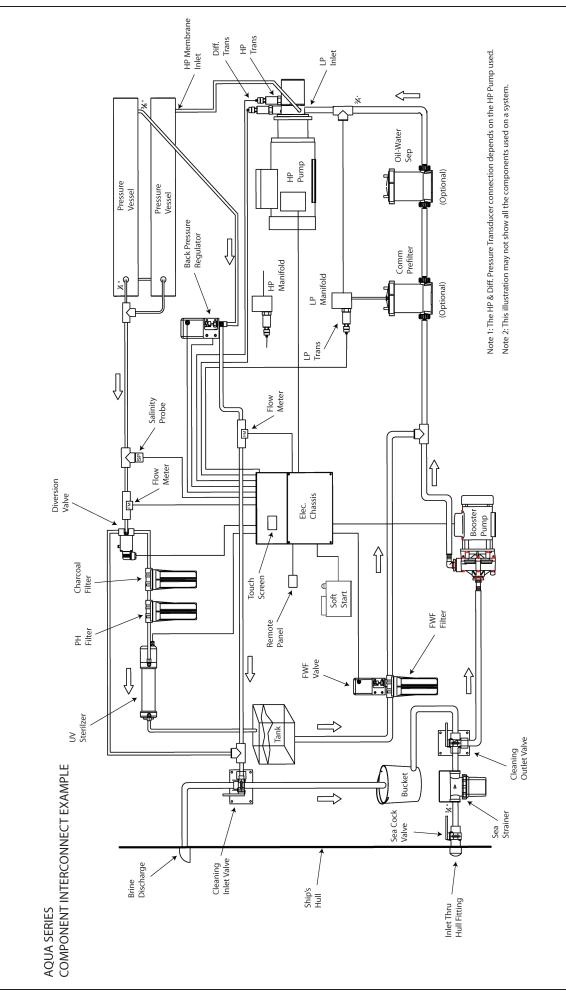

3.7 EXPLANATION OF PRESSURE TRANSDUCERS

Standard Transducers: The Illustration below shows the Standard Pressure Transducers included with each System.

a. Low Pressure Transducer #1 measures the pressure into the Prefiltration. This is the pressure exiting from the Booster Pump.

The Pressure Manifold for Low Pressure Transducer #1 is located inside the System Frame.

b. Low Pressure Transducer #2 measures the pressure exiting the last Prefilter. This is the pressure entering the High Pressure Pump.

The difference of pressure registered by Low Pressure Transducer #1 and Low Pressure Transducer #2 equates to the amount of line loss, or pressure loss, across the prefiltration. As the Prefiltation elements become fouled the pressure registered by Low Pressure Transducer #1 increases and the pressure registered by Low Pressure Transducer #2 decreases.

The Low Pressure Transducer #2 is located on the HP pump inside the System Frame.


c. High Pressure Transducer #3 measures the pressure exiting the HP Pump. This is the pressure entering the RO Membrane Vessel.

The Optional Differential Pressure Transducer #4 (not shown) measures the pressure between two Prefiltration components. The difference of the pressure into and out of a Prefiltration component is the "differential" across that given Prefilter.

When the System is equipped with two (2) or more prefiltration components, such as a Commercial Prefilter and Oil/Water Separator it is helpful to know the pressure across each of them. Knowing the pressure across each filter allows the operator to easily diagnose which of the filters is dirty and requires changing.

The Differential Pressure Transducer will pay for itself in a very short period of time through less time spent troubleshooting dirty filter elements.

Pick Up T for Differential Pressure Transducer is always plumbed in the Feed Line at the appropriate location by the Installer and connected to the Differential Pressure Transducer with a 1/4 in. (6.35 mm) OD Tube by the Installer.

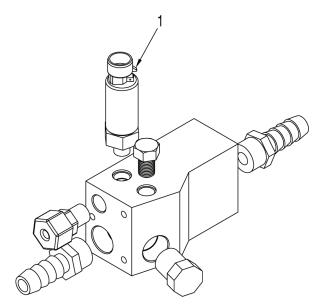

3.8 RO MEMBRANE ELEMENT NOTES

CAUTION: Some systems are shipped WITHOUT the Reverse Osmosis Membrane Element. This is to accommodate Boat Builders that will install the System well in advance of commissioning the boat and the System.

DOES THIS SYSTEM HAVE R.O. MEMBRANE(S) INSTALLED OR NOT?

If not, is it your intention to install the R.O. membrane(s) at this time, or do you wish to install them at a later date when the boat is commissioned?

If the R.O. membrane element has been installed, there will be a R.O. Membrane Element Serial Number tag, illustrated below, attached to the High Pressure Vessel(s). Find this Serial Number tag to ensure that the R.O. membrane element(s) has been installed.



If the R.O. membrane element Serial Number tag is missing or does not contain a serial number and date then the R.O. membranes are not installed. If the R.O. membrane elements are not installed and you wish to install them at this time contact Sea Recovery and supply us with your original *Purchase Order Number, Sea Recovery's Invoice Number, and this System's Serial Number.*

> **WARNING**: If the Reverse Osmosis Membrane Element is not to be installed at this time, ensure that you leave a visible note at the system controller and at the front of the control panel informing the end user that:

The Reverse Osmosis Membranes Elements are not installed; to contact the factory for the R.O. Membrane Elements; and DO NOT operate the system without the R.O. Membrane Elements installed.

** Extensive damage will occur if the system is operated without the R.O. Membrane Elements installed. ** Damage to the system caused by the operation of the system without R.O. Membrane Elements installed:

I OT warranty R

installer did not notify the end user.

I

Т

installer notified the end user that the R.O. Membranes were not installed and to not operate the system without the R.O. Membrane elements installed.

Note: Symbol Used in this Section.

** Indicates items supplied by owner/installer *** Indicates optional equipment.

3.9 COMPONENT DESCRIPTIONS

All components supplied by Sea Recovery, both standard and optional, are described in this section along with items required or desired by the installer. The location, operation, and purpose of each major component are briefly explained in this section.

Use of third party, Non Sea Recovery, components will lead to premature failure, added operating and maintenance costs, and increased labor. Using 3rd party, Non Sea Recovery, components will void any and all Sea Recovery Warranty. We only wish to help you enjoy the luxury of owning a Sea Recovery R.O. System. Treat it properly by using only Sea Recovery supplied parts, consumable, and accessories.

PREFILTRATION SECTION:

The Prefiltration Section filters and delivers the feed water into the system. The raw feed water is filtered to remove suspended solids larger than 5 Micron size (5/1,000,000 of a meter). The prefiltration protects the High Pressure Pump from premature wear and the Reverse Osmosis Membrane Element from premature fouling.

Inlet Thru Hull Fitting with Forward Facing Scoop
 ** is the point at which the feed water enters the
 system. It is important that the installer utilizes a
 forward facing scoop so that the system receives a
 positive flow of water as the boat is under way.

CAUTION: A flush inlet thru-hull fitting will cause a vacuum as the boat is under way, and will cause loss of feed water flow, cavitation of the feed pump and high pressure pump resulting in continual system shut down.

CAUTION: If the thru-hull fitting is placed in a position on the underside of the hull that allows air to continually enter the thru-hull fitting, it will cause the system to continually shut down due to loss of feed water.

NOTE: The resulting failure of the system to remain in operation is attributed to improper installation, is the liability of the installer, and is not covered by the Sea Recovery warranty.

- 2. Sea Cock Valve ** is used in a ship installation for safety reasons to close the feed water line during repair, maintenance, and disuse of the system.
- 3. Sea Strainer has a clear bowl with bronze body filter housing containing a cleanable monel filter screen. The Sea Strainer filters out large particulate matter and suspended particles that would otherwise damage the Booster Pump and prematurely foul the cartridge Prefilter Element.
- Booster Pump supplies a positive pressure to the Pre-filters and onward to the High Pressure Pump. The Booster Pump has a performance curve of 85 Ft Head 35 PSI (2.41 BAR) @ 60 Hz with a feed water flow of 4.5 GPM (17 LPM).

The resulting pressure at the High Pressure Pump depends on the final installation configuration and condition of Prefiltration elements.

- 5. Low Pressure Transducer #1 Booster Pump Outlet/ 1st Prefilter Inlet for line pressure pick up from the outlet of the Booster Pump to the 1st Prefiltration component.
- Plankton Filter *** This optional filter assembly contains a cleanable ultra fine monel mesh screen. The mesh screen removes suspended solids or biological growth such as plankton. It also provides longer life to the Pre-filter Elements and in turn provides lower system maintenance costs. The Plankton Filter is available as a single housing or dual housing.

7. Multi Media Filter *** This optional filter assembly contains a back-washable bed of sand and gravel. The sand traps suspended solids larger than 30 micron which provides longer life to the pleated cartridge prefilter elements minimizing maintenance intervals, maintenance labor, and filter element cost.

WARNING - PREFILTER ELEMENT: Do not use third party prefilter elements, use only Sea Recovery prefilter elements. Third party prefilter elements do not properly fit and the seams fall apart. They also allow by-pass resulting in extensive and very costly damage to the High Pressure Pump as well as premature fouling of the R.O. Membrane Element(s).

8. Commercial Prefilter takes the place of the Dual Prefilter. The 5 micron Commercial Prefilter cartridge element contains 37.5 sq. ft. (3.5 square meters) of filtering surface area. This oversize cartridge gives much longer filter element life greatly extending the time interval between required maintenance and reduces maintenance labor and prefilter element replacement cost.

CAUTION - PREFILTER ELEMENT:

Do not use "string wound" or "fiber" prefilter elements. String wound and fiber filter elements are designed for the Photographic Film Developing Industry. When used in sea water, they will plug up rapidly in 1/10th or less the time of a Sea Recovery supplied prefilter cartridge element. This will cause frequent shut downs of the system and very frequent changing which will result in very high cost of maintenance, and user frustration.

- Dual Pre-Filter removes suspended solids in two stages. The feed water passes first through a 20 micron cartridge then a 5 micron cartridge. By stepping the filtration, both prefilter elements gain longer life and require less maintenance labor and prefilter element replacement cost.
- T-Connector Pressure Differential Pick-up *** is included with Pressure Differential Transducer #4 for line differential pressure pick up between optional prefiltration components to the Low

Differential Pressure Transducer. Depending on Prefiltration configuration this T-Connector may not be necessary as illustrated on Page 3-7 and 3-8. Depending on the System style and perfiltration configuration, one of the two Pressure Pick-Up Tee styles may be used.

11. Pressure Differential Transducer #4 *** (optional) for line differential pressure across prefiltration components. Allows the operator to determine which prefiltration component requires servicing.

WARNING - OIL WATER SEPARATOR ELEMENT: Use only Sea Recovery supplied filter elements. Third party oil water separator elements do not properly fit and the seams fall apart. They also allow by-pass resulting in extensive and very costly damage to the High Pressure Pump as well as premature fouling of the R.O. Membrane Element(s).

12. Oil/Water Separator Filter removes oil present in the feed water.

CAUTION: Oil permanently destroys the R.O. Membrane element. It is recommended that the user avoid operating the Sea Recovery R.O. System in oil polluted waters if the Oil/Water Separator Filter is not installed.

- 13. Low Pressure Transducer #2 measures line pressure after all prefiltration and prior to the inlet of the High Pressure Pump.
- 14. Low Pressure Transducer Manifold supports the Low Pressure and Differential Pressure Transducers.
- 15. Low Pressure Gauge allows the operator to easily monitor the condition of the Booster Pump outlet pressure to determine if the Booster Pump requires maintenance.

PRESSURIZATION SECTION:

The Pressurization Section provides the necessary pressure to force the product water through the R.O. membrane element.

1. Standard: High Pressure pump is a marine quality stainless steel manifold, positive displacement ceramic plunger pump, operates with minimal

noise and vibration. This pump is exclusive and unique to the SRC systems.

Optional: High Pressure Pump and Motor Assembly is a Radial Axial Positive Displacement Plunger Pump made of high grade Duplex material specifically designed for sea water Reverse Osmosis applications. The Pump is self lubricated and does not require oil. The Pump is connected to the attached electric motor with a flex coupler and safety bell housing.

- High Pressure Hose, HP Pump Outlet to R.O. Membrane and Vessel Assembly Inlet, transfers pressurized sea water from the High Pressure Pump to the inlet of the R.O. Membrane Element.
- 3. R.O. Membrane Element and Vessel #1 The Membrane Element allows potable water molecules to pass through while rejecting the salt ions. Only 7% to 28%, depending on specific model, of the Seawater Feed becomes fresh Product Water. The remainder carries the rejected salt ions out of the R.O. Membrane Element in a concentrated brine stream. The R.O. System may have one or two R.O. Membrane Element & Vessel in series depending on the specific model and system capacity.
- R.O. Membrane Element and Vessel #2 is connected in series with the first R.O. Membrane Element and Vessel. The Sea Recovery R.O. System will have either one or two R.O. Membrane Element and Vessel depending on the model. The 2nd R.O. Membrane Element and Vessel may be added at any time to a system with only one. Adding the 2nd R.O. Membrane Element and Vessel will double the System's production.
- 5. High Pressure Hose R.O. Membrane Vessel Assembly Outlet to High Pressure Manifold Inlet.
- 6. High Pressure Transducer measures the System Operating Pressure from the Outlet of the High Pressure Pump through the R.O. Membrane and Vessels.
- High Pressure Gauge registers the System Operating Pressure applied to the R.O.Membrane Element(s).
- 8. Back Pressure Regulator controls the operating pressure applied to the R.O.Membrane Element(s). The operator rotates the handle to increase or decrease system operating pressure to gain specified performance.

9. High Pressure Manifold connects the High Pressure Hose, High Pressure Transducer, High Pressure Gauge, and Back Pressure Regulator.

BRINE DISCHARGE SECTION:

The Brine Discharge Section carries the Brine Discharge water, exiting from the R.O. Membrane Element, back to the feed source.

- Brine Discharge Flow Meter measures the brine water rate of flow from the R.O. Membrane Element in gallons or liters per hour. By adding the amount of Product Water flow to the Brine Discharge Flow the operator is able to determine the total Feed Water Flow.
- 2. Brine Discharge T-Connector collects the brine discharge water and unpotable product water.
- 3. Brine Discharge Connector attaches to the over board thru-hull fitting for connecting the brine discharge hose.
- 4. Multi Media Filter Waste "T" *** is included with the Multi Media Filter. This waste T is installed in line at the Brine Discharge fitting to allow discharge of the waste from the Multi Media Filter during the back wash and rinse operations, and the brine discharge water from the system.
- 5. Thru Hull Brine Discharge Fitting ** should be installed above water level for discharge of the Brine Discharge Water from the system.

PRODUCT WATER SECTION:

The Product Water Section gives a visual indication of the clarity, quantity, and quality of the product water. Post Filtration is the final step in Product Water quality control. The Post Filtration Subsystem is designed to limit unpleasant odor and taste, adjust the pH to neutral, and sterilize biological matter which may have passed through the R.O. Membrane Element.

- 1. Product Water T-Connector combines the product water from the two individual R.O. Membrane Elements.
- 2. Temperature Compensated Salinity Probe electronically determines whether the salinity content of the Product Water is acceptable. This Salinity Probe is temperature compensated and provides an accurate measurement of Product Water quality.

- 3. Flow Meter, Product Water electronically measures the rate of Product Water flow, in gallons or liters per hour.
- 4. 3-Way Product Water Diversion Valve, Electric Solenoid Actuated. The Controller energizes this valve to the "Potable" position when the system produces water which meets the low salinity requirement. If the Product Water being produced is "Unpotable", or high in salinity, then no signal is sent to the valve, and it thus remains in the normal open position. The "fail safe" normal open position diverts the unpotable Product Water to discharge.
- 5. Charcoal Filter removes foul odors from the Product Water. Sulfurous odor (rotten egg smell) is caused when biological matter dies and decays in the feed water section. Fresh water flushing of the system helps to minimize this odor.
- 6. pH Neutralizer Filter The pH value of pure water is pH7 which is regarded as neutral. pH values from 0-7 indicate acidity and pH values from 7-14 indicate alkalinity. The product water from an R.O. System will be slightly acidic because most of the naturally occurring high pH calcium carbonate has been removed. The product water from an R.O. System will also be very soft for the same reason. The product water pH will be approximately 6.5 pH. The pH Neutralizer Filter dissolves calcium carbonate back into the product water bringing the pH level to neutral at approximately pH 7.
- 7. Ultra Violet Sterilizer *** sterilizes at least 99.9% of any virus, bacteria, and other micro-organisms which may pass through the R.O. membrane element. The UV sterilizer is recommended if the Product Water Storage Tank is not otherwise treated by means such as chlorination.
- 8. Product Water Connector attaches to the Potable Water unpressurized tank for connection of the Product Water hose.

FRESH WATER SYSTEM

The Fresh Water System represents the boat or home's fresh water pressurized system. Pressurized fresh water is required to supply the System Fresh Water Flush.

1. Potable Water Storage Tank** may be any container suitable for storing Potable Water, i.e. existing water storage tank on a boat or cistern for a home.

- 2. Fresh Water Pressure Pump** delivers fresh water throughout the boat, or home. In order to provide the required flow of water to the System during the Fresh Water Flush cycle, this pump must deliver up to 1 U.S. Gallons (3.8 Liters) Per Minute at 25 to 60 PSI (172 to 414 kPa).
- Air Entrainment Tank** (accumulator) is sometimes installed into the boat or home's fresh water line to eliminate pulsations from and reduce demand on the Fresh Water Pressure Pump. This tank stores pressurized fresh water for delivery to the boat or home's fresh water piping.

FRESH WATER FLUSH SECTION

The Fresh Water Flush Section includes a Carbon Filter and an Automatic Motor Actuated Ball Valve that automatically flushes the system with fresh water. This process is automatic at each shut down of the system and repeats automatically every preset number of days. Fresh Water Flushing replaces the seawater in the system with less corrosive fresh water, and this also reduces the biological growth and subsequent decay that naturally occur if the sea water is not flushed from the system with fresh water.

- Fresh Water Flush 2-way solenoid valve
 ***automatically actuates at system shut down
 and every preset number of days there after to
 flush the system with fresh water.
- 2. Fresh Water Flush Check Valve *** prevents feed water from entering the fresh water line.
- 3. Fresh Water Flush Charcoal Filter *** removes chlorine, if present, in the fresh water prior to flowing through the R.O. Membrane Element.
- 4. Fresh Water Flush Check Valve *** routs the fresh water through the system.
- Cleaning Bucket ** can be any non ferrous container capable of holding at least 10 U.S. Gallons (37.8 Liters) of water. This container is used during the R.O. Membrane Element cleaning, storing, or winterizing process.
- 6. Rinse Clean Inlet Valve *** These Optional Valves are mounted separately on singular individual plates or together on a double plate.

The Rinse Clean Inlet Valve is used in conjunction with the Rinse Clean Outlet Valve simplifies the storage and cleaning procedures by allowing the operator to turn a valve rather than disconnect a hose. Also used for a manual fresh water flush if the Automatic Fresh Water Flush System is not installed. The Rinse Clean Valves are available on single valve mounting plates or on double valve mounting plate.

 Rinse Clean Outlet Valve *** used in conjunction with and identical to the Rinse Clean Inlet Valve simplifies the storage and cleaning procedures by allowing the operator to turn a valve rather than disconnect a hose.

ELECTRONIC SECTION

The Electronic Section measures water quality, controls the direction of Product Water flow, Starts and Stops the pumps, and contains the central electrical connection point of the system. It also ensures only potable Product Water passes into the Product Water Storage Tank.

- 1. System Touch Panel is where all system functions are accessed by touching the user friendly intuitive screen and where all operating conditions are monitored.
- 2. Electrical Control Box contains all electrical and electronic components that control the system.
- 3. Remote Control Touch Panel *** allows for remote control, operation, and monitoring of the system.
- 4. Soft Start *** The soft start, used only in AC Single Phase systems, reduces the initial startup amperes required to start the High Pressure Pump Motor and in turn allows a smaller sized KW generator to start the system. Starting amperage is reduced by 40% with the Soft Start installed.

Not Numbered:

Fresh Water Tank Low Level Switch ** owner/installer supplied provides an optional feature to the System Control Logic that works in conjunction with the Automatic Fresh Water Flush option.

When installed and connected to the Main Printed Circuit Board, the Fresh Water Tank Low Level Switch must be connected as a N.O. (Normally Open) 1PST (One Pole Single Throw) switch.

When the Fresh Water Tank is empty the switch is Open. As water rises a few inches in the tank the switch Closes. This informs the System Control Logic that there is sufficient Fresh Water to perform the Automatic Fresh Water Flush Cycle. • Fresh Water Tank High Level Switch ** owner/ installer supplied provides an optional feature to the System Control Logic that allows the System to shut off automatically when the Fresh Water Tank is full, when the System is operated in the Automatic mode. Additionally, the System will not start in the Automatic mode when the Fresh Water Tank High Level Switch signals the System Control Logic that the Fresh Water Tank is full.

When installed and connected to the Main Printed Circuit Board, the Fresh Water Tank High Level Switch must be connected as a N.C. (Normally Closed) 1PST (One Pole Single Throw) switch.

When the Fresh Water Tank is several inches below the full mark the switch is Closed. As water rises and reaches the top of the full mark the switch Opens. This informs the System Control Logic that the Fresh Water Tank is full.

If operation of the System is desired when the Fresh Water Tank Switch signals the System Control Logic that the Fresh Water Tank is full then the System may be operated in the Manual mode.

Aqua Matic Compact 450-1800 Section 4 - ELECTRICAL INFORMATION

Electrical

4 ELECTRICAL INFORMATION

4.1 ELECTRICAL REQUIREMENTS AND INFORMATION

Following are general electrical requirements and information for Aqua Whisper Modular models.

CAUTION: DO NOT PERFORM INSTALLATION UNLESS:

- 1. The System Feed Water Sea Cock Valve is closed.
- 2. The system main electrical disconnect switch is switched "OFF", LOCKED, and TAGGED.

WARNING: ELECTRICAL SHOCK HAZARD. A Volt / Ohm Meter will be necessary. The following installation procedures expose the installer to High Voltage and electrical shock hazard. Only attempt this if you are a qualified electrician and only if surrounding conditions are safe.

CAUTION: Always allow slack in electrical cables. Allow the cable to enter or leave from the strain relief in a straight manner for several inches to ensure proper connection, to relieve stress to the cable and fitting, and to allow ease of detachment and reattachment for maintenance or replacement. If electrical cables are pulled tight causing them to bend at the strain relief, they will pull out of the strain relief causing a dangerous electrical shock condition, the wire may break, and the strain relief will lose its water-tight integrity.

A. AMPERAGE NOTES

The Electric Motors within the Aqua Whisper systems start in series with time delay between each motor starting after the Touch Screen "Start" Switch is pressed. First, the Booster Pump starts, then the main High Pressure Pump Electric Motor starts. Alternatively, the Booster Pump and High Pressure Pump may be started manually by accessing the manual operation mode from the Touch Screen.

During start up, the current of the Booster Pump Electric Motor surges to "Locked Rotor" amperage for a fraction of a second after which the current drops to normal running load. Then the High Pressure Pump Electric Motor starts and surges to "locked Rotor" amperage for a fraction of a second after which the current drops to normal running load.

Therefore, the maximum surge current equals the Booster Pump Electric Motor normal running amperage plus the High Pressure Pump Electric Motor starting amperage. Normal operational amperage equals the normal operating amperage of the Booster Pump Electric Motor plus the normal operating amperage of the High Pressure Pump Electric Motor.

B. POWER SOURCE REQUIREMENTS

Check line voltage and frequency to ensure that it agrees with system nameplate. Grounding and circuit protection should be done in accordance with National Electrical Code. See connection diagram on nameplate of motor or refer to the diagrams within this manual.

Voltage AC	HZ	Min.	Max.	Min.	Max.
Systems	(AC)	HZ	HZ	Voltage	Voltage
120 VAC	60 HZ	58 Hz	62 Hz	108	132
				VAC	VAC
230 VAC	60 HZ	58 Hz	62 Hz	207	253
				VAC	VAC
100 VAC	50 HZ	48 Hz	52 Hz	90 VAC	110
					VAC
220 VAC	50 HZ	48 Hz	52 Hz	198	242
				VAC	VAC

C. MOTOR ROTATION

Refer to Booster Pump and High Pressure Pump markings to determine proper rotation.

Three Phase Systems: Ensure proper rotation by jogging each motor from the manual operation mode.

4.2 ELECTRICAL MOTOR SPECIFICATIONS

(H.P. = Horse Power; RPM = Revolutions Per Minute; FLA = Full Load Amperes; LRA = Locked Rotor Amperes @ Start Up)

ALTERNATING CURRENT SYSTEMS:

Single Phase Alternating Current (Oil Filled Pumps)

		High Pressure Pump Motor				Booster Pump Motor			
VAC	Hz	HP	RPM	FLA	LRA	HP	RPM	FLA	LRA
110	50	2	1450	21	109	0.5	2850	7.4	20
220	50	2	1450	10.5	54.5	0.5	2850	3.7	10
115	60	2.5	1750	21.2	109	0.5	3450	9.4	20
230	60	2.5	1750	10.6	54.5	0.5	3450	4.7	10

Three Phase Alternating Current (Oil Filled Pumps)

			High Pressure	e Pump Motor		Booster Pump Motor			
VAC	Hz	HP	RPM	FLA	LRA	HP	RPM	FLA	LRA
220	50	2.4	1450	8.2	30.9	0.5	2850	2.5	8.2
380	50	2.4	1450	4.1	15.45	0.5	2850	1.5	4.7
230	60	2.4	1750	7.2	30.9	0.5	3450	2.4	7.9
460	60	2.4	1750	3.6	15.45	0.5	3450	1.2	3.9

Single Phase Alternating Current (Oil Free Pumps)

		High Pressure Pump Motor					Booster Pi	ump Motor	
VAC	Hz	HP	RPM	FLA	LRA	HP	RPM	FLA	LRA
110	50	3	2850	23	89	0.5	2850	7.4	20
220	50	3	2850	11.5	44	0.5	2850	3.7	10
115	60	3	3450	25.4	86	0.5	3450	9.4	20
230	60	3	3450	12.7	43	0.5	3450	4.7	10

Three Phase Alternating Current (Oil Free Pumps)

			High Pressure	e Pump Motor		Booster Pump Motor			
VAC	Hz	HP	RPM	FLA	LRA	HP	RPM	FLA	LRA
220	50	2.5	2850	7.9	24.9	0.5	2850	2.5	8.2
380	50	2.5	2850	4.6	14.4	0.5	2850	1.5	4.7
230	60	3	3450	7.6	23.8	0.5	3450	2.4	7.9
460	60	3	3450	3.8	11.9	0.5	3450	1.2	3.9

4.3 RECOMMENDED CIRCUIT BREAKER

Recommended circuit breaker supplying power to system amperage rating:

Operating		Recommended	
AC Voltage	Phase	Circuit Breaker	
110 - 115 VAC	Single	50 Ampere	
220 - 230 VAC	Single	25 Ampere	
220 VAC	Three	15 Ampere	
380 VAC	Three	10 Ampere	
460 VAC	Three	10 Ampere	

4.4 RECOMMENDED POWER WIRE SIZE

Recommended power wire size to Aqua Whisper system and pump motors:

RECOMMENDED POWER WIRE SIZE TO AQUA WHISPER SYSTEM:

Operating			Maximum	Recommended Min Length of run	imum Wire Size for
Voltage	Phase	Load	10 Ft / 3 meter	25 Ft / 8 meter	50 Ft / 15 meter
110-115 VAC	Single	34.8 Ampere	10 AWG / 6 mm2	8 AWG / 10 mm2	8 AWG / 10 mm2
220-230 VAC	Single	17.4 Ampere	12 AWG / 4 mm2	12 AWG / 4 mm2	12 AWG / 4 mm2
220-230 VAC	Three	10.4 Ampere	14 AWG / 2.5 mm2	14 AWG / 2.5 mm2	14 AWG / 2.5 mm2
380 VAC	Three	6.1 Ampere	14 AWG / 2.5 mm2	14 AWG / 2.5 mm2	14 AWG / 2.5 mm2
460 VAC	Three	5 Ampere	14 AWG / 2.5 mm2	14 AWG / 2.5 mm2	14 AWG / 2.5 mm2


RECOMMENDED POWER WIRE SIZE TO AQUA WHISPER BOOSTER PUMP:

Operating			Maximum	Recommended Minim Length of run	um Wire Size for
Voltage	Phase	Load	10 Ft / 3 meter	25 Ft / 8 meter	50 Ft / 15 meter
110-115 VAC	Single	9.4 Ampere	14 AWG / 2.5 mm2	14 AWG / 2.5 mm2	14 AWG / 2.5 mm2
220-230 VAC	Single	4.7 Ampere	14 AWG / 2.5 mm2	14 AWG / 2.5 mm2	14 AWG / 2.5 mm2
220-230 VAC	Three	2.5 Ampere	16 AWG / 1.5 mm2	16 AWG / 1.5 mm2	16 AWG / 1.5 mm2
380 VAC	Three	1.5 Ampere	16 AWG / 1.5 mm2	16 AWG / 1.5 mm2	16 AWG / 1.5 mm2
460 VAC	Three	1.2 Ampere	16 AWG / 1.5 mm2	16 AWG / 1.5 mm2	16 AWG / 1.5 mm2

RECOMMENDED POWER WIRE SIZE TO AQUA WHISPER HIGH PRESSURE PUMP:

Operating			Maximum	Recommended Minir Length of run	num Wire Size for
Voltage	Phase	Load	10 Ft / 3 meter	25 Ft / 8 meter	50 Ft / 15 meter
110-115 VAC	Single	25.5 Ampere	12 AWG / 4 mm2	10 AWG / 6 mm2	10 AWG / 6 mm2
220-230 VAC	Single	12.7 Ampere	14 AWG / 2.5 mm2	12 AWG / 4 mm2	12 AWG / 4 mm2
220-230 VAC	Three	7.9 Ampere	14 AWG / 2.5 mm2	14 AWG / 2.5 mm2	14 AWG / 2.5 mm2
380 VAC	Three	4.6 Ampere	14 AWG / 2.5 mm2	14 AWG / 2.5 mm2	14 AWG / 2.5 mm2
460 VAC	Three	3.8 Ampere	14 AWG / 2.5 mm2	14 AWG / 2.5 mm2	14 AWG / 2.5 mm2

4.5 WIRE INSERTION TO TERMINAL STRIPS

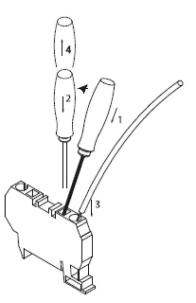

4.6 WIRE SIZE REFERENCES

Wire Size Cross Reference American Wire Gauge (AWG) vs. Metric Wire Sizes


AWG	Diameter	Square	Diameter	Square
	Inch	Inch (In2)	Millimeters	Millimeters (mm2)
0	0.46	0.1661	11.684	107.1649
0	0.4096	0.1317	10.4038	84.9683
0	0.3648	0.1045	9.2659	67.398
0	0.3249	0.0829	8.2525	53.4609
1	0.2893	0.0657	7.3482	42.3871
2	0.2576	0.0521	6.543	33.6069
3	0.2294	0.0413	5.8268	26.6516
4	0.2043	0.0328	5.1892	21.1385
6	0.162	0.0206	4.1148	13.2913
8	0.1285	0.013	3.2639	8.3626
10	0.1019	0.0082	2.5883	5.2588
12	0.0808	0.0051	2.0523	3.3064
14	0.0641	0.0032	1.6281	2.0809
16	0.0508	0.002	1.2903	1.307
18	0.0403	0.0013	1.0236	0.8225
20	0.032	0.0008	0.8128	0.5186
22	0.0254	0.0005	0.6452	0.3267

American Wire Gauge			Metric Wire	Metric Wire Gauge	
AWG	dia inch	sq. inch	dia mm	sq mm	Size mm2
0	0.46	0.1661	11.684	107.1649	100
0	0.4096	0.1317	10.4038	84.9683	85
0	0.3648	0.1045	9.2659	67.398	65
0	0.3249	0.0829	8.2525	53.4609	50
1	0.2893	0.0657	7.3482	42.3871	40
2	0.2576	0.0521	6.543	33.6069	32
3	0.2294	0.0413	5.8268	26.6516	32
4	0.2043	0.0328	5.1892	21.1385	19
6	0.162	0.0206	4.1148	13.2913	13
8	0.1285	0.013	3.2639	8.3626	8
10	0.1019	0.0082	2.5883	5.2588	5
12	0.0808	0.0051	2.0523	3.3064	3
14	0.0641	0.0032	1.6281	2.0809	2
16	0.0508	0.002	1.2903	1.307	1
18	0.0403	0.0013	1.0236	0.8225	0.8
20	0.032	0.0008	0.8128	0.5186	0.5
22	0.0254	0.0005	0.6452	0.3267	0.35


4.7 MODULAR MODEL ELECTRICAL INFORMATION

WARNING: ELECTRICAL SHOCK HAZARD. A Volt / Ohm Meter will be necessary. The following installation procedures expose the installer to High Voltage and electrical shock hazard. Only attempt this if you are a qualified electrician and only if surrounding conditions are safe.


Frame Enclosure Assembly




Frame Enclosure Strain Reliefs

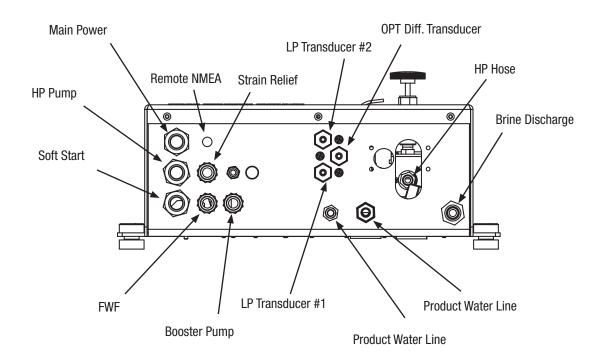

Electrical Motor Wiring-Single Phase

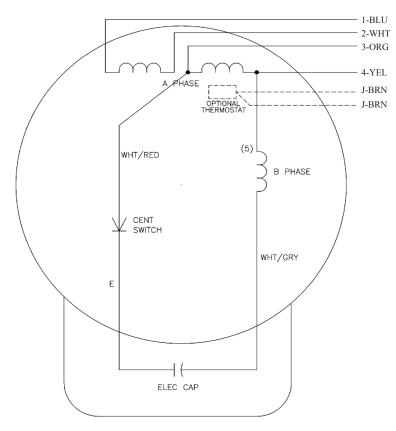

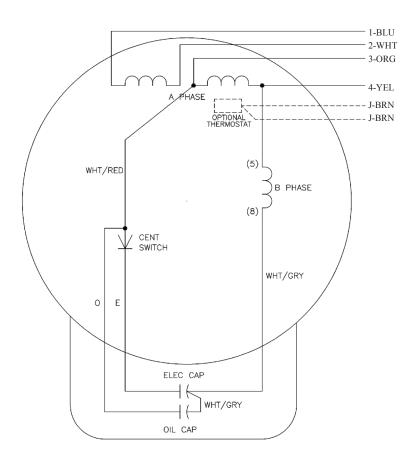

[VOLTAGE	LINE A	LINE B	JOIN
	220 - 230 VAC	1	4	2, 3
	110 - 115 VAC	1, 3	2, 4	

NOTES

- 1. CONNECTIONS ARE SHOWN FOR CCW ROTATION FACING END OPPOSITE SHAFT EXTENSION (STD). FOR CW ROTATION, INTERCHANGE 5 AND 8 INTERNALLY.
- 2. OPTIONAL THERMOSTAT IS PROVIDED WHEN SPECIFIED.
- 3. MULTIPLE CAPACITORS ARE CONNECTED IN PARALLEL UNLESS OTHERWISE SPECIFIED.
- 4. LEAD COLORS ARE OPTIONAL. LEADS MUST ALWAYS BE NUMBERED AS SHOWN.

Sea Recovery BOOSTER PUMP ELECTRIC MOTOR WINDINGS DIAGRAM CD0093 SINGLE PHASE 50/60 Hz 110-115 VAC // 220 - 230 VAC RPM @ 50 Hz 2850 - @ 60 Hz 3450

VOLTAGE	LINE A	LINE B	JOIN
220 - 230 VAC	1	4	2, 3
110 - 115 VAC	1, 3	2, 4	


NOTES


- 1. CONNECTIONS ARE SHOWN FOR CCW ROTATION FACING END OPPOSITE SHAFT EXTENSION (STD). FOR CW ROTATION, INTERCHANGE 5 AND 8 INTERNALLY.
- 2. OPTIONAL THERMOSTAT IS PROVIDED WHEN SPECIFIED.
- 3. MULTIPLE CAPACITORS ARE CONNECTED IN PARALLEL UNLESS OTHERWISE SPECIFIED.
- 4. LEAD COLORS ARE OPTIONAL. LEADS MUST ALWAYS BE NUMBERED AS SHOWN.

Sea Recovery HIGH PRESSURE PUMP ELECTRIC MOTOR WINDINGS DIAGRAM CD0093 SINGLE PHASE 50/60 Hz 110-115 VAC // 220 - 230 VAC RPM @ 50 Hz 2850 - @ 60 Hz 3450

Electrical Motor Wiring-Three Phase


ELECTRIC MOTOR WINDING / WIRING DIAGRAMS THREE PHASE, 50/60 Hz, 220-230 VAC, // 380-460 VAC

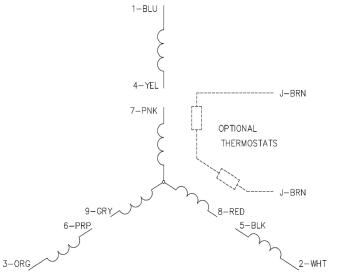



Electrical

- NOTES 1. INTERCHANGE ANY TWO LINE LEADS TO REVERSE ROTATION.
- 2. OPTIONAL THERMOSTAT IS PROVIDED WHEN SPECIFIED.
- 3. ACTUAL NUMBER OF PARALLEL CIRCUITS MAY BE A MULTIPLE OF THOSE SHOWN ABOVE.
- 4. LEAD COLORS ARE OPTIONAL. LEADS MUST ALWAYS BE NUMBERED AS SHOWN.



5

8

2

0

¢

୍

6


9


3


0

¢

(0)

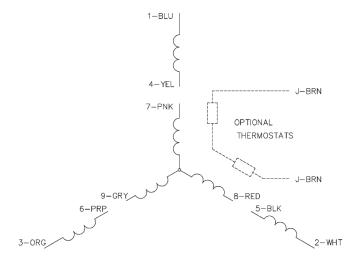








LINE LEADS 380 - 460 VAC

NOTES

- 1. INTERCHANGE ANY TWO LINE LEADS TO REVERSE ROTATION.
- 2. OPTIONAL THERMOSTAT IS PROVIDED WHEN SPECIFIED.
- 3. ACTUAL NUMBER OF PARALLEL CIRCUITS MAY BE A MULTIPLE OF THOSE SHOWN ABOVE.
- 4. LEAD COLORS ARE OPTIONAL. LEADS MUST ALWAYS BE NUMBERED AS SHOWN.


Sea Recovery HIGH PRESSURE PUMP ELECTRIC MOTOR WINDINGS DIAGRAM CD0005 RPM @ 50 Hz 2850 (a) 60 Hz 3450

Electrical Motor Wiring-Three Phase

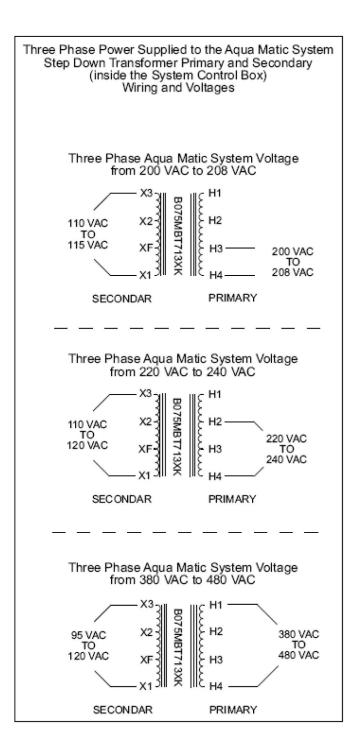

Electrical Chassis


Single Phase

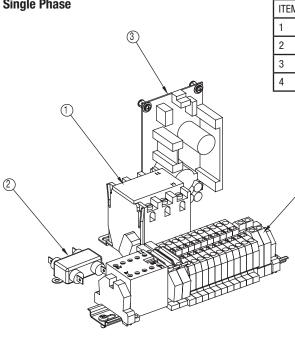

ITEM NO.	PART NUMBER	DESCRIPTION	QTY.
1	313106038F	HP PUMP CONTACTOR	1
2	31318301DX	EMI FILTER	1
3	B604170001	POWER SUPPLY ASSY	1
4	B604170000	DIN RAIL ASSY	1

4

Three Phase

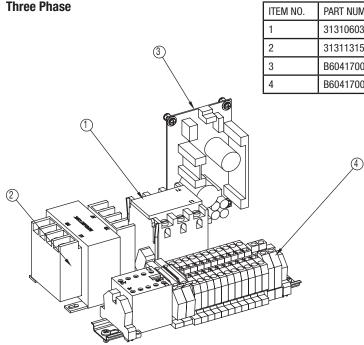

ITEM NO.	PART NUMBER	DESCRIPTION	QTY.
1	313106038F	HP PUMP CONTACTOR	1
2	3131131500	ELEC TRANSFORMER 480/120 BUCK	1
3	B604170001	POWER SUPPLY ASSY	1
4	B604170000	DIN RAIL ASSY	1


4.8 MODULAR MODEL WIRING DIAGRAMS

WARNING: ELECTRICAL SHOCK HAZARD. A Volt / Ohm Meter will be necessary. The following installation procedures expose the installer to High Voltage and electrical shock hazard. Only attempt this if you are a qualified electrician and only if surrounding conditions are safe.

Refer to Foldouts, Section 11 for Modular Model Wiring Diagrams.

Soft Start Wiring Diagram B596800006


Single Phase Wiring Connections:

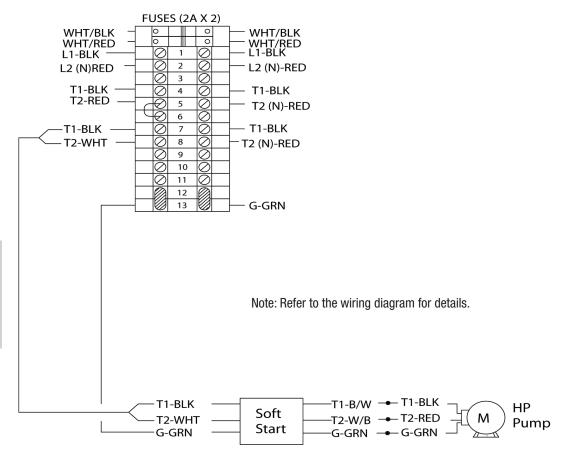

If the Motor Soft Start is not already installed, follow these instructions to install it:

- 1. Disconnect the power source from the System.
- 2. Open the System or Controller Enclosure cover to access the Electrical Chassis.
- 3. Connect Motor Soft Start wiring as shown above.

3 Phase Wiring Connections:

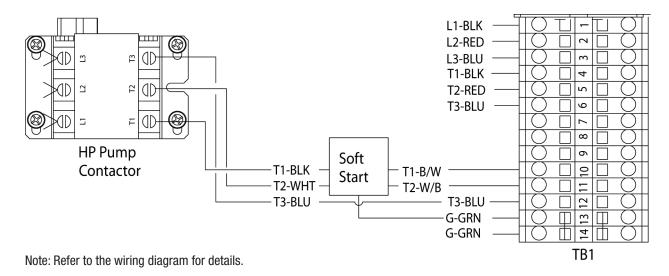

If the Motor Soft Start is not already installed, follow these instructions to install it:

- 1. Disconnect the power source from the System.
- 2. Open the System or Controller Enclosure cover to access the Electrical Chassis.
- 3. Connect Motor Soft Start wiring as shown above.

Electrical

Aqua Whisper DX Modular 450-1800 Section 5 - INSTALLATION REQUIREMENTS

Installation

5 INSTALLATION REQUIREMENTS

LAND INSTALLATION NOTE: REFER TO SECTION 5.7 REGARDING FEED WATER INSTRUCTIONS FOR LAND INSTALLATIONS. REFER TO THE REST OF THIS SECTION FOR INSTALLATION.

All mounting surfaces must be flat in order to avoid warping of brackets and frames. Any damage caused by attaching the system or its components to an uneven surface is attributed to improper installation, is the liability of the installer, and is not covered by the Sea Recovery warranty. Grind flat or use appropriate shims on uneven surfaces to ensure that mounting of the system components does not cause bending or warping.

The descriptions correspond to the System P&ID in Section 3.

5.1 SYSTEM CONTROLLER BOX

PLACEMENT AND SECURING THE SYSTEM CONTROL BOX

The System Control Box must be placed in a location that allows access for operation and maintenance. Allow access to the bottom side of the control box for electrical wire attachment. Ensure that the Touch Pad is reachable and readable.

The Control Box is mounted in place with 4 supplied rubber isolation mounts. Four threaded bolts and four sheet metal screws are provided for attachment. Set the Control Box in place onto a flat surface and mark the mounting holes.

Move the Control Box out of the way and drill the appropriate hole depending on which hardware will be used. Place the Control Box over the drilled holes and attach the rubber isolation grommet under the frame at each of the 4 mounting holes. Place the mating rubber isolation grommet over the top of the frame hole and attach with the appropriate supplied washers, and bolts or screws.

5.2 COMPONENTS

COMPONENT MOUNTING

Do not connect the water lines or electrical lines to the components until each of the components are in place and secure. After all components are in place and secure visually inspect the layout to ensure that the plumbing hoses and tubes will connect kink free, in short and straight segments, and will avoid heat and abrasions from surrounding surfaces.

- 1. Attach the supplied Inlet Connection to the Sea Cock Valve and rotate it towards the location of the Sea Strainer Inlet.
- 2. Allow sufficient space between the Inlet Connection and Sea Strainer for the Inline Vacuum/ Pressure Gauge, if used.
- 3. The Sea Strainer is mounted to a flat vertical surface, below water level, between the Inlet Sea Cock Valve or the Inline Vacuum/Pressure Gauge and Rinse Clean Inlet Valve or the Inline Vacuum/ Pressure Gauge or Booster Pump. Allow clearance above the bowl to access the mesh screen for cleaning or replacement.
- 4. The optional Rinse Clean Inlet Valve with attached Rinse Clean Outlet Valve is mounted below water level between the outlet of the Sea Strainer and the Rinse/Clean Bucket or Container and the Inline Vacuum/Pressure Gauge or Booster Pump. Allow access for the operator to reach and turn the valve handles.
- 5. Allow sufficient space between the Sea Strainer or Inlet Rinse/Clean Valve and Booster Pump for the Inline Vacuum/Pressure Gauge, if used.
- 6. The Booster Pump is mounted to a flat horizontal surface using the 4 supplied 1/4x1 SS Type "A" screws. The Booster Pump is mounted below water level to assist priming, and in an accessible location to allow access for maintenance. Mount the Booster Pump in an accessible location for Seal maintenance. Keep the Booster Pump close to the Inlet Thru Hull Sea Cock Valve, Sea Strainer, and Rinse Clean Inlet Valve. If the Booster Pump is mounted Vertical place the Pump Head at the bottom and the electric motor at the top. If the pump head is above the electric motor salt water damage to the electric motor will occur when the pump seal weeps or leaks.
- 7. The Automatic Fresh Water Flush Solenoid Valve is mounted on the Fresh Water Filter Assembly, below water level, before the Booster Pump inlet. Mount the Automatic Fresh Water Flush Check Valve vertical with the arrow pointing UP. Mounting the valve horizontal or with arrow pointing down may cause it to not properly function.
- 8. Allow sufficient space after the Booster Pump Outlet for the Inline Vacuum/Pressure Gauge, if used. If the Multi Media Filter is installed this

Inline Vacuum/Pressure Gauge is not required as the Multi Media Filter includes inlet and outlet pressure gauges.

9. The optional Plankton Filter, either the single or double housing version, is mounted to a flat vertical surface using the supplied screws. Allow minimum 4 in. (10 cm) below the bowl, and allow accessibility to the Plankton Filter for mesh screen removal and maintenance. Mount the Plankton Filter in close proximity to the outlet of the Booster Pump

> or (either install the Plankton Filter or the Multi Media Filter. Installing both is redundant and will lead to line pressure loss).

The optional Multi Media Filter is mounted to a flat horizontal surface using the supplied screws. Maintain an orientation and accessibility that allows the operator to view the pressure gauges, and adjust the valves mounted to the Multi Media Filter. Mount the Multi Media Filter in close proximity to the outlet of the Booster Pump.

10. The optional Multi Media Filter is mounted to a flat horizontal surface using the supplied screws. Maintain an orientation and accessibility that allows the operator to view the pressure gauges, and adjust the valves mounted to the Multi Media Filter. Mount the Multi Media Filter in close proximity to the outlet of the Booster Pump.

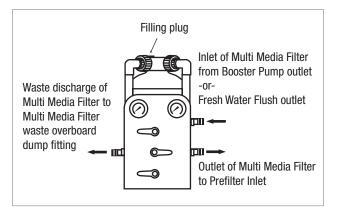


Figure 5a: Multi Media Filter


Connect the inlet to the Booster Pump or Fresh Water Flush outlet. Connect the oulet to the Prefilter inlet. Connect the Multi Media Filter's waste discharge fitting to the overboard dump waste fitting. Connect the waste outlet to the Multi Media Filter's over board dump waste fitting. Before use, you must place the supplied media, small gravel and fine sand, into the Multi Media Filter. Unscrew the Multi Media fill plug, located on top of the Multi Media Filter lid. Using a funnel, pour in approximately 15 lbs. (7 kg) of small gravel (1/8"x1/4"), then pour in approximately 26 lbs. (12 kg) of #20 silica sand. The silica sand must always go on top of the gravel. Clean the fill plug female threads of all debris and replace lid with a wrench, lightly tightened.

- **NOTE**: The Multi Media Filter must be back washed prior to use to avoid prefilter and RO Membrane Element fouling. (Refer to Commisioning, Section 6)
- 11. Allow sufficient space after the Plankton Filter Outlet for the Inline Vacuum/Pressure Gauge, if used. If the Multi Media Filter is installed this Inline Vacuum/Pressure Gauge is not required.
- 12. Prefilter. The 10 in. (25.4 cm) Dual Prefilters and the Commercial Prefilter serve the same function. Use either the 10 in. (25.4 cm) Dual Prefilters or the Commercial Prefilter. Do not use both. Using both is redundant and will lead to line pressure loss.

The Dual Prefilters are mounted to a flat vertical surface. Allow minimum 4 in. (10 cm) below the bowl, and allow accessibility to the Filters for element removal and maintenance.

or (either install the Dual Prefilters or Commercial Prefilter. Installing both will lead to line pressure loss).

The optional Commercial Prefilter replaces the 10 in. (25.4 cm) Dual Prefilters. The Commercial Prefilter is mounted to a flat horizontal surface using the supplied screws. Maintain an orientation and accessibility that allows the operator access to remove the filter element for maintenance. Allow minimum 12 in. (30.5 cm) above the top of the housing for filter element removal. Mount the Commercial Prefilter in close proximity to the outlet of the Booster Pump and the System frame. The commercial prefilter is plumbed as per the raised arrow and Inlet and Outlet letters molded into the filter housing. The correct water flow enters the outer surface of the filter element and migrates to the center core. *Refer to PAGE 5-3, fig. 5b*

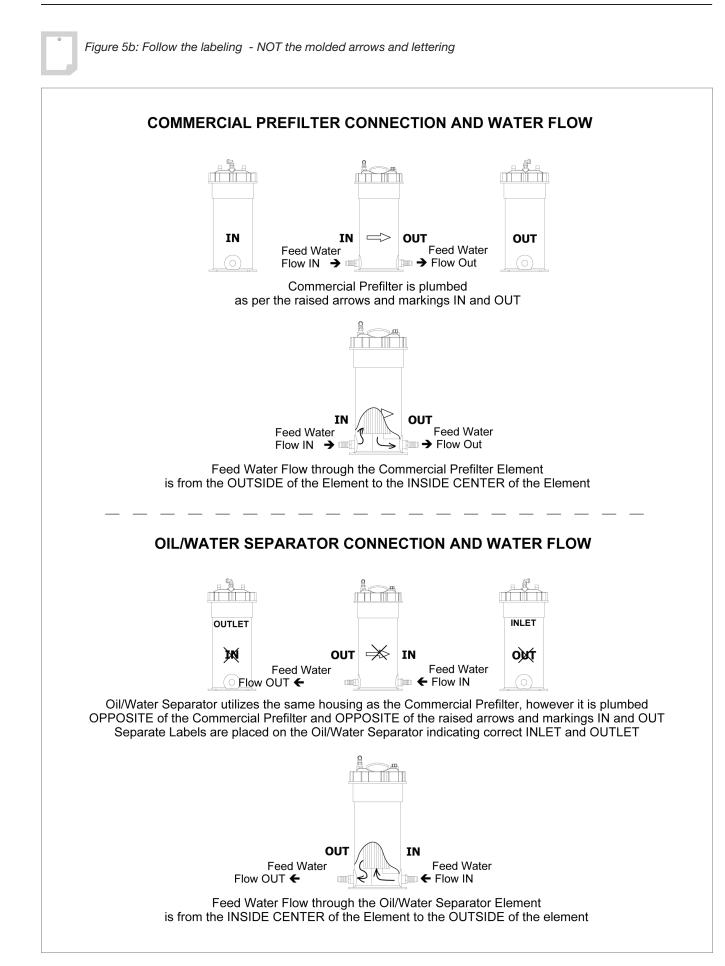

- 13. Allow sufficient space after the Commercial Prefilter for the Inline Vacuum/Pressure Gauge, if used.
- 14. The no-charge optional Oil/water Separator is mounted to a flat horizontal surface using the supplied screws. Maintain an orientation and accessibility that allows the operator access to remove the filter element for maintenance. Allow minimum 12 in. (30.5 cm) above the top of the housing for filter element removal. Mount the Oil/ water Separator in close proximity to the outlet of the Booster Pump and the System frame. *Refer to PAGE 5-3, fig. 5b*

WARNING NOTE (Refer to pg. 5-3, fig. 5b.): The Oil/water Separator utilizes the same filter housing as the Commercial Prefilter. However, the Oil/Water Separator is plumbed opposite of (backwards from) the Commercial Prefilter. This filter housing has a raised arrow molded into the housing indicating flow and the inlet and outlet ports are also marked with raised lettering Inlet and Outlet molded into the housing. For the Oil/ Water Separator these markings are INCORRECT. The Oil/Water Separator's correct water flow enters the center core of the filter element and migrates to the outer surface of the filter element (opposite that of the Commercial prefilter).

Prior to shipping Sea Recovery has placed lnlet and Outlet labels (stickers) indicating the correct plumbing. Follow the stickers, not the molded arrow and lettering.

Refer to PAGE 5-4.

15. Pressure Differential Transducer. The optional Pressure Differential Transducer threads into the center port of the Low Pressure Transducer Manifold.

CAUTION: Take care to NOT cross the fine female threads in the manifold.

Thread in clockwise finger tight. Using a wrench tighten an additional 45 degrees.

DO NOT OVER TIGHTEN.

OVER TIGHTENING WILL STRIP THE MANIFOLD FEMALE THREADS.

Using the supplied 1/4 in. (6.35 mm) 0.D. tubing connect the center Pressure Differential Transducer Tube Fitting to the T-Connector Pressure Pick-Up or to the Pressure Pick Up port of the respective Prefiltration component. Refer to the various Piping and Interconnect Diagrams Illustrated in this Section 3.

 The HP Pump is mounted to a flat horizontal surface using the 4 supplied 5/16-18x3/4 SS Hex bolts, nuts and washer. The HP Pump is mounted in an accessible location to allow access for maintenance.

Set the HP Pump in place onto a flat surface and mark the mounting holes.

Move the HP Pump out of the way and drill the appropriate hole depending on which hardware will be used. Place the HP Pump over the drilled holes and attach the rubber isolation grommet under the plate at each of the 4 mounting holes.

 RO Membrane Presure Vessels must be mounted on a flat or vertical surface close to the HP Pump. If possible allow 27-47 in. (68.6-119.4 cm) clearance at the ends for RO Membrane maintenance.

The Pressure Vessel assembly can be removed entirely from surface for maintenance.

- 18. UV Sterilizer Installation. The Ultra Violet Sterilizer should be mounted on a flat horizontal or vertical wall. Refer to Section 5.8 for installation details.
- 19. The Fresh Water Flush Carbon Filter is mounted to a flat vertical surface in an accessible location for filter element changing. Choose a location between the Automatic Fresh Water Flush Check Valve and a pressurized line from the boat's fresh water pressure system.

CAUTION: In order to provide the required flow of water to the Aqua Whisper System during the Fresh Water Flush cycle, the Boat or Home's fresh water pressure system must deliver minimum 1 U.S. Gallons (3.8 Liters) Per Minute at minimum 25 PSI and maximum 60 PSI (minimum 172 kPa and maximum 414 kPa).

TUBING AND HOSE PRECAUTIONS

TUBE FITTING CONNECTIONS ASSEMBLY

- a. Cut tube end square and clean.
- b. Loosen nut on fitting three turns.
- c. Insert tube into fitting until it bottoms.
- d. Loosen nut completely and remove tube with attached parts from body.
- e. Check to ensure that the O-Ring is seated onto the tube under the spacer.
 (and not pinched into the body)
- f. Insert tube with attached parts into the body and tighten nut finger tight.



CAUTION (*Refer to fig. 5c, pg 5-5*): Always allow slack in all tube and hose lines. Never cause the tube or hose to immediately bend from the fitting. Allow the line to enter or leave from the fitting in a straight manner for several inches to ensure proper connection, to relieve stress to the fitting and tube or hose, and to allow ease of detachment and reattachment during maintenance or repair.

If water lines are pulled tight causing them to bend at the fitting they will leak, allow air to enter, fail prematurely, and or break the fitting that they are attached to.

5.3 INTERCONNECTING COMPONENTS

INTERCONNECTING COMPONENTS WITH SUPPLIED HOSE *Chart Available on Page 5-6*

 Using the supplied 3/4 in. (19 mm) I.D. clear braided hose connect the Suction Line components, Low Pressure line components, and Brine Discharge Line components:

> Secure each connection with the supplied hose clamps. Ensure all Suction Hose connections use two hose clamps rotated 180 degrees with the screw heads facing the same direction. Remove any flash on the Hose Barb fittings using fine sandpaper.

If your System is not supplied with a mentioned optional component then skip it and connect to the next supplied component.

- With the supplied 1/2 in. (12.7 mm) I.D. clear braided hose connect the Feed Water Line components and secure each connection with the supplied hose clamps, placing 1 hose clamp onto each hose barb fitting:
- 3/8 in. (9.5 mm) OD nylon tubing is supplied with applicable components for connecting Product Water and FWF components. Use or non use of the 3/8 in. (9.5 mm) OD nylon tubing is dependent upon Product Water and FWF options installed.
- 1/4 in. (6.35 mm) OD nylon tubing is supplied with applicable components for connecting Pressure Pick Up points to the Low Pressure Transducers. Use or non use of the 1/4 in. (6.35 mm) OD nylon tubing is dependent upon Prefiltration options installed.
- 5. Ensure all High Pressure Hoses supplied for the RO Pressure Vessel assembly have sufficient slack and are not pulled tight into a sharp or immediate bend.

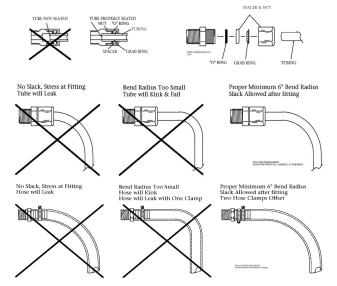


Figure 5c - Always allow slack in all tube and hose lines.

5.4 WATER TANK

CUSTOMER SUPPLIED FRESH WATER TANK, HIGH AND LOW LEVEL SWITCHES, AND ALARM

Not Numbered on the Piping and Interconnect Diagram. Installed inside the Fresh Water Tank.

These two tank level switches are not necessary for operation of the System. They do add additional features

Installation

to the Automatic mode of the System. The choice of make, model, and style are left up to the Installer or Owner. They must meet the electrical requirement and operation as explained below.

The customer may also connect an external alarm to the System which will alert the operator that they system has shut down.

Fresh Water Tank Low Level Switch ** owner/installer supplied provides an optional feature to the System Control Logic that works in conjunction with the Automatic Fresh Water Flush option.

When installed and connected to the Main Printed Circuit Board, the Fresh Water Tank Low Level Switch must be connected as a N.O. (Normally Open) 1PST (One Pole Single Throw) switch.

When the Fresh Water Tank is empty the switch is Open. As water rises a few inches in the tank the switch Closes. This informs the System Control Logic that there is sufficient Fresh Water to perform the Automatic Fresh Water Flush Cycle.

Fresh Water Tank High Level Switch ** owner/installer supplied provides an optional feature to the System Control Logic that allows the System to shut off automatically when the Fresh Water Tank is full, when the System is operated in the Automatic mode. Additionally, the System will not start in the Automatic mode when the Fresh Water Tank High Level Switch signals the System Control Logic that the Fresh Water Tank is full.

When installed and connected to the Main Printed Circuit Board, the Fresh Water Tank High Level Switch must be connected as a N.C. (Normally Closed) 1PST (One Pole Single Throw) switch.

When the Fresh Water Tank is several inches below the full mark the switch is Closed. As water rises and reaches the top of the full mark the switch Opens. This informs the System Control Logic that the Fresh Water Tank is full, the System will shut down if operating in the Automatic mode, and the System will not start in the Automatic mode.

If operation of the System is desired when the Fresh Water Tank Switch signals the System Control Logic that the Fresh Water Tank is full then the System may be operated in the Manual mode.

Alarm ** owner/installer supplied provides an optional feature to the System Control Logic that audibly or visually signals the operator that the System has stopped operating.

The output of this alarm circuit form the Main Printed Circuit Board is 12 VDC with MAXIMUM allowable current consumption of 1 (one) Ampere.

This alarm will signal if a fault occurs. It will not signal with a normal shut down that was not associated with a fault.

Outlet of	To Inlet of
Inlet Connection	Sea Strainer
Sea Strainer	Rinse Clean Inlet Valve left or right port
Rinse Clean Inlet Valve unused left or right port	Rinse/Clean container
Rinse Clean Inlet Valve center port	Booster Pump
Booster Pump	Prefilteration Options
Prefilter Option	LP Manifold
Brine Discharge Tee	Rinse Clean Discharge Valve
Rinse Clean Discharge Valve	Cleaning Bucket
Rinse Clean Discharge Valve	Brine Discharge Connector
Multi Media Filter Waste Line (if used)	Multi Media Filter Discharge Fitting separate Thru-Hull or Tee at Brine Discharge Connector
pH Neutralizing Filter	Ultra Violet Sterilizer
Ultra Violet Sterilizer	Potable Water Storage Tank or Cistern

Component Interconnect Chart

5.5 REMOTE TOUCH SCREEN

PLACEMENT AND SECURING THE REMOTE TOUCH SCREEN ENCLOSURE ASSEMBLY

The Remote Touch Screen is supplied with a 80 ft. (24.4 m) long NMEA 200 cable for connection to the Main Control Panel.

Place and install the Remote Touch Screen in a location that is:

- 1. Away from water lines and hoses
- 2. Away from locations subject to water spray
- 3. In an accessible and viewable location
- 4. Within 80 ft. (24.4 m) of the Main Control Panel

5.6 ELECTRICAL CONNECTIONS

Refer to the electrical diagram in Section 4.




CAUTION: The Reverse Osmosis Membrane Element(s) must be kept wet else severe loss of production will occur. Refer to Section 7 for further information and instructions.


5.7 LAND FEED WATER PICK-UP


LAND INSTALLATION FEED WATER PICK-UP INFORMATION

Refer to the illustrations on the next page.


Example of Water intake from a Deep Well



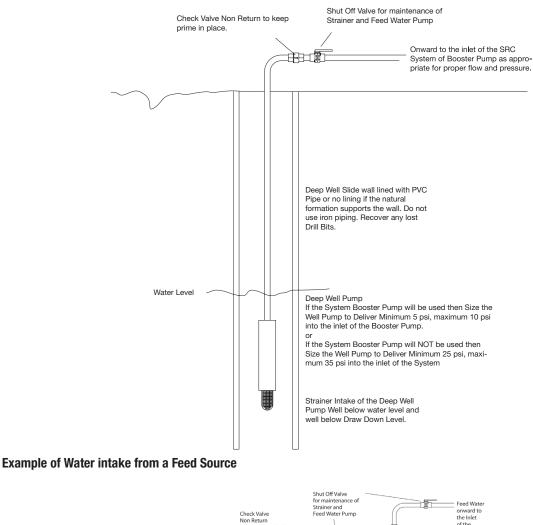

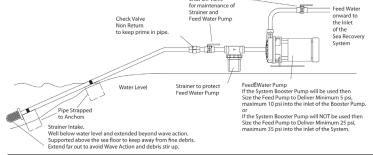



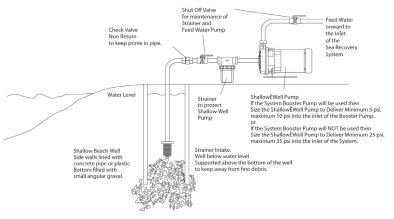



5.8 UV STERILIZER INSTALLATION

The SP Series UV unit is shipped with the UV lamp, quartz sleeve, fittings, and O-rings and need to be assembled before the UV unit can be used.

- 1. Install the UV unit in a sheltered, well ventilated area.
- 2. Install the UV unit as close as possible to the pointof-use to avoid potential contamination discharge from pipes, fittings, etc.
- 3. The UV unit should be mounted on stable support to avoid straining or warping. Allow sufficient clearance around the unit for servicing.
- 4. Verify the location is free from vibration.
- 5. All UV units are rated for maximum operating pressure at 50 psig (8.24 bar).
- 6. The UV unit must be properly grounded for safe and proper operation. Failure to properly ground the UV unit automatically voids all unit warranty.
- 7. Line voltage must be within 10.56V to 16.50V. Voltage outside the range will compromise the performance of the UV unit.

Plumbing Requirements

All piping, tubes and hoses leading to the UV unit connection points must be leak-free before the UV unit can be installed.



NOTE: The UV unit may be installed horizontally or vertically. For vertical installation, make sure the inlet port is positioned at the bottom.

Installation Procedure



NOTE: Do not assemble or install damaged parts. Quartz sleeve and UV lamp are fragile and must be handled with care.

Install Fittings

Perform this procedure to prepare the UV unit for installation.

1. Inspect each port and fitting to ensure threads are free of dirt, burrs, and excessive nicks. If threads are badly nicked, replace the fitting.

Wrap ¼ in (6.35 mm) wide PTFE tape 2 to 3 turns counter-clockwise around the male threads of the ¼ in (6.35 mm) fitting.

Do not wrap tape around the first thread.

- 3. Screw the fitting into cylinder ports to finger tight position to achieve desired alignment.
- 4. Do not back-off fitting. Do not over-tighten fitting. Over-tightening could strip the fitting threads and cause leak.

Install Quartz Sleeve

Perform this procedure only when water piping for UV unit is in place and ready for service.

- 1. Visually inspect quartz sleeve for cracks and damages.
- 2. Remove the four screws holding the ballast box cover and remove the cover.



 Remove the rubber boot. pull out the 4-point lamp connector.



Installation

4. Remove the compression nuts.



- 5. Insert the close-end of the quartz sleeve into the cylinder through the ballast box pass-thru.
- Leave a ½ in (12.7 mm) of the quartz sleeve to expose on the viewport pass-thru.





- 7. Lubricate the tips of the quartz sleeve with clean water and insert new O-ring. Ensure the O-ring has all-round contact with the cylinder pass-thru.
- Tighten the compression nut while making sure the nut does not contact the quartz sleeve. Adjust O-ring position as necessary. The compression nut should be snug and tight, not over-torque.
- 9. Repeat Step 7 and 8 on the ballast box compression nut.

Connect Plumbing

Tube or hose ends must be cut squared and clean; must have no rough edges. The quick fit elbow fitting has a C-clamp that will lock the tube in place once inserted.

- 1. Insert the supply pipe into one cylinder port and label the port "Inlet".
- 2. Insert the temporary pipe into the other cylinder port to direct water into a container.



Slowly fill the cylinder with water and flush cylinder for 1 minute.



- 4. Remove temporary pipe and insert the return pipe into the cylinder port and label the port "Outlet".
- 5. Slowly pressurize the UV unit by filling the cylinder with water while checking for leaks.
- 6. If leaks are found on the compression nuts, depressurize the unit and slightly tighten the leaking compression nut.
- 7. Retest until a leak-free installation is verified.
- 8. Once UV unit is leak-free, the quartz sleeve installation is complete and the UV lamp can be installed.

•

tube from fitting, first remove the C-clamp then push fitting sleeve down. Once the fitting sleeve is down, pull the tube out

NOTE! To remove



down, pull the tube out of the fitting.

Install Ultraviolet Lamp

Perform this procedure only after the quartz sleeve installation and leak-tests are completed successfully

1. Connect the UV lamp to the 4-point receptacle. If the lamp is not installed properly, lamp breakage will occur.



2. Insert lamp into quartz sleeve through compression nut pass-thu.



3. Install rubber boot over compression nut.




- 4. Connect unit power cable to power source.
- 5. Tighten the 4 screws to secure ballast box cover.
- 6. Turn ON the power to the unit.
- 7. Verify UV lamp operation from the viewport.
- 8. Allow one minute for the UV lamp to warm up prior to flowing water through the UV unit.



CAUTION! Use the viewport to verify the proper operation of the UV lamp.

3.



CAUTION! Prior to energizing the lamp, make sure there is no water leaking from the quartz sleeve compression nuts.

Mounting the Unit

Once the UV unit is assembled and tested successfully, it can be mounted onto its permanent operational location. The unit must be mounted in a manner that will prevent excessive vibration and warping which will damage the quartz sleeve.

Operational Guidelines

- a) Release the pressure in the UV treatment chamber before breaking the compression nut seals.
- b) Disconnect all power to the UV unit before servicing.
- c) Do not allow the inlet water temperature to drop below 35°F (2°C).
- d) Do not allow the flow rate to exceed 2 GPM (7.5 LPM).
- e) Do not cycle the UV unit more than 3 "ON/OFF" cycles in a 24-hour period.
- f) Ensure all plumbing connections are tightly sealed before applying pressure.
- g) Before connecting the return tube, flush the unit to rinse out any debris left from the installation process.

WARNING! UV LIGHT EXPOSURE CAN SEVERELY BURN AND DAMAGE EYES AND SKIN.

WARNING! DO NOT look at the blue UV light. DO NOT operate the UV lamp outside of the UV treatment chamber.

CAUTION! The unit operates on high voltage and must be serviced by qualified personnel only.



CAUTION! Standard flow rate are based on water temperature 35°F to 100°F (2°C to 38°C). If the inlet water temperature exceeds 100°F (38°C), please contact your local CSR.



CAUTION! Cycling more than 3 cycles will reduce the end-of-life (EOL) output and/or cause premature lamp failure.

Aqua Whisper DX Modular 450-1800 Section 6 - COMMISSIONING

Commissioning

6 COMMISSIONING

COMMISSIONING NOTES

These Commissioning instructions must be carried out for initial start-up of a NEW system.

Failure to follow these instructions will lead to system failure and cause damage to components.

6.1 CHECK INSTALLATION

Ensure that the installation has been properly performed. Do not rely on the installer's word, do not assume the System has been installed correctly.

WARNING: Damage caused to the system due to operation of an improperly installed system is the liability of the installer and the operator.

Check each water connection to the system to ensure that the installer has properly connected and properly routed each tube. Improper routing and any blockage in any line causes damage to the system. Improperly connected or loose connected lines resulting in leaks causing damage is the liability of the installer and the operator, and is not covered by the Sea Recovery warranty.

Do not assume and do not rely on the installer's word; check it yourself.

Make sure that the Electrical Power Source, boat's circuit breaker to the system, is switched "OFF".

Open the unit cover and check all electrical and electronic connections for proper wiring and attachment.

After checking all wiring for correct and tight connection, close the cover.

Switch the Electrical Power Source, boat's circuit breaker to the system, to the "ON" position.

6.2 CHECK RO MEMBRANE

Check to ensure that the Reverse Osmosis Membrane Elements are installed within the Pressure Vessels.

CAUTION: Some systems are shipped WITHOUT the Reverse Osmosis Membrane Element. This is to accommodate Boat Builders that install the system well in advance of commissioning the System. If the Reverse Osmosis Membrane Element has been installed, there will be a Reverse Osmosis Membrane Element Serial Number tag, attached to the High Pressure Vessel.

If the R.O. Membrane Element Serial Number tag is missing or does not contain a serial number and date, then immediately contact the company that sold the system to you, the installer, or Sea Recovery.

WARNING! DO NOT attempt to operate the system without a Reverse Osmosis Membrane Element installed in the system otherwise extensive damage will result.

WARNING! Damage caused to the system due to operation of the System without an R.O. Membrane Element correctly installed is the liability of the installer and the operator.

6.3 SETUP CONTROLLER

The controller is set by Sea Recovery prior to shipping based on the features and optional equipment that shipped with the System at the time of ordering.

Addition of the Fresh Water Flush to the System after it has shipped from Sea Recovery will require new set up of the computer logic.


Addition of, removal of, or changes in the length of the R.O. Membrane / Pressure Vessel Assembly will require control logic setup. Refer to the NMEA Configuration Guide.



A. FEATURES PROGRAMMABLE BY OPERATOR


The following is an explanation of features in the main controller that are programmable by the operator. It is required that each feature be set properly in order to gain maximum performance of the System.

Only preinstalled features will be displayed on this screen.

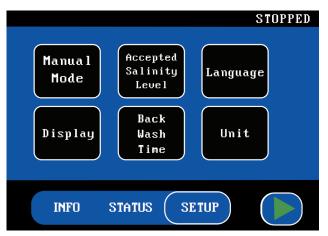

1. MANUAL MODE

Enable user to control the Booster Pump, HP Pump, Diversion Valve and Pressure.

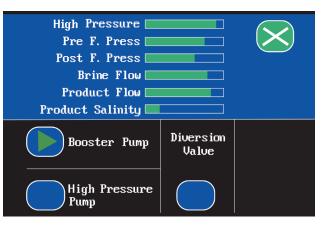

- a) **BOOSTER PUMP** Manually start and stop the Booster Pump.
- b) HIGH PRESSURE PUMP Manually start and stop the HP Pump when the Booster Pump is running.
- c) DIVERSION VALVE SET POINT

Manually energize the 3-Way Product Water Diversion Valve when the specified product water quality level has been reached, in PPM (Parts Per Million). The factory setting is 500 PPM TDS (five hundred Parts Per Million Total Dissolved Solids expressed as NaCl [sodium chloride - salt]).

2. DISPLAY

Changes the color contrast of the touch screen for better viewing.

3. ACCEPTED SALINITY LEVEL

Changes the accepted salinity level by adjusting the PPM level.

4. BACK WASH TIME

Changes the interval for automatic FWF by adjusting the number of days.

5. LANGUAGE

Changes the current language used on the controller by selecting new language option.

6. UNIT

Toggles the measurement standards between U.S. Standards and Metric Standards

Pressure: U.S. Standard = PSI (Pounds Per square Inch); Metric Standard = kPa (kilo Pasquel)

Flow: U.S. Standard = GPM (Gallons Per Minute) or GPH (Gallons Per Hour); Metric Standard = LPM (Liters Per Minute) or LPH (Liters Per Hour).

SYSTEM MAIN CONTROLLER UPDATE AS OF 10/30/2017

System Commissioning

The Aquamatic, Aquamatic XL and AquaWhisper desalination system controller comes loaded with a special utility tool designed to aid the dealer in the commissioning of the system. This utility can be used to set a limited number of options within the controller, and is accessed in the following manner.

NOTE: Your system should not be running when attempting to enter dealer commissioning mode.

CAUTION: All electrical covers should be on before providing powering to the system. Electrical shock may accrue if electrical boxes are exposed.

- **1.** Press Anywhere on the Main Splash screen to begin.
- 2. Press the indicated area to gain access to the system information area.
- **3.** On System Overview Screen press and hold the indicated area for at least 2 seconds to gain access to the 'System Additional Functions' menu area.






4. Log in using your dealer user name and password in the area shown below

NOTE: Password is case sensitive

5. Press System Configuration shown below

6. Select or Enter in SYSTEM TYPE, SYSTEM FREQUENCY, SYSTEM SIZE, and CURRENT TIME.

	Aqua Matic	Aqua Whisper DX	Aqua Matic XL
SYSTEM SIZE RANGE	450-1800	450-1800	2200-3400
SYSTEM FREQUENCY	50 or 60 Hz	50 or 60 Hz	50 or 60 Hz
CURRRENT TIME	24 Hour	24 Hour	24 Hour

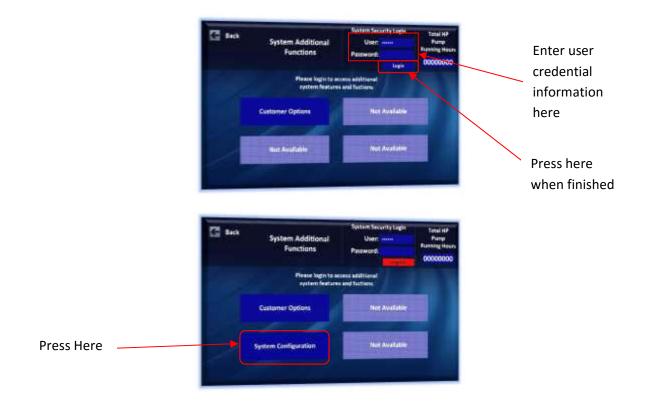



- 7. Press 'System Option' tab.
- 8. Select option applicable to your system.

System Tank Level Control	ON	OFF
System UV Sterilizer	ON	OFF
System Fresh Water Flush	ON	OFF
System Emergency Stop	ON	OFF

	System Cartiguration		
history believes the	Tel: Lond Server (1999)		
Septem Spillers	un bierber beiten 🕬	•	
Security	Auto TRIT System. DR		
Organitiwa	1 1 10	- 200	
61999-1998 	Streegeny Dec. ²⁰⁷	Ð	

9. Press 'Communications' tab

10. Select options applicable to your system

Communications Status	ON	OFF	
Communications Protocol	STD NMEA 2000	SRC	
Communications Port	NMEA2000	Remote	

	System Configuration		
intern beberendten	Generationians		•
Series Determ	Potent	-	•
Conversion.			
Original Terms	Green autors Parts		0
System Materia			
10 000 1000			

11. Press system 'Output Tests' tab

CAUTION: This page is meant to test individual function test of components power and motor rotation prior to running the system. **SINCE SYSTEM IS NOT PRIMED WITH WATER DO NOT TRY TO RUN SYSTEM COMPONENT FOR LONG PERIODS OR DAMAGE WILL ACCURE**.



12. Press each tab to test Power and/or motor rotation

- Auxiliary Pump (On, Off)
- Booster Pump (On, Off)
- High Pressure Pump (On, Off)
- Product Valve (On, Off)
- Fresh Water Flush Valve (On, Off)
- UV Sterilizer (On, Off)
- Jog BPR Clockwise (Only available on Aquamatic Models)
- Jog BPR Counter Clockwise (Only available on Aquamatic Models)

13. Press System Health Tab

Note: This tab will show a complete overview of the current system health along with any external sensors connected. A 'Fault!!' indicator will appear if a problem is detected. High speed flow meters cannot be tested automatically, but the output values of these sensors can be viewed here and should display a value when pumps are operated.

The 'System Health' screen displayed by the controller is shown below:



14. Press Save & Exit

Your system is now configured.

Display Settings

The Aquamatic, Aquamatic XL and AquaWhisper desalination system controller also allows you to configure your desired display settings. These setting include language, unit display and screen brightness. To update any of these settings, please follow the procedures outlined below:

- 1. Press Anywhere on the Main Splash screen to begin.
- 2. Press the display setting icon shown below.
- 3. Press language to set desired language.



4. Press Units to set desired Units.



5. Press Brightness to set desired brightness level.



To return to the 'Main Menu' screen simply press on the 'Home' button, as shown above.

Setting System Clock

- 1. Press system settings icon.
- 2. Press Clock.

Press here



- 3. Choose your time format.
- 4. Press on Set Time enter in the correct time.
- 5. Press Set for 2 seconds to set time.



6. Press home to return.

Setting System Run Timers

- 1. Press system settings icon.
- 2. Press Run Time.





3. Press HP Pump Delay to change default setting for the HP pump time delay.



HP Pump Delay Time

This delay timer controls the startup delay applied to the high-pressure pump during system activation. The default delay time is 10 seconds, but if your application has the booster pump located some distance away from the main unit, a longer delay may be required to allow the feed water to reach the high-pressure pump. The time value delay range is from 5 seconds to 99 seconds.

4. Press Tank Level Switch to change default setting tank level switch



Tank Level Switch Delay Time

This delay timer controls the delay period applied to the state change of the production tank level switches. As the tank begins to fill with fresh water and with movement of the vessel, the water level within the tank will oscillate. This oscillation will cause constant activation and de-activation of the product tank level switches when the tank level is near their detection point, this programmable delay period is designed to accommodate for these oscillations, so false triggering of these level switches is avoided. The time value delay range is from 5 minutes to 99 minutes.

5. Press Water Production to change default setting to the desired amount before system shutdown. A value of zero '0' will de-activate this feature.



Water Production


This controls the amount of water produced by the water maker. Once the produced water equals the amount programmed, the water maker will shut down. When the user re-starts the water maker, it will run until the produced amount of water equals the value stated. Production range is from 1 gallon to 4000 gallons.

6. Press Auto Shutdown to change default setting to the desired time. A value of zero '0' will deactivate this feature.




Auto Shutdown Operation

This controls the amount of time the water maker will operate. Once the operational time reaches the desired time, the water maker will shut down. When the user re-starts the water maker, it will run until the operational time stated. The time value range is from 1 hour to 48 hours.



Fresh Water Flush

This controls the sleep time between system fresh water flush cycles and the duration of the fresh water flush.

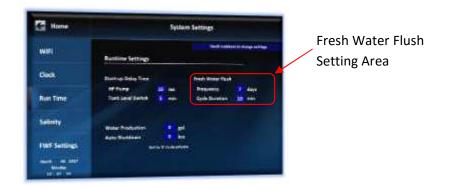

7. Press Fresh Water Flush Frequency to change the default number of days between fresh water flushing.

Fresh Water Flush			
Frequency	7	days	Press here
Cycle Duration	10	min	

8. Press Fresh Water Flush Cycle Duration to change the default time for fresh water flushing.

Fresh Water Flush			
Frequency	7	days	Press here
Cycle Duration	10	min	

9. Press home to return.

Setting System Salinity

The Aquamatic, Aquamatic XL and AquaWhisper desalination system controller allows you to configure your desired production water quality using two methods. The primary method used is by the simple movement left or right of the salinity bar or entering a value.

- 1. Press system settings icon.
- 2. Press Salinity tab.



3. Move slider bar left or right to adjust salinity or enter desired value in required Product Quality.



The Salinity value range is 150PPM to 999PPM. Once the value is entered, the slider position, and the current setting value will update appropriately.

4. Press home to return.

Setting Fresh Water Flush

The Aquamatic, Aquamatic XL and AquaWhisper desalination system controller allows you to configure your desired fresh water flush program settings in two areas. The first area is in 'Runtime Settings', as discussed previously. However, the same setting can also be adjusted in the dedicated 'FWF Settings' tab, this tab also gives information about the current FWF system status, including the number of days until the next flushing cycle will take place.

- 5. Press system settings icon.
- 6. Press FWF Settings.



Fresh Water Flush Frequency

This controls the sleep time between system fresh water flush cycles. Immediately after a system shutdown, the fresh water flush program activates for a set duration. This flushing is done to remove sea water from system components, and replace it with fresh water. However, it is vital this fresh water be replaced every so often to ensure no biological growth can occur. The default cycle time is 7 days, meaning each 7 days the fresh water flush program will repeat. Programmable cycle times range from a minimum of 1 day to 15 days.

7. Press Fresh Water Flush Frequency to change the default number of days between fresh water

G Home	System Settings	E Bone	System Settings	Press on th
WE	Fresh Water Flush Cycle	(WP)	Fresh We Date	default value to
COR.	The Party Model Party Anti-Anti-Anti-Anti-Anti-Anti-Anti-Anti-	Cial.	The second secon	
Run Time	Nexuli Water Fluids system over 1 2 days Nets Long (Nexul Science) Castle Datation Nexul Science (Nexul)	tus Time	Angel Wei 20 John 200 Zi E E Zi A Spelie Vei Zi Zi E Zi A Spelie Vei Zi Zi Zi Zi	change it. Enter your
Selecty	Current Fresh Water Flush Status	Salletty	Current J 2 1 BK	, desired val
INF Sections	Time revealed g for most fluck start or 72 days	FWF Settings	Time not seeing at the time at a fair the	and press
		And it set		'Enter'.

Fresh Water Flush Cycle Duration

This sets the fresh water flushing time. In most applications, a fresh water flushing time of 10 minutes is adequate to displace all sea water from the system. However, this cycle duration can be changed if desired. The Fresh Water Flush duration range is from 3 minutes to 30 minutes.

8. Press Fresh Water Flush Cycle Duration to change the default time for fresh water flushing.



Current Fresh Water Flush Status

NOTE: This display variable indicates the number of days remaining until the next fresh water flush cycle begins. If '**' is displayed, no fresh water flush cycles are scheduled

9. Press home to return.

6.4 CHECK SYSTEM MANUALLY

Refer to the P&ID in Section 3.

- 1. Ensure that the manual By-Pass lever on the 3-Way Product Water Diversion Valve is positioned outward (away from the coil body).
- 2. Open any auxiliary valve within the incoming Feed Line, Outgoing Brine Discharge Line, and Outgoing Product Water Line.
 - **WARNING**: If any auxiliary valve is installed in these lines, it will damage the System if left closed during starting and/ or operation of the system. The resulting damage is the liability of the operator.
- 3. Position Rinse Clean Inlet Valve to normal operation towards the Sea Restrainer.
- 4. Position Rinse Clean Outlet Valve to normal operation towards the Thru Hull Discharge Fitting.
- 5. Unwind the Back Pressure Regulator to fully open position (counter clockwise).

- 6. Check all filter housings to ensure that they contain the proper filter element:
 - a) Sea Strainer check for monel screen
 - b) Plankton Filter if installed check for monel fine mesh screen filter element
 - c) Multi Media Filter if installed check for media (#20 silica sand).
 - d) Dual Prefilter or Commercial Prefilter check for pleated cartridge filter elements
 - e) Oil/water Separator check for Oil/water Separator filter element
 - R.O. Membrane(s) check for Sea Recovery Serial Number and Date on the label attached to each pressure vessel.
 - g) Charcoal Filter check for charcoal filter element
 - h) pH Neutralizer check for pH Neutralizer cartridge
 - i) Fresh Water Flush Carbon Filter check for Carbon element.
- 7. Function Tests of Electric Components:

PRIOR TO ASSUMING THAT AN ELECTRICAL COMPONENT IS BROKEN OR NON FUNCTIONAL PERFORM A FUNCTION TEST TO DETERMINE IF IT IS OPERABLE OR NOT.

Function Tests should be performed manually as part of the commissioning procedure.

- Booster Pump Electric Motor
- High Pressure Pump Electric Motor
- Diversion Valve energize solenoid
- Fresh Water Flush Valve energize solenoid
- UV Sterilizer Ballast and Lamp
- a) Electric Motor Rotational Check:
 - Ask an assistant to view the fan section of the Booster Pump Motor and High Pressure Pump Motor.while you "Jog" each of these electric motors. Rotation is clockwise when viewing the back of the electric motor (fan), counter clock wise when viewing the front of the pump.
- b) Check the function of the following:
 - DIVERSION VALVE: 3-Way Product Diversion Valve Solenoid will energize momentarily. The valve should click when repositioning.

- FWF VALVE: Fresh Water Flush Solenoid Valve will actuate to the Fresh Water Flush position. Pressing the switch a second time will cause the Fresh Water Flush Solenoid Valve to revert to the Normal Feed position. The valve should click when repositioning.
- UV STERILIZER: UV Sterilizer will flicker when energized. Check for illumination at the UV Sterilizer viewport without looking directly at the light.
- c) Correct any abnormalities.
- 7. Prime the System.

In order to save time and make the initial start easy, when starting the System for the first time, the feed water lines and each component in the prefiltration section should be filled with either feed water or fresh water. This will prime the feed water section including the Booster Pump so that it will be able to pick up and continue delivering feed water.

6.5 OPERATION NOTES

BEFORE starting the System in semi-auto mode be prepared for the following sequence. After the System has been started the following will occur:

> **CAUTION**: The operator must verify the back pressure regulator valve knob is in fully open position before starting the System.

- 1. The System starts monitoring the Tank Low Level sensor, pressures, and water flow.
- 2. The System starts the booster pump.
- 3. When the inlet pressure of the high pressure pump is within valid range for 20 seconds, the System starts the high pressure pump.
- 4. The operator verifies that the low pressure gauge reading is within 35 psi normal operating range.
- 5. The operator increases operating pressure by adjusting the back pressure regulator valve knob in a clockwise direction.
- 6. When the product water flow reaches the configured production rate, the System starts monitoring the product water salinity.
- 7. While monitoring the product water flow reading on the control panel, the operator then adjusts

Commissioning

the back pressure regulator knob in small steps for the product water to flow at the configured production rate.

If the system pressure exceeds 975 psi, an alarm will sound and system safety will be activated and shut down the System.

- 8. When the sensor indicates that the product water tank is not full the System starts a 5-minute countdown.
- 9. When the salinity of the product water is below the set up salinity level for 5 seconds, the 3-way Product Water Diversion Valve is energized sending the product water to the potable water outlet, the UV sterilizer will energize if this option is installed. This may take up to 30 minutes.
- 10. Feed Pressure, Feed Flow, Operating Pressure, Brine Flow, Product Flow, and Product Salinity are all being monitored and the values of these readings cause the System Control Logic to perform various tasks to maintain proper functioning of the System.
- 11. When the Tank High Level sensor indicates that the water tank is full, the System will stop all operations.
 - a) Operator must adjust the Back Pressure Regulator to 0 psig (o bar).
 - b) The 3-Way Product Water Diversion Valve will revert to unpotable water.
 - c) The UV Sterilizer will stop.
 - d) The High Pressure Pump will stop.
 - e) The Booster Pump will stop.
 - f) If the System does not include the Automatic Fresh Water Flush option this ends the stop sequence.
 - or
 - g) If the System includes the Automatic Fresh Water Flush option, the Automatic Fresh Water Flush Valve will energize and ffter 7 to 15 minutes the Fresh Water Flush Valve will deenergize and the Stop sequence is complete.
- 12. The System will go to a Fresh Water Flush Stand-by mode and count down until the next automatic Fresh Water Flush Cycle. The Fresh Water Flush Cycle will automatically initiate every preset number of days until canceled or power is disconnected from the System.

MULTI MEDIA FILTER BACKWASH AND RINSE:

If the System is equipped with a Multi Media Filter it must be back washed and rinsed. New gravel and sand contain fines that must be backwashed from the multi media filter prior to operating the System.


- 1. Open the Inlet Sea Cock Valve.
- 2. Position the Rinse Clean Inlet Valve, to the normal operating position towards the Sea Strainer.
- Position the Rinse Clean Outlet Valve, to the normal operating position towards the Multi Media Filter Brine Discharge Thru-Hull Fitting.
- 4. Position the Multi Media Filter valves to Backwash.
- 5. Set the controller into the Manual mode of operation, and operate only the Booster Pump.
- 6. After 10 minutes of back washing, stop the Booster Pump.
- 7. Position the Multi Media Filter Valves to Rinse.
- 8. In the Manual mode of operation, operate only the Booster Pump.
- 9. After 5 minutes of Rinsing, stop the Booster Pump.
- 10. Position the Multi Media Filter Valves to Normal Operation.

6.6 INITIAL STARTUP

6.6.1 POSITION SYSTEM VALVES

VALVE	POSITION
Inlet Sea Cock Valve	FULL OPEN
Rinse Clean Inlet Valve	FROM SEA STRAINER TO FRESH WATER FLUSH VALVE
Rinse Clean Outlet Valve	FROM BRINE DISCHARGE OF SYSTEM TO THRU HULL DISCHARGE FITTING
Multi Media Filter Valves	NORMAL OPERATION
Back Pressure Regulator	FULL OPEN
ANY auxiliary valve in the Feed Line, Brine Discharge Line, or Product Water Line	FULL OPEN

WARNING: If any auxiliary valve is installed in these lines, it will damage the System if left closed during starting and/ or operation of the system. The resulting damage to the system is attributed to improper installation, is the liability of the operator, and is not covered by the Sea Recovery warranty.

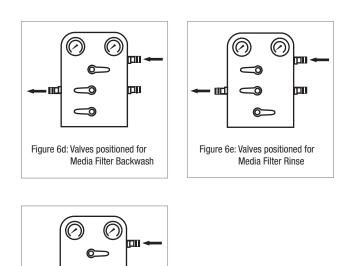



- MC

Figure 6f: Valves positioned for Normal Operation

- a) Switch the Electrical Power Source, boat or home's circuit breaker to the system "ON".
- b) All Operating Screens WILL NOT include the Automatic Fresh Water Flush components if the Fresh Water Flush Option is not installed and the control logic has been informed that the Fresh Water Flush Option is not installed.
- c) After the control logic has initiated itself, the default screen will appear indicating that the System is ready to Start.



Fig. 6a: Default screen

6.6.3 START THE SYSTEM

A. SEMI-AUTOMATIC MODE

The Semi-Automatic Mode is recommended for users and owners. These instructions are recommended when the System is configured with a Tank High Level sensor.

- 1. Verify the back pressure regulator valve knob is in full open position.
- 2. Press the Start button on the Main Control Panel or Remote Control Panel.
 - a) The System starts monitoring the Tank level, system pressures, and system water flow.
 - b) The System starts the booster pump.
 - c) When the inlet pressure of the high pressure pump is within 35 psi (2.4 bar) for 20 seconds, the System starts the high pressure pump.
- 3. Verify that the low pressure gauge reading is within 35 psi (2.4 bar), normal operating range.
- 4. Slowly increase operating pressure by adjusting the back pressure regulator valve knob in a clockwise direction until the product water flow reach the System production rate.
 - a) If the high pressure exceeds 975 psi (67.2 bar), an alarm will sound and shut down the System.
 - b) When the production flow rate is reached, the System will start monitoring the product water salinity.

Although the system is producing "Product Water", the Product Water may not be "Potable" for up to 30 minutes. The salinity of the Product Water diminishes gradually, until it reaches the acceptable level or lower.

PRODUCT SALINITY (RED) simply means that the dissolved solids in the Product Water have not yet decreased to acceptable level.

PRODUCT SALINITY (GREEN) simply means that the dissolved solids in the Product Water have reached the acceptable level and the Diversion Valve can be activated.

- c). If the tank is not full and the salinity of the product water drops below the preset salinity level, the U.V. sterilizer will energize if installed.
- d) If the salinity of the product water is below the preset salinity level for 5 seconds the

3-way Diversion Valve will energize sending the product water to the potable water outlet.

- Feed Pressure, Feed Flow, Operating Pressure, Brine Flow, Product Flow, and Product Salinity will be monitored and the System Control Logic will perform various tasks to maintain proper functioning of the System.
- f). When the tank is full, the System will stop all operations.
- 5. Check for:
 - a) A constant feed water flow.
 - b) A consistent system pressure.
 - c) Leaks in the system.
 - d) Abnormal noises or other occurrences.
- 6. If any abnormality develops, a warning/error screen will display.
 - a) Stop the System. correct the problem then repeat Step 1-5.
- 7. Proceed to Log System Readings.

B. MANUAL MODE

The Manual Mode is intended for SRC technicians for setup and configuration purposes.

NOTE: The Remote Touch Screen will be blocked during operation in the Manual Mode.

CAUTION: When the System is operated in the MANUAL Mode Safety features will still be controlled by the System Logic, however AUTOMATED features will not be controlled by the System Logic and must be controlled by the operator.

- 1. Verify the back pressure regulator valve knob is in fully open position.
- 2. From the default screen, touch the SETUP tab.
- 3. On the next screen, touch the Acceptable Salinity Level button.
- 4. On the Salinity Level screen, adjust to desired level (200 to 1000 PPM) then touch the SETUP button.
- 5. On the next screen, touch the Manual Mode button.
- 6. On the next screen, touch the Booster Pump START button then wait 5 seconds for booster pump to stabilize.

- 7. Touch the HP Pump START button.
- 8. Slowly increase operating pressure by adjusting the back pressure regulator valve knob in a clockwise direction until the product water flow reaches the System production rate.
 - a) If the high pressure exceeds 975 psi (67 bar), an alarm will sound and shut down the System.
 - b) When production rate is reached, the System will start monitoring the product water salinity.

Although the system is producing "Product Water", the Product Water may not be "Potable" for up to 30 minutes. The salinity of the Product Water diminishes gradually, until it reaches the acceptable level or lower.

PRODUCT SALINITY (RED) simply means that the dissolved solids in the Product Water have not yet decreased to acceptable level.

PRODUCT SALINITY (GREEN) simply means that the dissolved solids in the Product Water have reached the acceptable level and the Diversion Valve can be activated.

- 9. Activate the Diversion valve when Salinity meter turns Green.
 - a). If the tank is not full and the salinity of the product water drops below the preset salinity level, the U.V. sterilizer will energize if installed.
 - b) Feed Pressure, Feed Flow, Operating Pressure, Brine Flow, Product Flow, and Product Salinity will be monitored and the System Control Logic will perform various tasks to maintain proper functioning of the System.
 - c). When the tank is full, the System will stop all operations.
- 10. Check for:
 - a) A constant feed water flow.
 - b) A consistent system pressure.
 - c) Leaks in the system.
 - d) Abnormal noises or other occurrences.
- 11. If any abnormality develops, touch the STOP button on the Touch Screen. A warning screen will display.
 - a) Correct the problem then repeat Step 1-10.
- 12. Proceed to Log System Readings.

6.6.4 LOG SYSTEM READINGS

- 1. Record the System initial performance readings. Use the New System Initial Readings form on Page 6-8.
- 2. Proceed to Shutdown.

6.6.5 SHUTDOWN THE SYSTEM

A. SEMI-AUTOMATIC MODE

- 1. Rotate the Back Pressure Regulator counterclockwise to decrease operating pressure to 0 psi (0 bar).
- 2. From the default screen, touch the STOP button.
 - a) The 3-Way Product Water Diversion Valve will revert to unpotable water.
 - b) The UV Sterilizer will stop.
 - c) The High Pressure Pump will stop.
 - d) The Booster Pump will stop.
 - e) If the System does not include the Automatic Fresh Water Flush option, the Stop sequence is complete, or
 - f) If the System includes the Automatic Fresh Water Flush option, the Automatic Fresh Water Flush Valve will energize and after 7 to 15 minutes the Fresh Water Flush Valve will deenergize and the Stop sequence is complete.

The System will go to a Fresh Water Flush Stand-by mode until the next automatic Fresh Water Flush Cycle. The Fresh Water Flush Cycle will automatically initiate every preset number of days until canceled or power is disconnected from the System.

B. MANUAL MODE

- 1. Rotate the Back Pressure Regulator counterclockwise to decrease operating pressure to 0 psi (0 bar).
- 2. From the Manual Mode screen, touch the Diversion Valve button to de-activate the 3-way valve and de-energize the UV Sterilizer.
- 3. Touch the HP Pump STOP button.
- 4. Touch the Booster Pump STOP button.

If installed, the Automated Fresh Water Flush will NOT activate automatically. In order to perform a manual Fresh Water Flush follow the directions in Section 7.3:



BOAT SAFETY WARNING: The Inlet Thru-Hull Sea Cock Valve is in the Open position. It is recommended for the safety of the boat to close the Sea Cock Valve when ever the System is not in use. This will protect the boat from water flooding should a hose or component fail.

AUTOMATIC OPERATION WARNING:

If the Automatic Fresh Water Flush option is installed and if the System Control Logic has been set to perform Automatic Fresh Water Flushing, the Touch Screen will show the operator when this automatic cycle will be performed.

6.7 WARNINGS AND CAUTIONS

NEW SYSTEMS

A new System may take up to 30 minutes to purge the R.O. Membrane Element of the storage chemical and produce Potable Water. Even after the storage chemical is purged, although the system is producing "Product Water", the Product Water may not be "Potable" for up to 30 minutes. The salinity of the Product Water diminishes gradually, until it reaches the factory setting. When the Product Water is Potable and is diverted by the 3-way Product Water Diversion Valve [28] to the "Potable" (good water) position and into the Post Filtration components onward to the Ship's Storage Tank. At this point the UV Sterilizer will also illuminate.

RO MEMBRANE ELEMENT WARNING:



WARNING: PRIOR TO STOPPING THE SYSTEM REVIEW AND ADHERE TO THE FOLLOWING WARNINGS AND RESPECTIVE ACTIONS.



WARNING: The R.O. Membrane Elements must be kept wet at all times.

WARNING: The System must be protected from biological fouling if it will not be operated within the next 2 weeks.

FREEZING TEMPERATURE WARNING

The System must be protected from freezing if it will be exposed to temperatures below 32° Fahrenheit (0°

Celsius). Freezing temperatures (below 32° Fahrenheit or 0° Celsius) will cause extensive damage to the System as the water expands within the System during the freezing process. Resulting damage to the System caused by freezing temperatures is the liability of the operator.

DO NOT subject the System to temperatures below 32° Fahrenheit (0° Celsius) unless the System has been rinsed with a solution of product water with twenty percent food grade glycerin (propylene glycol).

LONG TERM STORAGE CAUTION

If the System will not be operated for an extended period of time, 3 months or longer, a Long Term Storage Procedure will be required.

If the Automatic Fresh Water Flush option is not installed or selected in the System Control Logic, pressing Stop will place the System into the Semi-automatic Shut Down mode. The operator will reduce the system pressure, the 3-Way Diversion Solenoid Valve will de-energize, the UV Sterilizer will de-energize, the High Pressure Pump will stop, and the Booster Pump will stop.

If the Automatic Fresh Water Flush option is installed, after the sequence listed above; the Fresh Water Flush Solenoid Valve will energize for 7 to 15 minutes, allowing fresh water from the boat's fresh water system to enter the System and flush it with fresh water.

After the Fresh Water Flush cycle has finished the Fresh Water Flush Solenoid Valve will de-energize and the System will go into a stand by mode. At the end of the preset number of days the Fresh Water Flush cycle will repeat.

This automatic cycle will stop if the power has been interrupted of if CANCEL has been Touched

R.O. MEMBRANE ELEMENT PROTECTION CAUTION:

SHORT STORAGE

If the System is not equipped with the Automatic Fresh Water Flush option perform a manual fresh water flush. Refer to the Short Term Storage Procedure in Section 7.

LONG TERM STORAGE

If the System will not be operated for an extended period of time, 3 months or longer, refer to the Long Term Storage Procedure in Section 7.

Sea Recovery Aqua Whisper

NEW SYSTEM INITIAL READINGS

At the time of commissioning the NEW system, record the following information after one hour of continuous proper operation of the system.

Retain this form in this Owner's Manual for the owner and operator's future reference. This information is valuable to the servicing technicians in providing technical support to the owner and future operators of the Aqua Whisper. Provide this information to service technicians when requesting technical assistance.

Date Installed:			Date C	ommission	ed:		
Model Information:							
System Serial Number:							
Style: Compact Ve							
R.O. Membrane/Vessel Assy Quantit	y:1 (d	one)	2	(two)			
System Capacity: 450 GPD					1400	GPD 1800) GPD
Who Installed the System:							
Company							
Street Address							
City, State							
Country, postal code					Telephone		
Name of Installer							
Who Commissioned the System:							
Company							_
							_
City, State							_
Country, postal code					Telephone		
Name of Installer							-
System Power: Volts	AC	Hz		Pha	se		
Feed Water Temperature:	_ Fahrenhe	it or		Celsius			
Hour Meter Reading:	Hours						
PRESSURE READINGS:							
Low Pressure Transducer #1	psi	or		kPa			
Pressure Differential Pressure		psi	or		kPa		
Low Pressure Transducer #2	psi	or		kPa			
High Pressure Transducer	psi	or		kPa			
WATER FLOW METER READINGS:							
Flow Meter Product Water:	US Ga	llons Per	Hour	or		Liters Per Hour	
Flow Meter Brine Discharge:	US Ga	llons Per	Minute	or		Liters Per Minute	
WATER QUALITY:							
Feed Water Salinity: p	opm or	Locatior	n of use:				
Product Water Salinity:	ppr	n					
Problems, Unusual Occurrences, or							

Aqua Whisper DX Modular 450-1800 Section 7 - OPERATION

Operation

7 OPERATION

IMPORTANT Notes regarding the Automated operational sequence:

NOTE: During operation, touching STOP at any time immediately stops all functions of the System. Touch STOP ONLY in case of an emergency such as human safety concern, substantial water leak, electrical safety issue, etc.

SEMI-AUTOMATIC SEQUENCE

Be prepared for the following automatic sequence. After the System has been started the following will occur:

- 1. Booster Pump electric motor will start and a screen will indicate that it has started.
- 2. Low Pressure Transducers will signal the System Control Logic which will look for adequate feed water pressure from the Booster Pump.
- 3. After a 20 second delay timer, the High Pressure Pump electric motor will start and a screen will indicate that it has started.
- 4. Feed Water Flow Meter will signal the System Control Logic which will look for adequate feed water flow through the System.
- 5. Gradually close the Back Pressure Regulator by rotating clockwise to build up operating pressure until specified product water flow rate is accomplished.
- 6. Product Water Flow Meter will register product water flow, as operating pressure exceeds the osmotic pressure of the feed water. Product Water Flow will take priority to inform the control logic to increase or decrease operating pressure in order to maintain the product water flow specification.
- 7. The 3-Way Product Water Diversion Valve will energize sending the Product Water to the Post Filtration section and the UV Sterilizer will energize if installed. This may take up to 30 minutes.
- 8. Feed Pressure, Feed Flow, Operating Pressure, Brine Flow, Product Flow, and Product Salinity are all being monitored and the values of these readings cause the System Control Logic to perform various tasks to maintain proper functioning of the System.

- 9. The System may be manually stopped, or it may be programmed to stop at a given time or given volume of Product Water production.
- 10. If the STOP is touched the System will immediately stop all functions.
 - a). Manually rotate the Back Pressure Regulator counter-clockwise to full open position.
- 11. When the System is signaled to perform a nonemergency stop:
 - a) The 3-Way Product Water Diversion Valve will revert to unpotable water.
 - b) The UV Sterilizer will stop.
 - c) The High Pressure Pump will stop.
 - d) The Booster Pump will stop.
 - e) Manually rotate the Back Pressure Regulator counter-clockwise to full open position.
 - f) If the System does not include the Automatic Fresh Water Flush option this ends the stop sequence.

OR

g) If the System includes the Automatic Fresh Water Flush the Automatic Fresh Water Flush Valve will energize to Fresh Water.

After 7 to 15 minutes the Fresh Water Flush Valve will de-energize and the Stop sequence is complete.

NOTE: The Back Pressure Regulator Valve should be manually opened all the way to prevent flow restriction during Fresh Water Flush.

12. The System will go to a Fresh Water Flush Standby mode and count down until the next automatic Fresh Water Flush Cycle. The Fresh Water Flush Cycle will automatically initiate every set number of days until canceled or power is disconnected from the System.

SYSTEM WARNINGS

PRIOR TO OPERATION AND DURING NON-OPERATION OF THE SYSTEM, REVIEW AND ADHERE TO THE FOLLOWING WARNINGS AND RESPECTIVE ACTIONS.



WARNING: The R.O. Membrane Elements must be kept wet at all times.

WARNING: The System must be protected from biological fouling if it will not be operated within the next 2 weeks.

FREEZING TEMPERATURE WARNING:

The System must be protected from freezing if it will be exposed to temperatures below 32° Fahrenheit (0° Celsius). Freezing temperatures, below 32° Fahrenheit (0° Celsius), will cause extensive damage to the System as the water expands within the System during the freezing process. Resulting damage to the System caused by freezing temperatures is attributed to improper operator care and protection, is the liability of the operator, and is not covered by the Sea Recovery warranty.

DO NOT subject the System to temperatures below 32° Fahrenheit (0° Celsius) unless the System has been rinsed with a solution of product water with 20% food grade glycerin (propylene glycol) as described in Section 7.4.

LONG TERM STORAGE CAUTION:

If the System will not be operated for an extended period of time, 3 months or longer, a Long Term Storage Procedure must be performed.

If the Automatic Fresh Water Flush option is not installed and is not selected in the System Control Logic, pressing Stop will place the System into the Automatic Shut Down mode. The pressure will be reduced, the High Pressure Pump will stop, and the Booster Pump will stop.

If the Automatic Fresh Water Flush option is installed, after the Booster Pump stops the Fresh Water Flush Valve will energize for 7 to 15 minutes allowing fresh water to flush the System.

SHORT TERM STORAGE:

If the Automatic Fresh Water Flush option is installed, after the System has stopped operating, the Fresh Water Flush Solenoid Valve will energize and flush the System with fresh water for 7 to 15 minutes.

Deration

WARNING: There must be sufficient Fresh Water in the Potable Water Storage Tank and the Pressure System (Pressure Pump and Air Entrainment Tank) if used must be pressurized to minimum 25 PSI (172 BAR). The Fresh Water System Piping must be capable of delivering minimum 1 U.S. Gallons (3.8 Liters) Per Minute at 25 PSI (172kPa) during the Fresh Water Flush cycle. After the Fresh Water Flush cycle has finished the Fresh Water Flush Solenoid Valve will de-energize and the System will go into a stand by mode and repeat after preset number of days. This Automated Fresh Water Flush cycle will protect the System and R.O. membrane element for short term shut downs.

This automatic cycle will stop if the power has been interrupted or if CANCEL has been Touched

R.O. MEMBRANE ELEMENT PROTECTION CAUTION:

SHORT STORAGE: If the System is not equipped with the Automatic Fresh Water Flush option, perform a manual fresh water flush. Refer to Section 7.3 for Short Term Storage Procedures.

LONG TERM STORAGE: If the System will not be operated for an extended period of time, 3 months or longer, refer to Section 7.4 for Long Term Storage Procedures.

7.1 DAILY OPERATION

7.1.1 POSITION VALVES

VALVE	POSITION
Inlet Sea Cock Valve	FULL OPEN
Rinse Clean Inlet Valve	FROM SEA STRAINER TO
	FRESH WATER FLUSH VALVE
Rinse Clean Outlet Valve	FROM BRINE DISCHARGE
	OF SYSTEM TO THRU HULL
	DISCHARGE FITTING
Multi Media Filter Valves	NORMAL OPERATION
Back Pressure Regulator	FULL OPEN
ANY auxiliary valve in the	FULL OPEN
Feed Line, Brine Discharge	
Line, or Product Water Line	

WARNING: If any auxiliary valve is installed in these lines, it will damage the System if left closed during starting and/ or operation of the system. The resulting damage to the system is attributed to improper installation, is the liability of the operator, and is not covered by the Sea Recovery warranty.

7.1.2 APPLY POWER TO THE SYSTEM

1. Switch the Electrical Power Source, boat or home's circuit breaker to the system "ON".

All Operating Screens WILL NOT include the Automatic Fresh Water Flush components if the Fresh Water Flush Option is not installed and the control logic has been informed that the Fresh Water Flush Option is not installed.

2. After the control logic has initiated itself, the default screen will appear indicating that the System is ready to Start

7.1.3 START THE SYSTEM

A. SEMI-AUTOMATIC MODE

The Semi-Automatic Mode is recommended for users and owners. These instructions are recommended when the System is configured with a Tank High Level sensor.

- 1. Verify the back pressure regulator valve knob is in full open position.
- 2. Press the Start button on the Main Control Panel or Remote Control Panel.
 - a) The System starts monitoring the Tank level, system pressures, and system water flow.
 - b The System starts the booster pump.
 - c) When the inlet pressure of the high pressure pump is within 35 psi (2.4 bar) for 20 seconds, the System starts the high pressure pump.
- 3. Verify that the low pressure gauge reading is within 35 psi (2.4 bar), normal operating range.
- 4. Slowly increase operating pressure by adjusting the back pressure regulator valve knob in a clockwise direction until the product water flow reach the System production rate.
 - a) If the high pressure exceeds 975 psi (67.2 bar), an alarm will sound and shut down the System. Manually adjust the back pressure regulator to 0 psi (0 bar).
 - b) When the production flow rate is reached, the System will start monitoring the product water salinity.

Although the system is producing "Product Water", the Product Water may not be "Potable" for up to 30 minutes. The salinity of the Product Water diminishes gradually, until it reaches the acceptable level or lower. PRODUCT SALINITY (RED) simply means that the dissolved solids in the Product Water have not yet decreased to acceptable level.

PRODUCT SALINITY (GREEN) simply means that the dissolved solids in the Product Water have reached the acceptable level and the Diversion Valve can be activated.

- c) If the tank is not full and the salinity of the product water drops below the preset salinity level, the U.V. sterilizer will energize if installed.
- d) If the salinity of the product water is below the preset salinity level for 5 seconds the 3-way Diversion Valve will energize sending the product water to the potable water outlet.
- e) Feed Pressure, Feed Flow, Operating Pressure, Brine Flow, Product Flow, and Product Salinity will be monitored and the System Control Logic will perform various tasks to maintain proper functioning of the System.
- f) When the tank is full, the System will stop all operations.
- 5. Check for:
 - a) A constant feed water flow.
 - b) A consistent system pressure.
 - c) Leaks in the system.
 - d) Abnormal noises or other occurrences.
- 6. If any abnormality develops, a warning/error screen will display.
 - a) Stop the System. correct the problem then repeat Step 1-5.
- 7. Proceed to Log System Readings.

B. MANUAL MODE

The Manual Mode is intended for SRC technicians for setup and configuration purposes.



NOTE: The Remote Touch Screen will be blocked during operation in the Manual Mode.

CAUTION: When the System is operated in the MANUAL Mode Safety features will still be controlled by the System Logic, however AUTOMATED features will not be controlled by the System Logic and must be controlled by the operator.

- 1. Verify the back pressure regulator valve knob is in fully open position.
- 2. From the default screen, touch the SETUP tab.
- 3. On the next screen, touch the Acceptable Salinity Level button.
- 4. On the Salinity Level screen, adjust to desired level (200 to 1000 PPM) then touch the SETUP button.
- 5. On the next screen, touch the Manual Mode button.
- On the next screen, touch the Booster Pump START button then wait 5 seconds for booster pump to stabilize.
- 7. Touch the HP Pump START button.
- 8. Slowly increase operating pressure by adjusting the back pressure regulator valve knob in a clockwise direction until the product water flow reaches the System production rate.
 - a) If the high pressure exceeds 975 psi (67 bar), an alarm will sound and shut down the System. Manually adjust the back pressure regulator to 0 psi (0 bar).
 - b) When production rate is reached, the System will start monitoring the product water salinity.

Although the system is producing "Product Water", the Product Water may not be "Potable" for up to 30 minutes. The salinity of the Product Water diminishes gradually, until it reaches the acceptable level or lower.

PRODUCT SALINITY (RED) simply means that the dissolved solids in the Product Water have not yet decreased to acceptable level.

PRODUCT SALINITY (GREEN) simply means that the dissolved solids in the Product Water have reached the acceptable level and the Diversion Valve can be activated.

- Activate the Diversion valve when Salinity meter turns Green.
 - a). If the tank is not full and the salinity of the product water drops below the preset salinity level, the U.V. sterilizer will energize if installed.
 - b) Feed Pressure, Feed Flow, Operating Pressure, Brine Flow, Product Flow, and Product Salinity will be monitored and the System Control Logic will perform various tasks to maintain proper functioning of the System.
 - c). When the tank is full, the System will stop all operations.

- 10. Check for:
 - a) A constant feed water flow.
 - b) A consistent system pressure.
 - c) Leaks in the system.
 - d) Abnormal noises or other occurrences.
- 11. If any abnormality develops, touch the STOP button on the Touch Screen. A warning screen will display.
 - a) Correct the problem then repeat Step 1-10.
- 12. Proceed to Log System Readings.

7.1.5 LOG SYSTEM READINGS

- 1. Record the System initial performance readings. Use the New System Initial Readings form on Page 6-8.
- 2. Proceed to Shutdown.

7.1.6 SHUTDOWN THE SYSTEM

A. SEMI-AUTOMATIC MODE

- 1. Rotate the Back Pressure Regulator counterclockwise to decrease operating pressure to 0 psi (0 bar).
- 2. From the default screen, touch the STOP button.
 - a) The 3-Way Product Water Diversion Valve will revert to unpotable water.
 - b) The UV Sterilizer will stop.
 - c) The High Pressure Pump will stop.
 - d) The Booster Pump will stop.
 - e) If the System does not include the Automatic Fresh Water Flush option, the Stop sequence is complete, or
 - f) If the System includes the Automatic Fresh Water Flush option, the Automatic Fresh Water Flush Valve will energize and after 7 to 15 minutes the Fresh Water Flush Valve will deenergize and the Stop sequence is complete.

The System will go to a Fresh Water Flush Stand-by mode until the next automatic Fresh Water Flush Cycle. The Fresh Water Flush Cycle will automatically initiate every preset number of days until canceled or power is disconnected from the System.

9.

B. MANUAL MODE

- 1. Rotate the Back Pressure Regulator counterclockwise to decrease operating pressure to 0 psi (0 bar).
- 2. From the Manual Mode screen, touch the Diversion Valve button to de-activate the 3-way valve and de-energize the UV Sterilizer.
- 3. Touch the HP Pump STOP button.
- 4. Touch the Booster Pump STOP button.

If installed, the Automated Fresh Water Flush will NOT activate automatically. In order to perform a manual Fresh Water Flush follow the directions in Section 7.3:

BOAT SAFETY WARNING: The Inlet Thru-Hull Sea Cock Valve is in the Open position. It is recommended for the safety of the boat to close the Sea Cock Valve when ever the System is not in use. This will protect the boat from water flooding should a hose or component fail.

AUTOMATIC OPERATION WARNING:

If the Automatic Fresh Water Flush option is installed and if the System Control Logic has been set to perform Automatic Fresh Water Flushing, the Touch Screen will show the operator when this automatic cycle will be performed.

7.2 SYSTEM STORAGE AND CLEANING

R.O. MEMBRANE ELEMENT HANDLING AND SYSTEM STORAGE CAUTIONS:

TEMPERATURE: Never store the R.O. membrane element or Membrane/Vessel Assembly in direct sunlight. Never expose the R.O. membrane element or Membrane/Vessel Assembly to storage temperatures above 120° F (50° C) or below 32° F (0° C). High temperatures cause up to 40% loss of production from the R.O. membrane element. This damage is irreversible. Freezing temperatures cause mechanical damage to the system and irreversible damage to the R.O. membrane element.

DRYING OUT: Never allow the R.O. membrane element to dry out, as 40% production loss occurs. This membrane damage may be irreversible. Some, but not all, production may be restored by saturating the R.O. membrane element in product water for several days and then operating the system using product water feed into the system for a continuous 48 hour period. The R.O. membrane element must remain wet at all times.

BIOLOGICAL FOULING: Protect the R.O. membrane element from biological fouling. Production loss occurs if the element becomes fouled by biological slimes. Some, but not all, production may be restored after cleaning.

CHEMICAL FOULING: Never expose the R.O. membrane Element to chemicals other than those supplied by SRC. Use caution when operating the system in harbors that may be polluted with chemicals, oil, or fuel. Chemicals may damage the R.O. membrane element beyond repair.

WARNING: NEVER USE THIRD PARTY CHEMICALS, ONLY USE SEA RECOVERY SUPPLIED CHEMICALS. Third party chemicals are not compatible with various materials used in the Sea Recovery System. Copolymer parts within the Sea Recovery System will be dissolved by third party chemicals. Third party chemicals will destroy the Sea Recovery R.O. membrane element. Damage to the Sea Recovery System or components within the System are not covered by the Sea Recovery Warranty.

STORAGE: The dark and moist interior of a membrane element is an excellent breeding ground for microorganisms. Simply operating the system does not protect the R.O. membrane element from production loss due to biological fouling. During short-term shutdowns, the system must be rinsed as explained in the following pages. During long-term shutdowns, the system must be rinsed as well as chemically treated.

NEW SYSTEM STORAGE: If the R.O. membrane elements are installed in the System and if the System will not be installed and commissioned within a 3 months from receipt refer to the procedures for either Short Term or Long Term storage.

Illustrations on Page 7-7 - figure 7a, show the flow of water in a Once-Through-Rinse operation and in a Closed Loop operation. These illustrations may be referred to during the Rinse, Clean, and Storage procedures.

The illustration on Page 7-8 - figure 7c demonstrates a simplified Once Through Configuration

This is used to Rinse the System with Fresh Water, to Winterize the System, and also to Discharge the contents of the cleaning solution bucket. When the instructions within this section state "configure for Once Through Rinse" refer to page 7-7, figure 7a and proceed as follows:

- Configure the Suction line for a Once Through Configuration as illustrated on Page 7-7. Disconnect the outlet line from the Sea Strainer and place it in the Rinse/Clean Bucket or Container. Or if the system is equipped with the optional Rinse Clean Inlet Valve then position this valve to draw from the Rinse/Clean Bucket or Container. also
- 2. Configure the Brine Discharge line for a Once Through Configuration as illustrated on Page 7-7, Fig. 7a). Connect the Brine Discharge Line from the system to the Thru-Hull over board discharge fitting, normal connection for normal operation. Or if the system is equipped with the optional Rinse Clean Outlet Valve then position this valve to discharge through the Thru-Hull fitting, normal connection for normal operation.

When the instructions within this section state "configure for Closed Loop"refer to page 7-7, figure 7b and proceed as follows::

 Configure the Suction line for a Closed Loop Configuration as illustrated on (fig. 7b). Disconnect the outlet line from the Sea Strainer and place it in the Rinse/Clean Bucket or Container. Or if the system is equipped with the optional Rinse Clean Inlet Valve then position this valve to draw from the Rinse/Clean Bucket or Container.

also

2. Configure the Brine Discharge line for a Closed Loop Configuration (fig. 7b). Disconnect the Brine Discharge Line from the Thru-Hull over board discharge fitting and place it in the Rinse/Clean Bucket or Container. Or if the system is equipped with the optional Rinse Clean Outlet Valve then position this valve to return to the Rinse/Clean Bucket or Container.

7.3 SHORT-TERM SHUTDOWN

A short-term shutdown is defined as a period of time in which the system is not utilized for up to four weeks. An effective short-term protection for the system and R.O. membrane element is a Fresh Water Rinse of the entire system with fresh water (product water from the system). This prolongs the system life by minimizing electrolysis and retarding biological growth.



WARNING - WINTERIZING AND

FREEZING TEMPERATURE STORAGE: If the system is exposed to freezing temperatures, DO NOT activate the Automatic Fresh Water Flush. Instead, perform a Manual Fresh Water Rinse below.

MANUAL FRESH WATER RINSE PROCEDURE

Follow the directions below if the system is not equipped with an Automatic Fresh Water Flush option, or if the System is to be Winterized against freezing temperatures. This procedure displaces the system feed water with fresh water and allows a short-term shutdown for up to four weeks, and adds propylene glycol if Winterizing. Ten gallons (38 liters) of fresh product or potable water is required for the fresh water rinse, and 2 gallons (7.5 liters) food grade glycerin (propylene glycol) is required for Winterizing.

- 1. Close the Inlet Sea Cock Valve.
- 2. Fill a 10-gallon container with clean, fresh water.
 - WARNING: IF THE SYSTEM WILL BE EXPOSED TO FREEZING TEMPERATURES add 20% (2 gallons or 7.5 liters) food grade glycerin (propylene glycol) to 10 gallons (37.8 liters) of potable water in the Bucket. This prevents the water in the system from freezing.
- 3. Configure the system for a Once Through Rinse (Page 7-7, fig 7a).
- 4. Start the System in the MANUAL MODE
- Operation of the System will deplete the Fresh Water or Water and Propylene Glycol mixture in the bucket. Just prior to depleting the Water or mixture in the Bucket Stop the System.
- 5. Proceed to Section 7.5.

7.4 LONG TERM SHUTDOWN

A Long Term or Prolonged Shutdown is a period in which the system goes unused for longer than three months, depending on conditions.

For this interval, the system should first be rinsed with fresh water then stored with system and Membrane Element Storage Chemical (SRC SC). This chemical inhibits bacterial growth while maintaining the high flux and salt rejection of the R.O. membrane element.





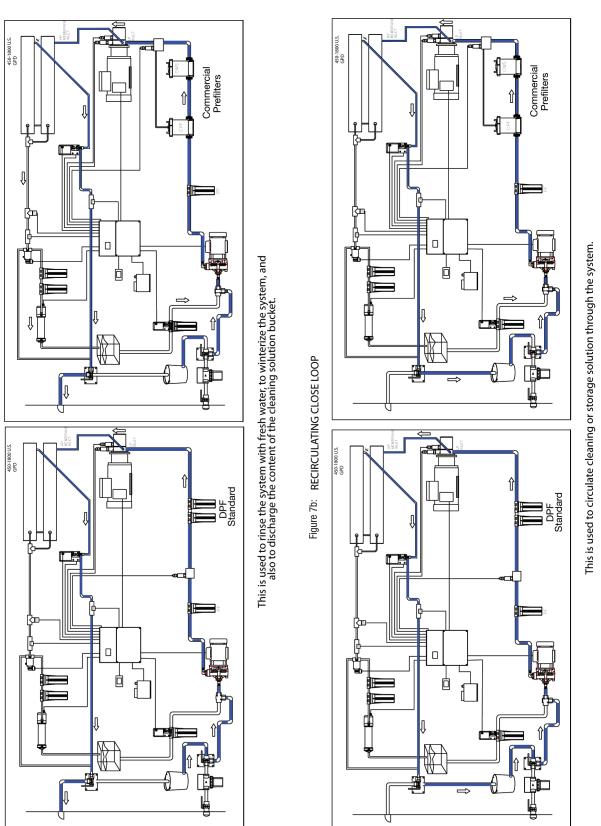


Figure 7a: ONCE THROUGH RINSE


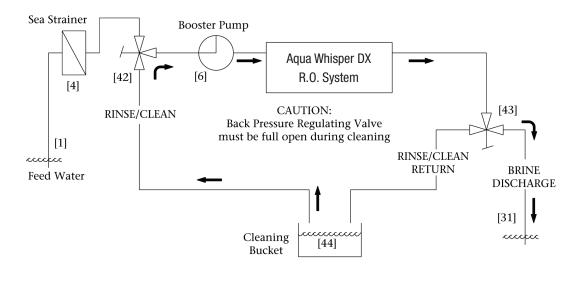


Figure 7c: Simplified Aqua Whisper DX Once Through Rinse

Figure 7d: Simplified Aqua Whisper DX Re-Circulating Loop

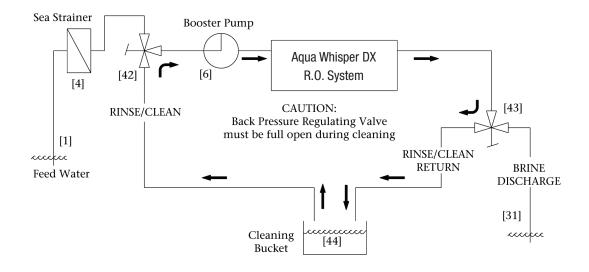

ITEMS REQUIRED

- a) 20 gallons (75.7 liters) of potable water.
- b) Sea Recovery Storage Chemical SRC SC
- c) 2 Gallons (7.5 liters) of food grade glycerin (propylene glycol) if the System will be Winterized

NOTE: If the system is equipped with an automatic Fresh Water Flush Accessory then it is not necessary to read this section as long as the Automatic Fresh Water Flush cycle remains active. The Automatic Fresh Water Flush option rinses the system every preset number of days automatically. However, see "Winterizing and Freezing" note below.

NOTE - WINTERIZING AND FREEZING TEMPERATURE STORAGE: If the system is exposed to freezing temperatures, DO NOT activate the Automatic Fresh Water Flush. Instead, perform a Manual Fresh Water Rinse as described below.

Follow the directions below if the system will not be used for several months or if the system is not equipped with an Automatic Fresh Water Flush option, or if the System is to be Winterized against freezing temperatures. This procedure displaces the system feed water with Storage Chemical or Storage Chemical and propylene glycol.

LONG TERM SHUTDOWN PROCEDURE

- 1. Close the Inlet Sea Cock Valve.
- 2. Fill a 10-gallon (37.8 liters) container with clean, potable water.
- 3. Configure the system for a Once Through Rinse (Page 7-7, figure 7a).
- Start the System in the MANUAL MODE
 Operation of the System will deplete the Fresh Water in the bucket. Just prior to depleting the Water in the Bucket Touch STOP.
- 5. Once again, fill a 10-gallon (37.8 liters) container with 10 gallons (37.8 liters) clean, potable water.
- 6. Add to the Fresh Water in the bucket or Fresh Water and Propylene glycol, 4 ounces of Sea Recovery Storage Chemical SRC SC.
- 7. Configure the system for a Recirculating Closed Loop configuration as illustrated on Page 7-7.

- Start the System in the MANUAL MODE
 Operate the System in the Recirculating Closed
 Loop configuration for 10 minutes. After 10 minutes stop the system:
- 9. Proceed to Section 7.5.

7.5 WINTERIZING PROCEDURE

If the System will be exposed to freezing temperatures the Post Filtration Section of the System must be drained of all Product Water.

- a) Charcoal Filter
 - 1) Remove the Charcoal Filter bowl.
 - 2) Remove the water from the bowl.
 - 3) Replace the Charcoal Filter Element with a New Charcoal Filter Element.
 - 4) Replace the bowl back onto the lid.
- b) pH Neutralizing Filter
 - 1) Remove the pH Neutralizing bowl.
 - 2) Remove the water from the bowl.
 - 3) Replace the bowl and pH element back onto the lid.
- c) UV Sterilizer
 - 1) Disconnect the product water line from the UV Sterilizer filter and drain the product water from it.
- 1. Switch the Power to the System OFF.
- 2. Lock and Tag the Power Breaker to ensure that no one will accidentally operate the System and displace the Winterizing Mixture with Feed or Fresh Water.
- 3. Discard the Storage Chemical in an environmentally safe manner.

7.6 R.O. MEMBRANE CLEANING

Do not arbitrarily clean the R.O. membrane in a NEW system. The R.O. membrane element in a NEW System will not be fouled with any substance that is cleanable. Low production or high salinity of the Product water from a NEW System will be attributed to factors other than fouling.

If a NEW system experiences low production this would indicate that there is a blockage in the Product Water Line, the feed water temperature is low, the operating pressure is low, or the R.O. membrane element has dried out prior to use. A NEW System experiencing low production should be operated for up to 48 hours continuously to clear and saturate the R.O. membrane element and product water channel. Correlate and compensate operating pressure, feed water temperature, and feed water salinity as charted in the Section 2.

If a NEW System still experiences low production after 48 hours of continual operation, then contact the factory. If a NEW System experiences poor quality Product Water, high in salinity, this would be attributed to a mechanical failure such as a broken or missing O-ring and will be accompanied with high production at low operating pressure. For problems with a NEW System refer to the Troubleshooting section.

The membrane element requires cleaning from time to time. Biological growth and salt accumulation eventually make replacement necessary. The frequency of required cleaning depends on the amount of production loss and salt rejection loss resulting from normal use. In order to properly assess performance changes, it is important to maintain daily log readings for comparison.

During performance comparisons, Feed Water Temp, Feed Water Salinity, and System Operating Pressure must be taken into consideration and compensated for. After compensations, a 10% decline in productivity (GPH Flow) and/or a 10% increase in salt passage indicate that the R.O. membrane element may require cleaning.

If production rate has dropped dramatically since the last time the system was used, this may be due to drying out of the R.O. membrane element and/or fouling during storage. If the system has not been used for several months and the production rate has dropped dramatically since the last time used, try operating the system for 48 or more continuous hours to saturate the Product Water Channel within the R.O. membrane element.

If production rate drops dramatically from one day to another, this may be due to chemical attack which is not cleanable. Sewage chemicals or petroleum products cause irreparable damage to the R.O. membrane element. Suspended solids fouling resulting from silt, coral dust, iron (rust), river or inland waterway debris, or other small solid matter may not be cleanable.

R.O. WATER AND CHEMICAL REQUIREMENTS

1. The system must be rinsed with fresh water before any cleaning procedure, cleaned, and then rinsed again.

- The process of rinsing and cleaning the R.O. membrane elements with just one cleaning compound requires 30 gallons (113.5 liters) of fresh non- chlorinated product water. If a second cleaning is performed using a different cleaning compound an additional 20 gallons (75.7 liters) will be required per additional cleaning.
- 3. The Sea Recovery Reverse Osmosis cleaning compounds are designed to clean in a closed loop configuration moderate fouling from the R.O. membrane element. If the R.O. membrane element is excessively fouled and in-field cleaning is not successful, the R.O. membrane element may be returned to Sea Recovery or to one of Sea Recovery's many Service Dealers for professional chemical cleaning. If your membrane requires professional cleaning, please contact Sea Recovery for a Return Authorization Number, price quotation, and return instructions. Due to the complexity of and time involvement in professionally cleaning the R.O. membrane element it can be more cost effective to replace a heavily fouled R.O. membrane element. Always compare the cost of cleaning vs the cost of replacement in order to make the proper decision to clean or replace.
- 4. SRC MCC-1, Membrane Cleaning Compound "#1" is an alkaline cleaner designed to clean biological fouling and slight oil fouling from the R.O. membrane element. Biological fouling is usually the first cause of the R.O. membrane element fouling. The system is constantly exposed to seawater and biological growth occurs from the first day forward. If exposed to seawater and left to sit, the R.O. membrane element becomes fouled even with no actual system use. This fouling is minimized with fresh water rinsing whenever the system is not in use.
- 5. SRC MCC-2, Membrane Cleaning Compound "#2" is an acid cleaner designed to clean calcium carbonate and other mineral deposits from the R.O. membrane element. Mineral fouling is a slow process which takes place during use of the system. Therefore, if the system has relatively few hours of use yet shows signs of R.O. membrane element fouling then that fouling is likely biological fouling. If the system has several thousand hours of use then there may be some mineral fouling combined with biological fouling.

6. SRC MCC-3, Membrane Cleaning Compound "#3" is used for iron fouling. It is not included in the SRC Membrane Cleaning Chemical kit. If the system's R.O. membrane element is fouled with rust from iron piping, then SRC CC-3 may be used for effective removal of light or moderate rust fouling. Heavily rust fouled RO membranes may not be recoverable as rust not only fouls the Membrane Element but also damages the membrane surface.

WARNING: DO NOT mix different chemicals together. DO NOT use different cleaning chemicals together at the same time. Mix the cleaning chemicals separately and use them separately. Use only Sea Recovery supplied chemicals. NEVER use third party non-Sea Recovery chemicals.

CLEANING PROCEDURE

Product Water Required, in U.S. Gallons for Cleaning of the R.O. membrane element:

Chemical	Rinse water required	Cleaning water required	Second rinse water required	Total water required
CC-1	10	10	10	30
CC-2		10	10	20
CC-3		10	10	20

- 1. Close the Inlet Sea Cock Valve.
- If installed, position the Multi Media Filter Valves in the Multi Media Filter By-Pass position to by-pass it during the cleaning procedures See illustration on page 7-12 for Multi Media Filter Valve positioning.
- 3. Replace the Pre-filtration Cartridge with a new SRC supplied Pre-filtration Element.
- 4. Fill a 10-gallon (37.8 liters) container with unchlorinated clean fresh water.
- 5. Configure the system for a Once Through Rinse as illustrated on Page 7-7.
- Start the System in the MANUAL MODE
 Operation of the System will deplete the Fresh Water in the bucket. Just prior to depleting the

Water in the Bucket Touch STOP.

- 7. Once again, fill the container with 10 gallons (37.8 liters) clean, fresh water.
- Add to the 10 gallons (37.8 liters) of fresh water 1.5 lbs. (0.68 kg) of Sea Recovery Membrane Cleaning Compound MCC 1, MCC 2 or MCC 3. Thoroughly mix the solution until the cleaning compound has dissolved.
- 9. Configure the system for a Recirculating Closed Loop configuration as illustrated on Page 7-7.
- 10. Start the System in the MANUAL MODE
- 11. Operate the System in the Recirculating Closed Loop configuration for 60 minutes. After 60 minutes stop the system as follows:
- 12. Configure the system for a Once Through Rinse configuration as illustrated on Page 7-7.
- 13. Start the System in the MANUAL MODE to discharge the cleaning chemical to waste.

Operation of the System will deplete the cleaning solution in the bucket. Just prior to depleting the solution in the Bucket stop the System.

- 14. One final time, fill the container with 10 gallons (37.8 liters) clean, fresh water.
- 15. Configure the system for a Recirculating Closed Loop configuration as illustrated on Page 7-7.
- 16. Start the System in the MANUAL MODE

Operate the System in the Recirculating Closed Loop configuration for 10 minutes. After 10 minutes stop the system as follows:

- 17. Configure the system for a Once Through Rinse configuration as illustrated on Page 7-7.
- 18. Start the System in the MANUAL MODE to discharge the rinse water to waste.


Operation of the System will deplete the cleaning solution in the bucket. Just prior to depleting the solution in the Bucket Stop the System as follows:

The system is now ready for additional cleaning, use, or storing.

If further membrane cleaning is necessary, repeat Steps 4 to 18 above for each additional cleaning.

19. If System will be expose to freezing temperature, proceed to Section 7.5:

VALVE POSITIONING OF THE MULTI MEDIA FILTER DURING 4 SEPARATE MODES OF OPERATION

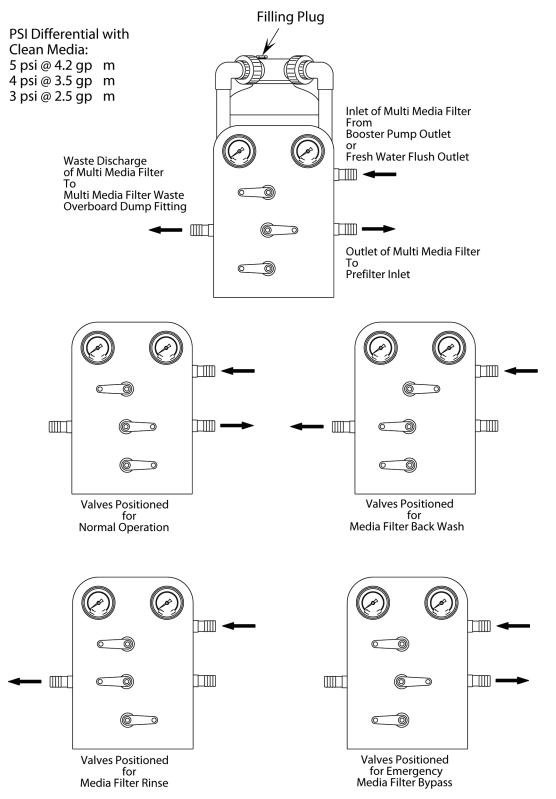

Sea Recovery Aqua Whisper

DAILY SYSTEM READINGS

Make Copies of this form and fill one in each time the System is operated. Record the following information after one hour of
continuous proper operation of the system, or just prior to stopping the System.
Retain these forms in this Owner's Manual for future reference. This information is valuable to the servicing technicians in providing
technical support of the Aqua Whisper. Provide this information to service technicians when requesting technical assistance.
Date Installed: Date Commissioned:
Model Information:
System Serial Number: Style: Compact Modular
Style: Compact Modular
R.O. Membrane/Vessel Assy Quantity: 1 (one) 2 (two)
System Capacity: 450 GPD 700 GPD 900 GPD 1400 GPD 1800 GPD System Power: Volte AC Hz Phase
System Power: Volts AC Hz Phase Feed Water Temperature: degrees Fahrenheit or degrees Celsius
Hour Meter Reading: Hours
PRESSURE READINGS:
Low Pressure Transducer #1 psi or kPa
Pressure Differential Pressure psi or kPa
Low Pressure Transducer #2 psi or kPa
High Pressure Transducer psi or kPa
WATER FLOW METER READINGS:
Flow Meter Product Water: US Gallons Per Hour or Liters Per Hour
Flow Meter Brine Discharge: US Gallons Per Minute or Liters Per Minute
WATER QUALITY:
Feed Water Salinity: ppm or Location of use:
Product Water Salinity: ppm
Problems, Unusual Occurrences, or Unusual Noises:

Operation

Aqua Whisper DX Compact 450-1800 Section 8 - MAINTENANCE AND REPAIR

Maintenance

8 MAINTENANCE AND REPAIR

From time to time, Sea Recovery may make programming changes to the Control Logic.

Other production changes are tracked by Sea Recovery through the System Serial Number.

Troubleshooting methods and results can vary depending on the information that is displayed at the SYSTEM INFORMATION screen.

When ever requesting assistance from Sea Recovery or one of Sea Recovery's service dealers,

ALWAYS PROVIDE ALL INFORMATION DISPLAYED AT THE SYSTEM INFORMATION SCREEN.

- SERIAL NUMBER helps us to determine the latest physical version and configuration of your system which is necessary to ensure that we provide you with the correct information or parts.
- TYPE tells us the production capacity of your system which gives us a bench mark in diagnosing product water flow and pressure concerns.
- TIME RUNNING assists us in diagnosing abnormalities that can occur at given operational time intervals such as required pump maintenance, or R.O. membrane element condition.
- VERSION allows us to determine the sequential operation of the system based on the version of the programmed control logic.

AND Always provide us with the System Operating Voltage, Cycles, and Phase.

QUALIFICATIONS

Technicians must have technical knowledge and ability in the following fields:

- a) Electrical, Electronic, Electric Motors and Circuits
- b) Electromechanical and Mechanical Systems
- c) Hydraulic and Liquid Pressure and Flow Systems
- d) Piping and Plumbing Systems
- e) Water Suction and Pressure Lines
- f) Thru-Hull Fitting below and above water level

DO NOT PERFORM MAINTENANCE UNLESS:

- 1. The System Feed Water Sea Cock Valve is closed.
- 2. The system main electrical disconnect switch is switched "OFF", LOCKED, and TAGGED.
- 3. Section 10, Exploded Parts View is available.



WARNING - ELECTRICAL SHOCK HAZARD: A Volt / Ohm Meter will be necessary. The following installation procedures expose the installer to High Voltage and electrical shock hazard. Only attempt this if you are a qualified electrician and only if surrounding conditions are safe.

REVERSE OSMOSIS MEMBRANE ELEMENT SUSCEPTIBILITY TO CHEMICAL ATTACK:



CAUTION: Do not expose the Sea Recovery System to these chemicals:

Hydrogen peroxide	chloramines-T	
Chlorine dioxide	chlorine	
Bromine	phenolic disinfectants	
chloramines	N-chlorioisocyanurates	
hypochlorite	iodine	
Bromide	petroleum products	

or any other specific chemical not approved in writing by Sea Recovery Corp. Use of non authorized or misuse of authorized chemicals voids warranty. Never use third party so called "Reverse Osmosis Chemicals" for storage or cleaning. Third Party chemicals will dissolve copolymer components within the Sea Recovery System and will destroy the R.O. membrane element. Use of and subsequent damage caused by non Sea Recovery Chemicals are the liability and responsibility of the operator and are not covered by the Sea Recovery Warranty.

Do not connect any water line to the Sea Recovery R.O. System that may contain any of the above listed chemicals. Examples: Do not connect the Sea Recovery R.O. System to the ships potable product water tank if that tank has been treated with a Brominator as Bromine destroys the copolymer components within the system. Do not connect the Sea Recovery R.O. System to any line that may contain chlorine or other oxidants as they destroy the R.O. membrane element.

If you use detergents to clean the internal wetted parts of the system ensure that they are rinsed thoroughly, wiped and dried prior to reassembly. After the components have been reassembled, product water can be used to remove any feed water residue from the exterior surfaces of the components.

USE OF NON-AUTHORIZED OR MISUSE OF AUTHORIZED CHEMICALS VOIDS SYSTEM WARRANTY.

8.1 WEEKLY QUICK CHECK

The following steps ensure that potential problems are resolved preventing major repairs:

- Inspect all fasteners for tightness including brackets, screws, nuts, and bolts. Pay special attention to the High Pressure Pump and Electric Motor since they are subject to increased vibration.
- 2. Clean any salt water or salt deposits from the system with a wet rag.
- 3. Check for water leaks throughout the System and supporting water lines.
- 4. Check all tubing and high-pressure hoses for wear and abrasion against rough surfaces. The hoses must not contact heated or abrasive surfaces.

8.2 OPERATOR MAINTENANCE INTERVALS

The frequency of required maintenance is dependent on the regularity of usage, the condition of the intake water (the location of use), the length of time the system is exposed to water, the total running time and, in some cases, the manner in which the system is installed or operated. Because of these factors, it is virtually impossible to comprise an exact timetable for required maintenance. The maintenance timetable, Page 8-3, is an estimate of the time intervals at which maintenance may be required on the various system components. This is based upon factual data compiled from Sea Recovery installations around the world. However, this schedule must be adjusted to each individual system depending upon the variables listed.

WARNING: Components, spares, and consumable utilized within the Sea Recovery System can be specific to Sea Recovery specifications and are not commercially available from other sources. Other Components utilized within the Sea Recovery System are modified by Sea Recovery for a specific purpose of compatibility and are not commercially available from other sources. Many of these special components can appear to be similar to Sea Recovery components. Extensive and expensive damage to the Sea Recovery System WILL result if incompatible components are used in the Sea Recovery System. Damage caused to the Sea Recovery System as a result of third party components is the liability and responsibility of both the Marine Dealer that sold the component for use in the Sea Recovery System as well as the Owner/Operator that purchased and installed the third party component in the Sea Recovery System and is not covered by the Sea Recovery Warranty.

Always insist on only Sea Recovery supplied components, spares, and consumable.

8.3 INDIVIDUAL COMPONENT MAINTENANCE AND REPAIR

Refer to the P&ID in Section 3.

1. Inlet Thru Hull Fitting: Non Sea Recovery component. Keep the Inlet Thru Hull Fitting free and clear of debris and marine growth. If the Inlet Thru Hull Fitting is clogged, this results in a low feed pressure condition, which causes the system to shut off.

> Blockage at the Inlet Thru-Hull Fitting causes the System to shut off due to lack of Feed Water Flow. Unfortunately, since it is under water operators are reluctant to thoroughly inspect the Inlet Thru-Hull Fitting for problems. This can cause time consuming frustrations in attempting to gain feed water flow by trouble shooting other components in the System.

> The Inlet Thru-Hull Fitting must be free and clear allowing the System to draw 4.5 U.S. Gallons (17 Liters) Per Minute through it with minimal resistance. Any blockage at the Inlet Thru-Hull Fitting will cause low pressure and low flow problems at the System. This Inlet Thru-Hull Fitting must be a Forward Facing Scoop so that the System receives a positive flow of water as the boat is under way. It must be minimum 3/4 in. (19 mm) inside diameter. It must be installed in a position on the bottom of the Hull so as to allow free flowing Feed Water without air.



CAUTION: A flat profile, flush mount, inlet thru-hull fitting will cause a vacuum as the boat is under way, and this will cause loss of feed water flow and

Maintenance Timetable:

COMPONENT	MAINTENANCE REQUIRED	TIME INTERVAL CONTINUOUS	TIME INTERVAL INTERMITTENT DUTY
Sea Strainer	Inspect & Clean Screen & Housing	weekly	100 hours
Plankton Filter	Inspect & clean	weekly	100 hours
Multi Media Filter	Back wash & Rinse	when pressure drops 20 PSI (1.37 BAR) across the filter	
Pre-filter	Replace element(s)	Low Pressure <10 psi (0.68 BAR)	Low Pressure <10 psi (0.68 BAR)
Oil/water Separator	Replace element	Low Pressure <10 psi (0.68 BAR)	Low Pressure <10 psi (0.68 BAR)
Std HP Pump	Change Oil	500 hrs	500 hrs
	Replace Seal Kit	2000 hrs	2000 hrs
	Replace Valve Kit	2000 hrs	2000 hrs
Opt HP Pump	Internal Service	Approxi 8000 hrs	
R. O. Membrane	Clean Element	When production or salt rejection decreases by 10%	
Salinity Probe	Clean Probes	Annually	Annually
Charcoal Filter	Replace Element	3 months	3 months
pH Neutralizing Cartridge	Replace Cartridge clean quartz sleeve	when calcium carbonate granules are depleted	
UV Sterilizer	Replace lamp &	2000 Hours	2000 Hours
Fresh Water Flush Charcoal Element	Replace Element	3 months	3 months

cavitation of the Booster Pump and High Pressure Pump resulting in continual system shut down due to low feed water flow and pressure. The resulting failure of the system to remain in operation is attributed to improper installation, is the liability of the installer, and is not covered by the Sea Recovery warranty.

CAUTION: If the thru-hull fitting has been placed in a position on the underside of the hull that allows air to continually enter the thru-hull fitting, this will cause the system to continually shut down due to loss of feed water. The resulting failure of the system to remain in operation is attributed to improper installation, is the liability of the installer, and is not covered by the Sea Recovery warranty.

CAUTION: The Sea Recovery System must not be tied into another existing auxiliary water line already supplying

another accessory on the boat. Using one Thru Hull fitting for other equipment will cause the Sea Recovery System to draw air or cavitate leading to continual system shut down. The resulting failure of the system to remain in operation is attributed to improper installation, is the liability of the installer, and is not covered by the Sea Recovery warranty.

CAUTION: If the Sea Recovery System is connected to a Sea Chest or Stand Up Pipe, do not plumb the Sea Recovery System feed line to the "top" of the Sea Chest or Stand Up Pipe. If plumbed into the top of these feed water arrangements, the Sea Recovery System will experience continual shut down due to air inducement into the system. The resulting failure of the system to remain in operation is attributed to improper installation, is the liability of the installer, and is not covered by the Sea Recovery warranty. Plumb the Sea Recovery System to the "bottom" of such feed water arrangements to ensure a continual air free supply of feed water to the system.

- 2. Sea Cock Valve: Non Sea Recovery component. The packing and connections of the Inlet Sea Cock Valve must be tight and must properly seal. Clean the valve cavity of debris or replace the seal and seat or the entire valve, as required. This section is under a vacuum condition while operating the system. Loose fittings or a worn seal will allow air to enter the Sea Recovery system causing continual shut down due to subsequent low feed water pressure.
- 3. Inlet Connection: Replace if damaged.
- 4. Inline Vacuum / Pressure Gauges: If the Vacuum/ Pressure gauge needle does not move; or does not register proper vacuum or pressure this may be caused by a plugged orifice. The Vacuum/Pressure Gauges have a very small orifice at the bottom of the pipe fitting end. This orifice can become plugged with debris or corrosion. Using a small diameter wire clean the debris from the orifice. Replace the gauge if cleaning of the orifice does not restore functionality.
- 5. Sea Strainer: Keep the mesh screen free and clear of debris. When the mesh screen is clogged, it results in a low-pressure condition causing system shut off. This section is under a vacuum condition while operating the system. If the Sea Strainer's bowl is loose or if the O-ring seal is worn or not properly seated, air will enter the system causing continual shut down due to subsequent low feed water pressure.
- Booster Pump: (centrifugal; counter clockwise rotation as viewed from volute end {front end} of pump)

A. Electric Motor:

Troubleshoot electric motor failure to ensure that any abnormality from the power, wiring, connections, contactors, or control circuit are not at fault or at cause. If the electric motor has failed, it will require repair. However, depending upon failure, replacement may be more cost effective than repair. If failure of the motor is due to external source, not the motor itself, then correct the cause or else the replacement or repaired motor will fail again.

Failures of the electric motor may be:

Winding failure.	Generally caused by low or high power, below or above the specified voltage requirements of the system. This is Not economically repairable.
Capacitor failure.	Generally caused by low power feeding the motor and or low cycles from the power source. Also caused by rapidly repeating starting and stopping of the motor. Field replaceable.

The Electric Motor is 1/2 horse power, Totally Enclosed Fan Cooled, 2 pole, dual Cycle, and dual Voltage.

WARNING: The Booster Pump MUST rotate in the COUNTER CLOCKWISE DIRECTION ONLY Rotating the Booster Pump in the clockwise direction will cause extensive damage to it. Never operate the Booster Pump in the clockwise direction.

WARNING: When switching from Three Phase Generator power to Three Phase Shore power ALWAYS check phases prior to operating the System else Reverse Rotation along with extensive damage to the Booster Pump will occur should the power be out of phase.

Problems and Symptoms appearing and caused by the Booster Pump or its Electric Motor:

1. The Single Phase (115 or 230 VAC) Electric Motor "hums", pulls starting current (locked rotor) amperage, does not rotate, and trips the supply power circuit breaker when attempting to operate the System.

> The Single Phase Electric Motor is a capacitor start motor. If the motor was started with low voltage, a drop in voltage during starting, and if this was repeated several times in rapid concession the capacitor will short out. Without the aid of a working capacitor the motor will "hum", pull starting current (locked rotor) amperage, not rotate, and trip the supply power circuit breaker when attempting to operate the System.

Low voltage will also cause the same symptom. Low voltage is caused by an undersized power supply or generator, undersized power lead wires to the System or motor, loose power wire, or connection at the motor or within the power supply line, and "burnt" contacts on the motor starter relay (contactor).

Solutions:

- a) Check wiring size and connections to, from, and in between the Power Supply and the electric motor. Correct wire size or any loose wires.
- b) Check the capacitor on the motor, and replace it if it has shorted out.
- c) Measure voltage at the motor during attempt to start it. If voltage drops more than 10% locate and correct the reason.
- d) Check the motor starter relay (contactor) for "burnt" contacts.
- 2. The Three Phase (230/380/460 VAC) Electric Motor "hums", pulls starting current (locked rotor) amperage, does not rotate, and trips the supply power circuit breaker when attempting to operate the System.

The Three Phase Electric Motor requires all three power lines (all three phases) to be operative else it will "single phase" causing extensive damage to the motor's internal windings.

Low voltage will also cause the same symptom. Low voltage is caused by an undersized power supply or generator, undersized power lead wires to the System or motor, loose power wire, or connection at the motor or within the power supply line, and "burnt" contacts on the motor starter relay (contactor).

Solutions:

- a) Check wiring size and connections to, from, and in between the Power Supply and the electric motor. Correct wire size or any loose wires.
- b) Measure voltage at the motor during attempt to start it. If voltage drops more than 10% locate and correct the reason. Cross check voltage across all 3 power leads.
- c) Check the motor starter relay (contactor) for "burnt" contacts.

3. The Electric Motor makes an unusual "grinding" sound when operated.

Solutions:

- a) Check and replace as necessary the front and rear bearings.
- b) Check to see if the fan is rubbing against the fan guard.

B. Booster Pump:

Replace the ceramic seal approximately every 2000 hours, or at the sign of leakage:

DISASSEMBLY:

Remove the four 3/8-16 Bolts holding the volute to the motor bracket. To remove the impeller, remove the bearing cap on the motor to expose the screwdriver slot on the motor shaft. Hold the motor shaft with a large screwdriver and remove the impeller by grasping it with your hand and turning the impeller counter clockwise. Remove the Seal. Two screwdrivers wedged into the seal at 180° apart serve as tools to wedge the seal out. The ceramic seat is removed by removing the end bell gasket.

REASSEMBLY:

Clean the motor shaft and the bracket of any corrosion or salt deposits. Replace the end bell gasket and the tap seat portion into the bracket cavity. Use a new gasket. Place the ceramic seat into the cavity over the shaft. Make sure that the polished side is toward the end of the shaft. Tap into place evenly using a hollow piece of wood or plastic tool. If a metal tool is used to tap it into place, protect the seat with cardboard or a clean cloth. Lubricate the shaft with water and soap or a light oil and slip the rotating portion of the seal over the shaft with the carbon element toward the ceramic. Slide it down onto the shaft as far as possible. Apply blue Loctite to the motor shaft threads. Hold the Motor shaft and reinstall the impeller. Tighten the impeller by turning it clockwise until it is snug. Reinstall the volute. Tighten the bolts evenly. Thoroughly prime the pump.

Some Electric Motors supplied by Sea Recovery have permanently sealed and lubricated bearings. Others require lubrication from time to time. If your Electric Motor has grease jerks at each end of the motor, over the front and rear bearings, the bearings require lubrication every 6 months. Give three pumps of high temperature motor bearing lubricant into each grease jerk. Use a Polyurea Base Grease such as Chevron SRI (Polyurea Base) or Shell Dolium R (Polyurea Base). DO NOT USE LITHIUM OR SILICONE BASE GREASE.

- 7. T-Connector Pressure Pick-Up: Replace any hose or tube that is kinked. Disconnect each end of the tube and blow air through the tube to ensure that it is not blocked. Replace if damaged.
- 8. Pressure Transducers: The Pressure Transducers are not repairable and can not be calibrated. If inoperative check connections at the Transducer and at the Printed Circuit Board to ensure there is no visible corrosion or loose connections.
- 9. Plankton Filter Element Cleaning:
 - a) Unscrew the bowl counter clockwise.
 - b) Remove the Plankton Filter Elements from the bowl.
 - c) Remove the O-Ring from the top of the bowl.
 - d) Clean the mesh screen filter elements with a bristle brush and water spray.
 - e) Wipe the O-Ring with a damp cloth.
 - f) Lightly lubricate the O-Ring with O-Ring lubricant.
 - g) Place the O-Ring back onto the bowl.
 - h) Insert the cleaned or new plankton filter elements into the bowls.
 - i) Screw the bowls on clockwise.
 - j) Hand snug to seal the O-Ring; do not use a wrench or other tool to tighten; do not over tighten. Over tightening transfers stress to the lid and bowl threads causing the lid or bowl to fail (crack or break) and making subsequent disassembly difficult.
- 10. Multi Media Filter Backwash:

The Multi Media Filter contains fine gravel and #20 silica sand. This silica sand traps suspended solids larger than 20 micron. The top layer of the silica sand within the Multi Media Filter becomes packed with suspended solids and restricts flow through it. When the silica sand becomes packed with suspended solids, as indicated by a loss of pressure, it must then be back washed to waste. This back washing procedure fluffs the silica sand and dislodges the suspended solids from the sand base. During back washing the suspended solids are discharged to waste through the Multi Media Filter Waste outlet.

If replacing the media, the Multi Media Filter requires approximately 15 lbs. (7 kg) of small gravel ($1/8 \times 1/4$ in. (3.27×6.35 mm) first on the bottom then approximately 26 lbs. (12 kg) of #20 silica sand last (on top of the small gravel).

NOTE: the new gravel and sand contain fines and contaminates. The Multi Media Filter must be back washed prior to use.

Instructions for Back-washing of the Multi Media Filter:

- a) Open the Inlet Sea Cock Valve.
- b) Position the Rinse Clean Inlet Valve, if installed, to the normal operating position towards the Sea Strainer.
- c) Position the Rinse Clean Outlet Valve, if installed, to the normal operating position towards the Brine Discharge Thru-Hull Fitting.
- d) Position the Multi Media Filter valves to Backwash
- e) In the Manual mode of operation, operate only the Booster Pump.
- f) After 10 minutes of back washing Stop the Booster Pump.
- g) Position the Multi Media Filter Valves to Rinse.
- h) In the Manual mode of operation, operate only the Booster Pump.
- i) After 5 minutes of Rinsing Stop the Booster Pump.
- j) Position the Multi Media Filter Valves to Normal Operation. Refer to Figure 8a, page 8-7.
- 11. Commercial Prefilter Element Replacement:

The Commercial Prefilter Pleated Cartridge Element may be cleaned with water spray once or twice. After cleaning the expected life will be reduced in half. Attempts to clean the element more than twice will result in a very short life and will damage the element rendering it useless. Change the element after the first or second cleaning. Clean or replace the element when plugged to the extent that the pressure into the High Pressure Pump is 10 PSI (69 kPa) or less. At slightly below 6 PSI (41 kPa) the System will turn off and display a fault screen.

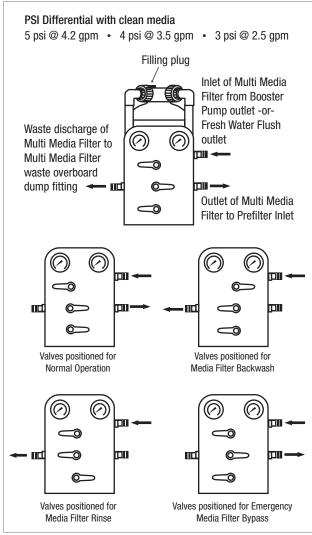


Figure 8a: Valve Positioning of the Multi Media Filter during 4 separate modes of Operation.

CAUTION: Do not use third party prefilter elements; use only Sea Recovery Prefilter Elements. Third party prefilter elements on the market do not properly fit, the seams fall apart, they will allow by-pass.

WARNING: By-pass of debris through the third party element will extensively damage the High Pressure Pump. Bypass of debris through the third party element will also prematurely foul the R.O. membrane element. Use of third party prefilter elements will void any and all Sea Recovery warranty to the High Pressure Pump and the R.O. membrane element.

IMPORTANT: Do not use "string wound" or "fiber" prefilter elements. These type of elements are designed for the Photographic Film Developing industry. When used in sea water, they will plug up rapidly in 1/10th or less the time causing frequent shut down of the system and very frequent changing which will also lead to very high cost of maintenance. Use of String Wound or Fiber type elements will only lead to user frustration and very high maintenance costs. Use of third party prefilter elements will void any and all Sea Recovery warranty to the High Pressure Pump and the R.O. membrane element.

DO NOT ACCEPT THIRD PARTY PREFILTER ELEMENTS FROM ANY MARINE DEALER. USE ONLY SEA RECOVERY SUPPLIED PREFILTER ELEMENTS. The resulting failure of the system to remain in operation, and or damage to the Sea Recovery System caused by Third Party Prefilter Elements is attributed to improper maintenance and operation, is the liability of the operator and owner, and is not covered by the Sea Recovery warranty.

Commercial Prefilter Element Replacement:

To clean or replace the Commercial Prefilter Element:

- a) Unscrew the lid locking ring counter clockwise.
- b) Remove and discard the used Commercial Prefilter Pleated Cartridge Element from the housing.
- c) Thoroughly clean the inside of the bowl. The High Pressure Pump is manufactured to very tight tolerance spacing between moving parts. Any debris entering the Pump will cause extensive and expensive damage to the internal parts. The Sea Recovery Prefilter will stop any debris and protect the High Pressure Pump. Use caution when changing filter elements and do not allow any debris from the prefilter element to enter the outlet port of it's housing.
- d) Inspect the O-Ring attached to the lid. Replace if damaged or if the lid leaks water.
- e) Wipe the O-Ring with a damp cloth.
- f) Sparingly lubricate the O-Ring with O-Ring lubricant.

- g) Insert the cleaned or new Sea Recovery Commercial Prefilter Pleated Cartridge Element into the bowl.
- h) Replace the lid into the top of the housing.
- Replace the lid locking ring. Tighten ONLY two finger tight. Finger or lightly Hand snug to retain the lid in place. Do not use a wrench or other tool to tighten. Do not over tighten. Over tightening causes stress to the bowl and lid lock ring threads leading to cracks, breakage, and difficult disassembly at the next filter change.
- j) Open the Sea Cock Valve, open the air bleed valve located on the lid. Bleed any air from the Commercial Prefilter Housing. After water appears close the air bleed valve. It may be necessary to operate the Booster Pump manually in order to purge the Commercial Prefilter housing of air.

WARNING: For safety reasons ALWAYS purge air from the Prefilter Housing.

Dual Prefilter Element Replacement:

The Prefilter Pleated Cartridge Element may be cleaned with water spray once or twice. After cleaning the expected life will be reduced in half. Attempts to clean the element more than twice will result in a very short life and will damage the element rendering it useless. Change the element after the first or second cleaning. Clean or replace the element when plugged to the extent that the pressure into the High Pressure Pump is 10 PSI (69 kPa) or less. At slightly below 6 PSI (41 kPa) the System will turn off and display a fault screen indicating low pressure.

To clean or replace the Prefilter Element:

- a) Unscrew the bowl counter clockwise.
- b) Remove and discard the used Prefilter Pleated Cartridge Element from the bowl.
- c) Remove the O-Ring from the top of the bowl.
- d) Thoroughly clean the inside of the bowl. The High Pressure Pump is manufactured to very tight tolerance spacing between moving parts. Any debris entering the Pump will cause extensive and expensive damage to the internal parts. The Sea Recovery Prefilter will

stop any debris and protect the High Pressure Pump. Use caution when changing filter elements and do not allow any debris from the prefilter element to enter the outlet port of it's housing.

- e) Wipe the O-Ring with a damp cloth.
- f) Sparingly lubricate the O-Ring with O-Ring lubricant.
- g) Place the O-Ring back onto the bowl.
- h) Insert the cleaned or new Sea Recovery Prefilter Pleated Cartridge Element into the bowl. 20 micron into filter housing and 5 micron into filter housing
- i) Screw the bowl on clockwise.
- j) Hand snug to seal the O-Ring; do not use a wrench or other tool to tighten; do not over tighten. Over tightening causes stress to the bowl and lid threads leading to cracks, breakage, and difficult disassembly at the next filter change.
- 12. T-Connector Pressure Pick-Up: Replace any hose or tube that is kinked. Disconnect each end of the tube and blow air through the tube to ensure that it is not blocked. Replace if damaged.
- 13. Oil/Water Separator Filter Element Replacement: The Oil/Water Separator Coalescing Filter Element is not cleanable. Replace the element when plugged to the extent that the pressure into the High Pressure Pump is 10 PSI (69 kPa) or less. At slightly below 6 PSI (41 kPa) the System will turn off and display a fault screen indicating low pressure.

Oil/Water Separator Filter Element Replacement:

To replace the Oil/Water Separator Filter Element:

- a) Unscrew the lid locking ring counter clockwise.
- b) Remove and discard the used Oil/Water Separator Filter Element from the housing.
- c) Thoroughly clean the inside of the bowl. The High Pressure Pump is manufactured to very tight tolerance spacing between moving parts. Any debris entering the Pump will cause extensive and expensive damage to the internal parts. The Sea Recovery Prefilter will stop any debris and protect the High Pressure

Pump. Use caution when changing filter elements and do not allow any debris from the prefilter element to enter the outlet port of it's housing.

- d) Inspect the O-Ring attached to the lid. Replace if damaged or if the lid leaks water.
- e) Wipe the O-Ring with a damp cloth.
- f) Sparingly lubricate the O-Ring with O-Ring lubricant.
- g) Insert the new Sea Recovery Oil/Water Separator Filter Element into the bowl.
- h) Replace the lid into the top of the housing.
- Replace the lid locking ring. Tighten ONLY two finger tight. Finger or lightly Hand snug to retain the lid in place. Do not use a wrench or other tool to tighten. Do not over tighten. Over tightening causes stress to the bowl and lid lock ring threads leading to cracks, breakage, and difficult disassembly at the next filter change.
- j) Open the Sea Cock Valve, open the air bleed valve located on the lid. Bleed any air from the Oil/Water Separator Filter Housing. After water appears close the air bleed valve. It may be necessary to operate the Booster Pump manually in order to purge the filter housing of air.
- 14. Transducer Manifold is not repairable. If broken or leaking replace it.
- 15. High Pressure Pump and Electric Motor:

A) Electric Motor:

Troubleshoot electric motor failure to ensure that any abnormality from the power, wiring, connections, contactors, or control circuit are not at fault or at cause. If the electric motor has failed, it will require repair. However, depending upon failure, replacement may be more cost effective than repair. If failure of the motor is due to external source, not the motor itself, then correct the cause or else the replacement or repaired motor will fail again.

Failures	of the	electric	motor	may be	
----------	--------	----------	-------	--------	--

Winding failure.	Generally caused by low or high		
	power, below or above the specified		
	voltage requirements of the system.		
	This is Not economically repairable.		
Capacitor failure.	Generally caused by low power		
	feeding the motor and or low		
	cycles from the power source. Also		
	caused by rapidly repeating starting		
	and stopping of the motor. Field		
	replaceable.		

The Electric Motor is 3 horse power, Totally Enclosed Fan Cooled, 2 pole, dual Cycle, and dual Voltage.

WARNING: The High Pressure Pump MUST rotate in the COUNTER CLOCKWISE DIRECTION ONLY Rotating the High Pressure Pump in the clockwise direction will cause extensive damage to it. Never operate the High Pressure Pump in the clockwise direction.

WARNING: When switching from Three Phase Generator power to Three Phase Shore power ALWAYS check phases prior to operating the System else Reverse Rotation along with extensive damage to the High Pressure Pump will occur should the power be out of phase.

Problems and Symptoms appearing and caused by the High Pressure Pump or its Electric Motor:

A. The Single Phase (115 or 230 VAC) Electric Motor "hums", pulls starting current (locked rotor) amperage, does not rotate, and trips the supply power circuit breaker when attempting to operate the System.

> The Single Phase Electric Motor is a capacitor start motor. If the motor was started with low voltage, a drop in voltage during starting, and if this was repeated several times in rapid concession the capacitor will short out. Without the aid of a working capacitor the motor will "hum", pull starting current (locked rotor) amperage, not rotate, and trip the supply power circuit breaker when attempting to operate the System.

Low voltage will also cause the same symptom. Low voltage is caused by an undersized power supply or generator, undersized power lead wires to the System or motor, loose power wire, or connection at the motor or within the power supply line, and "burnt" contacts on the motor starter relay (contactor).

Solutions:

- a) Check wiring size and connections to, from, and in between the Power Supply and the electric motor. Correct wire size or any loose wires.
- b) Check the capacitor on the motor, and replace it if it has shorted out.
- c) Measure voltage at the motor during attempt to start it. If voltage drops more than 10% locate and correct the reason.
- d) Check the motor starter relay (contactor) for "burnt" contacts.
- B. The Three Phase (230/380/460 VAC) Electric Motor "hums", pulls starting current (locked rotor) amperage, does not rotate, and trips the supply power circuit breaker when attempting to operate the System.

The Three Phase Electric Motor requires all three power lines (all three phases) to be operative else it will "single phase" causing extensive damage to the motor's internal windings.

Low voltage will also cause the same symptom. Low voltage is caused by an undersized power supply or generator, undersized power lead wires to the System or motor, loose power wire, or connection at the motor or within the power supply line, and "burnt" contacts on the motor starter relay (contactor).

Solutions:

- a) Check wiring size and connections to, from, and in between the Power Supply and the electric motor. Correct wire size or any loose wires.
- b) Measure voltage at the motor during attempt to start it. If voltage drops more than 10% locate and correct the reason. Cross check voltage across all 3 power leads.
- c) Check the motor starter relay (contactor) for "burnt" contacts.
- C. The Electric Motor makes an unusual "grinding" sound when operated.

Solutions:

- a) Check and replace as necessary the front and rear bearings.
- b) Check to see if the fan is rubbing against the fan guard.

B) High Pressure Pump (Optional Pump):

This High Pressure Pump is a Quintiplex Radial Axial Positive Displacement Plunger Pump made of high grade Duplex material specifically designed for sea water Reverse Osmosis applications. This Pump is not commercially available. This pump is specifically manufactured to Sea Recovery specifications.

WARNING: Two similar Pumps are commercially available. One has a higher flow rate and the other has a lower flow rate. Both of these pumps will cause damage to the Sea Recovery System because of excess flow or under flow. The use of any similar pump, not supplied by Sea Recovery, will either cause the Electric Motor to fail, or the R.O. membrane element to prematurely foul. USE ONLY SEA RECOVERY SUPPLIED PARTS AND COMPONENTS FOR THE SEA RECOVERY SYSTEM.

As with all Positive Displacement pumps it must receive a specified minimum amount of water at a positive pressure. A vacuum at the inlet of the pump will cause cavitation and damage. This pump does not use oil, it is self lubricated with the feed water. Internal components are designed for 8,000 hours of continual service in sea water. As with any component exposed to sea water, use is best.

The Pump is manufactured to very tight tolerance spacing between moving parts. Any debris entering the Pump will cause extensive and expensive damage to the internal parts. The Sea Recovery Prefilter will stop any debris and protect the High Pressure Pump. Use caution when changing filter elements and do not allow any debris from the prefilter element to enter the outlet port of it's housing.

The High Pressure Pump is not field repairable. If the High Pressure Pump fails to properly function return it to Sea Recovery, or to a Sea Recovery Authorized Dealer for return to Sea Recovery. A Pressure Pump requiring maintenance within the warranty period, and if after examination by Sea Recovery is found to be non-operational due to a warranty failure, will be repaired or replaced with a rebuilt pump at Sea Recovery's option.

A High Pressure Pump requiring maintenance that is not within the warranty period, or is damaged due to non warranty reasons, will be repaired or replaced with a rebuilt pump depending on the severity of damage.

For repair or replacement, contact Sea Recovery for a Material Return Authorization and shipping instructions.

C) High Pressure Pump (Standard Pump): HIGH PRESSURE PUMP ABNORMALITIES:

- 1. High Pressure Pump flow is normal when the system operating pressure is below 100 PSI, but the flow drops or becomes erratic and pulsates as pressure is applied.
- a) Worn High Pressure Seals from normal use require replacement.
- b) Worn High Pressure Pump valves, valve seats, valve springs and or valve seat "O" rings are broken or worn due to normal use and are allowing internal by-passing. Repair the pump with a Valve and Seal Kit.
- 2. Pump is noisier than usual and pulsations are observed in hoses and gauges
- Worn or broken Valve, Valve Spring, or Valve Seat. Repair the pump with a Valve and Seal Kit.
- Pump is cavitating and not receiving sufficient feed water at it's inlet due to blockage prior to the pump's inlet port. Clear the blockage in the feed water line.
- 3. High Pressure Pump Leaks Oil
- a) Determine source of leak and replace appropriate associated seal.
- 4. High Pressure Pump leaks water between manifold and Drive End.
- a) Worn Inlet Packings due to normal use
- b) Worn Inlet Packings due to operation under a vacuum condition
- c) Worn Inlet Packings because pump has been operated dry, without inlet feed water.

d) Repair the pump with a Seal Kit.

5.

- If the High Pressure Pump electric motor fails to operate, follow these steps to isolate the problem.
 - a) Ensure that the system is receiving proper power from the power source.
 - Press "Start" button to start the system. It will take approximately 2 seconds before the High Pressure Pump Motor starts. Do not press any other switch.
 - Measure the AC voltage between terminals (AC Systems) or (DC systems) on the main terminal strip.
 - d) If the voltage measured matches the system voltage, then problems may be in the power cable attached to the motor or the motor internal wiring or windings.
 - e) If low or no voltage is present, then check for proper operation of the High Pressure Pump Contactor. To deactivate the contactor, press the "Stop" button. To activate the contactor again press the "Start" button.
 - f) If the contactor is mechanically operating, but no voltage is present at the motor terminals, then the High Pressure Pump Motor contactor may be at fault.
 - g) If the contactor does not operate mechanically, then measure the DC voltage between A1 and A2 terminals on the High Pressure Pump Motor contactor coil. It should read 12V DC when activated.
 - h) If the contactor coil is receiving 12V DC but inoperative then the contactor's coil may be bad. Replace the contactor.
 - If 12V DC is not present when the High Pressure Pump is activated, trace the wires to the main circuit board and measure the DC voltage at the terminals. It should read 12V when activated.
 - j) Confirm the HP PUMP "Stop" button illuminated on the Touch Screen when the High Pressure Pump is activated. When this HP Pump "Stop" button is illuminated the HP terminals on the Control Printed Circuit Board should receive 12 VDC. If it is not the case, replace the main circuit board.

- 16. High Pressure Hose: The High Pressure Hose has been assembled with crimp fittings by Sea Recovery. The High Pressure Hose is NOT repairable. Should a leak, damage, or failure develop order a replacement hose from Sea Recovery.
- 17. Reverse Osmosis Membrane and Pressure Vessel Assembly:
 - **NOTE**: The System Membrane Element is accessible with the Vessel still attached to the frame, provided there is sufficient room to the left and right of the System to remove the R.O. membrane element.

Replace all Brine and Product Water O-Rings attached to the End Plugs within the High Pressure Vessel Assembly each time the Reverse Osmosis Membrane Element is removed or replaced. Ensure these O-Rings are on hand prior to repair.

R.O. Membrane Elements are only installed and removed from the INLET end of the High Pressure Vessel.

Disassembly of the Reverse Osmosis Membrane and Vessel Assembly:

In this section the number in brackets [#] refer to the reference number in the illustration on the opposite page (fig. 8b).

- a) Disconnect the High Pressure Hose from each end of the High Pressure Vessel Assembly.
- b) Using a 5/16" Allen wrench remove the 3 each Socket Head Cap Screws #16 from the three-piece Segment Rings [14] located at each end of the Pressure Vessel.
- c) Push inward on the End Plug [3 & 4] and Remove the three-piece segment ring [14] from one end, repeat for the other end.
- d) Remove the Port Retainer [15] from each end.
- e) Remove the High Pressure Port [5 & 9] from each end.
- f) Remove the product water tube [13] from the product water tube fitting [12].
- g) Remove the product water tube fitting [12] and nipple [11] from the end plug.
- h) Insert all three of the Socket Head Cap Screws [16] finger tight back into the End

Plug [3 & 4]. These screws are used as a grip to remove the End Plug.

- Grasp one or more of the Socket Head Cap Screws with a pair of pliers and pull slowly outward to remove the End Plug. There is some resistance due to the two Brine O-Rings exerting friction against the Vessel wall. With the End Plug removed from the High Pressure Vessel, the Reverse Osmosis Membrane Element is visible.
- j) Remove and discard the brine O-ring [6] from each of the End Plugs.
- k) Remove and discard the Product Water O-ring[7] from each of the End Plugs.
- I) Clean the end plugs with a cloth and inspect each for any sign of wear, cracks, or damage.
- m) Sparingly, lightly, lubricate NEW Brine O-Ring and new Product Water O-Ring.
- Place the NEW Product Water O-Ring into the product port inner O-Ring groove in each of the End Plugs.
- o) Place the NEW Brine O-Ring onto the outer Brine O-Ring grooves of each of the End Plugs.
- p) CAUTION: At each end of the Reverse Osmosis Membrane Element is a Product Water Tube approximately ¾ in. (1.9 cm) diameter by 1 in. (2.5 cm) long. The outside diameter surface of this product water tube is a sealing surface, which isolates the Product Water from the Feed Water. The surface of the Product Water Tube must be scratch free. Never use pliers or other grabbing tools on the Product Water Tube. Do not drop the R.O. membrane onto a hard surface as the Product Water Tube may be damaged.

With your fingers grasp the Product Water Tube attached to the R.O. membrane element from the INLET end of the Pressure Vessel and pull outward. If resistance is met then cup the INLET end of the High Pressure Vessel with one hand and shake downward to dislodge the R.O. membrane element. The R.O. membrane element may also be pushed from the Outlet end of the vessel towards the Inlet end.

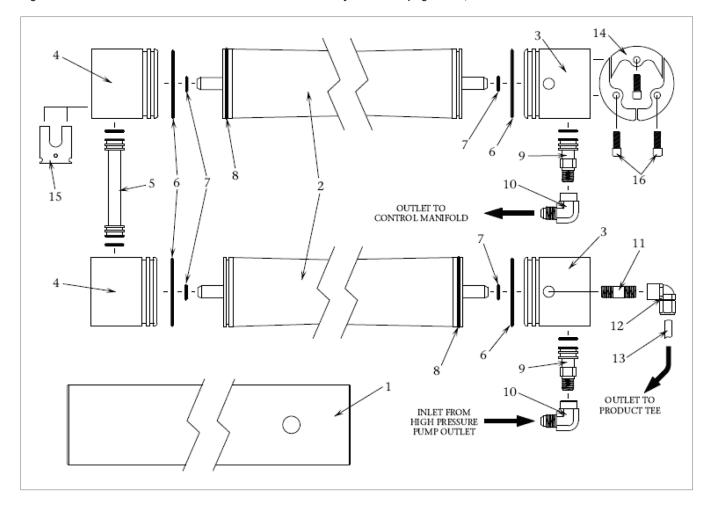


Figure 8b: Reverse Osmosis Membrane and Vessel Assembly - Refer to page 8-11, #17

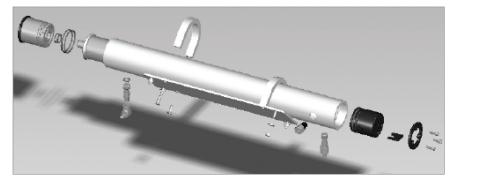


Figure 8c: R.O. Membrane illustration of brine seals Left side: Inlet / Feed Water Entry / R.O. Membrane Element Brine Seal End Right Side: Outlet / Brine Discharge / No brine seal in this end



Figure 8d: Inlet end of Pressure Vessel / Brine Seal End of R.O. Membane Element

- q) Run a rag through the High Pressure Vessel to remove any biological film or debris from the inside of the vessel.
- A new Sea Recovery R.O. membrane element comes complete with a "U" cup Brine Seal #8 at one end of the Element. This Brine Seal must be positioned at the INLET end of the Pressure Vessel. Refer to illustrations below.

Install a new R.O. membrane element with attached "U" cup Brine Seal into the Pressure Vessel. Place the end of the R.O. membrane element that DOES NOT have the Brine Seal attached into the INLET end of the Pressure Vessel and slide it into the Pressure Vessel

Insert the down stream end (end without a brine seal) of the RO membrane element into the upstream inlet end of the High Pressure Vessel.

- s) Slide the membrane element into the High Pressure Vessel, past the brine seal, until the membrane element product water tube is 4 in. (10.2 cm) past the end lip of the High Pressure Vessel.
- t) Insert the End Plug with new attached O-Rings into the High Pressure Vessel while aligning the High Pressure Port and Product Water Port to the respective holes in the High Pressure Vessel. Continue pushing inward on the End Plug until its exposed end travels just past the Segment Ring Groove in the Pressure Vessel. Ensure that the Ports of the End Plug are aligned with the Port Holes of the High Pressure Vessel.
- u) Insert the High Pressure Port Fitting with attached O-Rings into the High Pressure Port.
- v) Replace the Port Retainer.
- w) Insert the three-piece Segment Ring Set into the Segment Ring Groove of the High Pressure Vessel. Align the Segment Ring Set with the tapped holes in the End Plug for insertion of the three Socket Head Cap Screws. Attach the three Socket Head Cap Screws and tighten.
- x) Connect the High Pressure Hoses to the respective fitting on the Pressure Vessel.

- High Pressure Manifold. Replace the High Pressure Manifold if it is visibly cracked or broken and leaking. Replace High Pressure fitting O-rings if damaged, worn, or leaking.
- 19. High Pressure Transducer: The Pressure Transducers are not repairable and can not be calibrated. If inoperative check connections at the Transducer and at the Printed Circuit Board to ensure there is no visible corrosion or loose connections.
- 20. Brine Discharge Flow Meter: The electronic flow meters used in the System are not repairable. If the flow meter gives an inaccurate reading replace it.
- 21. Brine Discharge T-Connector: The Brine Discharge T-Connector is not repairable. If it breaks or should a crack develop replace it.
- 22. Brine Discharge Connector: This 90 degree elbow fitting attaches to the over board thru-hull fitting for connecting the brine discharge hose. If it breaks or cracks replace it.
- Multi Media Filter Waste & Brine Discharge Tee: This 90 degree elbow fitting attaches to the over board thru-hull fitting for connecting the brine discharge hose. If it breaks or cracks replace it.
- 24. Thru-Hull Discharge Fitting: This Owner or Installer supplied Discharge Thru-Hull Fitting is not repairable. If it breaks or cracks replace it.
- 25. Product Water T-Collector: The Product Water T-Collector is not repairable. If it breaks or should a crack develop replace it.
- 26. Salinity Probe: The salinity probe requires cleaning from time to time should debris build up onto the monel probes. Clean the probes once a year.
 - a) Unscrew the black tube fitting nut below the probe to disconnect it from the control manifold.
 - b) Using a soft bristle brush, scrub the probes to remove any built up debris. Thoroughly dry the probe area.
 - c) Should the salinity reading become inaccurate replace it.
- 27. Product Water Flow Meter: The electronic flow meters used in the System are not repairable. If the flow meter gives an inaccurate reading replace it.
- 28. 3-way Product Water Diversion Solenoid Valve:


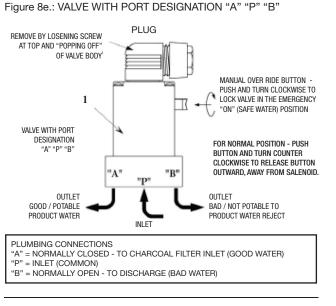


Figure 8f.: VALVE WITH PORT DESIGNATION "R" "B" "P"



PLUMBING CONNECTIONS

- "R" = NORMALLY CLOSED TO CHARCOAL FILTER INLET (GOOD WATER) "B" = INLET (COMMON)
- "P" = NORMALLY OPEN TO DISCHARGE (BAD WATER)

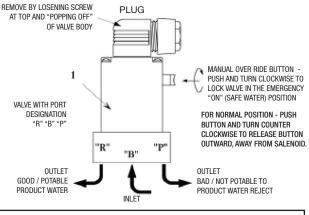

Measure the DC resistance between pins 1 and 2. Proper resistance reading is aprox. 12 to 15 Ω

- A) Do not assume that the Valve's Solenoid is not operational. Check it by performing a Function Test as described in Section 6.4.
- B) Over tightening of the tube fittings into the valve's body can cause the Diversion Valve internal ports to move out of proper position resulting in internal blockage or bypassing.

Refer to Figure 8e through 8f, page 8-15 and follow the instructions listed below.

1) Remove Diversion Valve from the system.

- Position the manual over ride button OUTWARD to normal position by first pushing the button inward and rotating it counter clockwise allowing it to spring outward away from the coil body.
- With your mouth, blow into port "P", air should expel from port "B" which is the "normally open" or "bad water" port.
- If it is extremely difficult to expel air from port "B" or if no air expels from port "B", then valve needs to be replaced.
- 5) Again blow into port "P" while plugging port "B" with a finger tip. No air should expel from port "A".
- 6) If air expels from port "A", then valve need to be replaced.
- Position the manual over ride button INWARD to manual over ride position by pushing the button inward and rotating it clockwise allowing it to lock inward close to the coil body.
- With your mouth, blow into port "P", air should expel from port "A" which is the "normally closed" or "good water" port.
- If it is extremely difficult to expel air from port "A" or if no air expels from port "A", then valve need to be replaced.
- 10) Again blow into port "P" while plugging port "A" with a fingertip. No air should expel from port "B".
- 11) If air expels from port "B", then valve need to be replaced.
- C) Solenoid Valve Coil Check:
 - 1) The 3-way Product Diversion Valve Solenoid operates from 12 VDC.

To check the condition of the Diversion Valve solenoid coil:

- a) While System is operating and producing potable water, using a voltmeter set to DC, check the voltage at the din connector terminals at the top of the 3-Way Diversion Valve's solenoid.
- b) If 12 VDC is present at the din connector terminals then the control circuit is operating normally, but the 3-way Diversion Valve Coil

may be shorted or open. Check the solenoid coil continuity.

- c) This check can only be performed with the solenoid electrically disconnected from the Control Board. Remove the Din Connector from the solenoid. Using an Ohm meter measure the continuity of the solenoid coil as shown below.
- d) If an open circuit exists, or if the resistance is much greater than or less than 12 to 15 ohms, then replace the solenoid coil or the entire valve.
- e) If 12 VDC is not present at the din connector terminals, then the cable connections may be loose, the cable may be broken, or the control circuit may be inoperable. Check these components.
- f) Check for 12 VDC at the connection points of the Diversion Valve Solenoid Coil on the Control Printed Circuit Board terminals.
- g) If 12 VDC is present while system is operating, then the Diversion Valve cable is loose at one of the connections or the cable is defective.
- h) If there is no voltage present while system is operating, then troubleshoot the Control Printed Circuit Board.
- 29. Charcoal Filter: A sulfurous (rotten eggs) odor from the product water requires the replacement of the Charcoal Element. Otherwise, the Charcoal Element should be replaced every 3 to 4 months. It is not cleanable.

CAUTION: Do not use third party charcoal or carbon filter elements; use only Sea Recovery Charcoal Filter Elements. Many third party Charcoal Filter Elements on the market do not properly fit, the seams fall apart, and they will allow by-pass.

WARNING: Many third party Charcoal and Carbon Filter Elements on the market are designed for a very low flow rate and will cause extensive and expensive damage to the Sea Recovery System resulting from several hundred pounds of pressure build up on the product water line. Excessive pressure resulting from third party Charcoal or Carbon Filter Elements will damage: R.O. Membrane Element, Product Water Flow Meter, 3-Way Product Water Diversion Valve, Charcoal Filter Housing, and the Product Water Line.

DO NOT ACCEPT THIRD PARTY CHARCOAL FILTER ELEMENTS FROM ANY MARINE DEALER. USE ONLY SEA RECOVERY SUPPLIED CHARCOAL FILTER ELEMENTS. The resulting failure of the system to remain in operation, and or damage to the Sea Recovery System caused by Third Party Charcoal or Carbon Filter Elements is attributed to improper maintenance and operation, is the liability of the operator and owner, and is not covered by the Sea Recovery warranty.

To replace the Charcoal Filter Element:

- a) Unscrew the bowl counter clockwise.
- b) Remove the Charcoal Filter Element from the bowl.
- c) Remove the O-Ring from the top of the bowl and take care to not damage it.
- d) Replace the Charcoal Filter Element with a new Sea Recovery element.
- e) Wipe the O-Ring with a damp cloth.
- f) Sparingly lubricate the O-Ring lightly with O-Ring lubricant.
- g) Place the O-Ring back onto the bowl.
- h) Insert the new, Sea Recovery Charcoal Filter Element into the bowl.
- i) Screw the bowl on clockwise.
- j) Hand snug to seal the O-Ring, do not use a wrench or other tool to tighten, do not over tighten. Over tightening causes stress to the lid and bowl threads resulting in damage, breakage, or cracks and subsequent removal difficult.
- 30. pH Neutralizing Filter: The pH Neutralizing cartridge will require replacement when the calcium carbonate within the cartridge has dissolved.

Maintenance

To replace the pH Neutralizing Cartridge:

- a) Unscrew the bowl counter clockwise.
- b) Remove the pH Neutralizing Cartridge from the bowl.
- c) Remove the O-Ring from the top of the bowl and take care to not damage it.
- d) Replace the pH Neutralizing Cartridge with a new Sea Recovery Cartridge.
- e) Wipe the O-Ring with a damp cloth.
- f) Sparingly lubricate the O-Ring lightly with O-Ring lubricant.
- g) Place the O-Ring back onto the bowl.
- h) Insert the new, Sea Recovery pH Neutralizing Cartridge into the bowl.
- i) Screw the bowl on clockwise.
- j) Hand snug to seal the O-Ring, do not use a wrench or other tool to tighten, do not over tighten. Over tightening causes stress to the lid and bowl threads resulting in damage, breakage, or cracks and subsequent removal difficult.
- Ultraviolet Sterilizer: The UV Sterilizer lamp emits a low frequency form of light. This light degrades and loses intensity and ability to sterilize biological matter over approximately 8,000 hours of use. Therefore, the lamp may remain lit, but requires replacement every 4400-8000 hrs.



CAUTION: Make sure that system power is turned off before beginning sterilizer maintenance. Ultra Violet light is harmful to eyes and skin.

Lamp Replacement:

- a) Remove the four screws on the ballast box and remove lid.
- b) Remove the rubber boot and carefully pull lamp out of the quartz sleeve.
- c) Replace the lamp. During lamp replacement clean the quartz sleeve as well. The quartz sleeve should be crystal clear and if it has discolored, it must be cleaned or replaced.

Quartz Sleeve Cleaning:

a) Remove the four screws on the ballast box and remove lid.

- b) Remove the rubber boot and carefully pull lamp out of the quartz sleeve.
- c) Unscrew and remove the two compression nuts (ballast box and view port).
- d) Remove the O-ring on the view port side only.
- e) With care pull the quartz sleeve out from the ballast box side.
- f) Clean the quartz tube with water and a bottle brush without moving the O-ring. Dry with a soft cloth. Handle the quartz sleeve carefully.

Reassembly:

- a) Replace old O-rings with new O-rings.
- b) Insert the quartz sleeve (close-end first) through the ballast box passthru until O-ring contact passthru. Screw on the ballast box compression nut. Insert view port O-ring and screw on view port compression nut .
- c) Attach a new UV Lamp into the plug.
- d) Slide the lamp into the Quartz Sleeve and install rubber boot over the compression nut.
- e) Replace the three 1/4-20 cap head screws.
- 32. Fresh Water Flush Carbon Filter Element: The Carbon Filter Element in the Fresh Water Flush should be replaced every 3 months.

The Fresh Water Flush will automatically flush the system with Fresh Water every preset number of days. The duration of the flush cycle will be 90 seconds for a system connected to 60 Hz power and to 120 seconds for systems connected to 50 Hz power.

To replace the Carbon Filter Element:

- a) Unscrew the bowl counter clockwise.
- b) Remove the Carbon Filter Element from the bowl.
- c) Remove the O-Ring from the top of the bowl and take care to not damage it.
- d) Replace the Carbon Filter Element with a new Sea Recovery element.
- e) Wipe the O-Ring with a damp cloth.
- f) Sparingly lubricate the O-Ring lightly with O-Ring lubricant.
- g) Place the O-Ring back onto the bowl.
- h) Insert the new, Sea Recovery Carbon Filter Element into the bowl.

- i) Screw the bowl on clockwise.
- Hand snug to seal the O-Ring, do not use a wrench or other tool to tighten, do not over tighten. Over tightening causes stress to the lid and bowl threads resulting in damage, breakage, or cracks and subsequent removal difficult.

8.4 UV STERILIZER MAINTENANCE

Follow the preventative maintenance procedures to maximize the efficiency, reliable, and longevity of the UV Sterilizer.

Refer to Table on Page 8-18 for recommended maintenance schedule.



WARNING! The most important consideration is operator safety. The following directly relates to operator safety. All personnel must review and comply with the following.

CAUTION! Operators must observe Safety Requirements at all times

Safety Requirements

The following safety requirements are mandatory. Failure to comply can cause injuries and/or damages to the UV unit.

- 1. Never look directly at the blue ultraviolet lamp when it's "ON". Never operate the ultraviolet lamp outside the stainless steel cabinet. UV light exposure can severely burn and damage eyes and skin.
- 2. Properly ground the UV unit. Failure to properly ground the UN unit can cause severe electrical shock hazard.
- 3. Provide watertight piping and compression nut seals. Failure to provide watertight seals can cause damage to electrical components or cause electrical shock hazard.
- 4. Disconnect power before servicing the UV unit. The UV lamp and electrical components operate with high voltage electrical power. Do not attempt to service the UV unit without first disconnecting the power source. Shut off the source of power at the main panel breaker and use appropriate tag-out or lock-out procedures to prevent accidental power-up.

- 5. Only qualified service personnel should perform services to the UV unit.
- 6. Remove pressure before servicing the UV unit.
- 7. Never operate the UV unit for more than 30 minutes without water flow. Elevated water temperature can damage the UV unit.
- 8. Do not exceed 3 "Start/Stop" cycles per 24-hour period. Exceeding 3 cycles will subjected the lamp filament to excessive thermal stress leading to premature failure of the UV lamp.

Unit Maintenance

The exterior surfaces of the UV unit should be kept clean and dry. In most cases it may be necessary to clean the exterior of the unit once a month. Use soft cloth and soapy water, or any commercial stainless steel cleaner.

Interior of the ballast box should be inspected for debris. Any debris should be removed using vacuum.

Quartz Sleeve

Debris and other matter in the water will settle onto the quartz sleeve and eventually block the ultraviolet rays from penetrating into the water. It is necessary to determine a cleaning schedule for the quartz sleeve. The frequency will depend on the specific type of water being processed and the duty cycle of the unit.

Inspect the quartz sleeve 30 days after initial installation to assess the amount of contamination collected over the 30-day period. Use the finding to determine a reasonable schedule and frequency for periodic cleaning.

Clean-In-Place (CIP) cleaning is sometimes effective in removing debris from the quartz sleeve. Conduct a CIP cleaning test to determine its effectiveness. If CIP cleaning is not effective, then a manual cleaning or replacement is required.

When the quartz sleeve is due for cleaning, use the following procedures.

- 1. Turn off the water source to the UV unit.
- 2. Disconnect the power source to the UV unit.
- 3. Drain the UV treatment chamber.
- 4. Remove the ballast box cover.
- 5. Remove rubber boot and carefully pull out the UV lamp through the compression nut pass-thru.
- 6. Use a channel lock to remove the compression nuts.
- 7. Remove the Quartz Sleeve carefully.

Maintenance

8. Wash the Quartz Sleeve with mild soapy water and rinse in clean hot water.

If dirt remains after rinsing, the quartz sleeve should be replaced. Contact your local CSR to order a replacement.



NOTE! Failure to perform quartz sleeve maintenance may reduce the efficiency of the UV light to adequately treat water in the treatment chamber.

Checking for Leaks

Visual inspect the UV unit exterior for signs of leakage. The cause of any leakage must be located and repaired.

If a leakage is detected, perform the following.

- 1. Shut off all electrical power. Shut off the source of power at the main panel breaker and use appropriate tag-out procedures to prevent accidental power-up.
- 2. Depressurize the UV unit.
- 3. Remove ballast box cover and remove the rubber boot.
- 4. Locate which end of the quartz sleeve is leaking.

Repairing Leaks

If both ends of the quartz sleeve are leaking, perform the following on both ends.

- 1. Use a channel lock to loosen and remove the compression nut.
- 2. Remove the quartz sleeve O-ring without pulling the quartz sleeve out.
- 3. Lubricate the quartz sleeve tip with clean water and place new O-ring. Ensure the O-ring has allround contact with the cylinder pass-thru.
- 4. Replace and tighten the compression nut.
- 5. Refill the treatment chamber and verify a leak-free condition.

Measuring Performance

Every UV unit must be tested periodically to verify its efficiency. Regardless of the intended application or any optional equipment provided with the UV unit, the most accurate procedure is the Post-UV Analysis. The Post-UV Test must be performed in accordance with standard testing methods.

Verifying Lamp Operation

The UV lamp is "ON" when the blue light is emitting thru the viewport.

Obtaining Water Samples

Vast majority of unsatisfactory Post-UV Test results are directly related to the improper sample-taking techniques. Although several commercial sample collection apparatuses are available, the proper manufacturer's sample procedures must be followed.



NOTE! Sea Recovery recommends a valve with a discharge orifice not to exceed 1/4" (6mm).

Sampling Procedure

Use sterile sample bottles obtained from reliable laboratory that has been autoclaved and kept in plastic bag for this procedure.

- 1. Use temporary tube to direct water from UV unit to container or drainage.
- 2. Pressurize the UV unit and flush unit with sample valve fully opened for 3.5 minutes. After flushing for 3.5 minutes, reduce valve opening to 50% and flush for 3 minutes.
- 3. Open the sample bottle and keep the inside of the cap facing down.
- 4. Fill the sample bottle and avoid breathing directly into the bottle or touching the inside of the bottle, cap, or neck.
- 5. Immediately cover and secure the cap after filling the sample bottle.
- 6. Label the sample bottle and place in a clean plastic bag.
- 7. Take sample bottle to the laboratory for plating as soon as possible.
 - **NOTE**! Sample processing must begin within 3 hours after sample collection and must comply with accepted standard methods.

Periodic Maintenance Table

The table below represents the recommended Periodic Maintenance (PM) for the SP Series UV Unit.

Description	Init.	Daily	Mn	Ann.	Other
Quartz Sleeve Cleaning	х				
Quartz Sleeve Replacement*	Х				
Operating Condition	х				
Unit Cleaning	Х		х		
Leak Inspection	х	х	Х		
UV Lamp Inspection	х	х	Х		
UV Lamp Replacement-SP-1				Х	4,400 hrs
UV Lamp Replacement-SP-2				Х	8,000 hrs

* Quartz Sleeve replacement will occur more frequently for systems operating with continuous high flow rate or low water quality water, and less frequently for systems operating with low flow rate or high water quality.

UV Unit Specifications

Туре	12 VDC Operating UV Sterilizer for 2 gallon (7.5 liters) per minute of water flow
Ballast Type	Solid State
Bulb Type	16 Watts Single Ended
Bulb Life	8000 Hours minimum
Materials	Body: SS304; Ballast Box: PVC
Power Cord	13 ft. (4 meters) 2 conductors
Weight	1 lbs. (500g) Body
Temperature Range	Operating: +37°F to +104°F (+3°C to +40°C); Dry Storage: -4°F to +185°F (-25°C to +85°C)
Operating Voltage Range	10.56V minimum; 16.50V maximum
Current	1.45A maximum @ Standard Test Voltage
UV Dosage	22mJ/cm2 @ 254nm
Operating Pressure	50psi (3.4 bar)
Inlet/Outlet Ports	1⁄4 in. (6.3 mm) NPT Female
Flow Rate	2 gpm (7.5 lpm)
Disinfection Rate	99%

Aqua Whisper DX Modular 450-1800 Section 9 - TROUBLESHOOTING

9 TROUBLESHOOTING

This section deals with abnormal occurrences of the System. Some occurrences may have many different causes. For each symptom, one or more causes are given. In turn, each cause has one or more corresponding tests to help identify whether the cause of the occurrence is the correct one. When the test has confirmed the source of the problem, the appropriate remedy is given to correct it.

There may be more than one cause of a problem. In the following guide, when there is more than one cause of a problem, the causes are listed in the most likely to occur order. The tests given are designed to determine whether the cause of the problem is the correct one. When diagnosing the causes of a problem in this case, eliminate the listed causes one by one until the correct cause is found. Then the appropriate remedy is performed. Diagnosing and correcting the various occurrences in this manner makes troubleshooting easier and less time consuming.

Troubleshooting and subsequent correction or repair will require understanding of:

- a) Electrical Circuits
- b) Electronic Circuits
- c) Electric Motors
- d) Hydraulic Systems
- e) Liquid Pressures and Flows
- f) Electromechanical Systems
- g) Mechanical knowledge and skills

WARNING! Do not attempt troubleshooting and/or subsequent correction or repair if you are not familiar with or are not proficient in the above fields of expertise.

USE CAUTION WHEN TROUBLESHOOTING.

DO NOT PERFORM MAINTENANCE UNLESS:

- a) The System Feed Water Sea Cock Valve is closed.
- b) The electrical power to the system is switched "OFF", LOCKED, and TAGGED.
- c) Section 10, "EXPLODED PARTS VIEW" is available.

CAUTION!: ELECTRICAL SHOCK HAZARD. A Volt / Ohm Meter will be necessary. The following procedures expose the technician to High Voltage and electrical shock hazard. Only attempt this if you are a qualified electrician and only if surrounding conditions are safe.

From time to time, Sea Recovery may make changes to the Control Logic.

Other production changes are tracked by Sea Recovery through the System Serial Number.

Troubleshooting methods and results can vary depending on the information that is displayed at the SYSTEM INFORMATION screen.

Whenever requesting assistance from Sea Recovery or one of Sea Recovery's service dealers:

ALWAYS PROVIDE ALL INFORMATION DISPLAYED AT THE SYSTEM INFORMATION SCREEN.

9.1 ALARM AND ERROR SCREENS

The following alarm and error screens provide operator information regarding the condition of the System. Where applicable, the alarm message (yellow background) or error message (red background) will recommend the corrective action to eliminate the system alarm or error.



- 1. Fresh Water Tank full.
- 2. Product flow was out of specifications. Check for leaks and wiring connections.
- 3. Conductivity sensor (#) failed measuring. Check wiring.
- 4. Fresh Water Tank was too low. Fresh Water Flush stopped.
- 5. Flow error in the Fresh Water Flush Operation. Check for leaks or blockage in the Fresh Water Supply.
- 6. Product flow is low. Check water temperature and reverse osmosis membrane.
- 7. Unable to communicate with the selected water maker. Check the water maker.
- 8. The TDS salinity level at the product water line is too high. The system is unable to clean the water. Check for mechanical failure.
- 9. Pressure drop on inlet Filters to excessive. Check filters.
- 10. User initiated emergency break.
- 11. Power has been interrupted while the system was in operation. The system will not restart automatically.
- 12. Inlet Pressure of the High Pressure Pump dropped below specifications. Check Booster Pump and filters.
- 13. Outlet pressure of High Pressure Pump exceeded the specifications. Check Brine Discharge, Product Water lines and Post Filtration.
- 14. Brine Discharge flow was out of specifications. Check for leaks and wiring connections.
- 15. Warning on the water maker. For detailed information please check warning on the water maker display.
- 16. Alarm on the water maker. For detailed information please check alarm on the water maker display
- 17. Low Pressure Sensor (#) failed to measure the pressure. Check wiring.
- 18. High Pressure sensor failed to measure the pressure. Check wiring.
- 19. Temperature Sensor (#) failed to measure the temperature. Check wiring.

9.2 TROUBLESHOOTING COMPONENTS

Refer to the P&ID in Section 3.

Blockage at the Inlet Thru-Hull Fitting causes the System to shut off due to lack of Feed Water Flow. This can cause time consuming frustrations in attempting to gain feed water flow by trouble shooting other components in the System.

The Inlet Thru-Hull Fitting must be free and clear allowing the System to draw 4.5 U.S. GPM (17 LPM) through it with minimal resistance. This Inlet Thru-Hull Fitting must be a Forward Facing Scoop so that the System receives a positive flow of water as the boat is under way. It must be minimum 3/4 in. (1.9 cm) inside diameter. It must be installed in a position on the bottom of the Hull so as to allow free flowing Feed Water without air.

> **CAUTION!** A flat profile, flush mount, inlet thru-hull fitting will cause a vacuum as the boat is under way, and this will cause loss of feed water flow and cavitation of the Booster Pump and High Pressure Pump resulting in continual system shut down due to low feed water flow and pressure. The resulting failure of the system to remain in operation is attributed to improper installation, is the liability of the installer, and is not covered by the Sea Recovery warranty.



CAUTION! If the thru-hull fitting has been placed in a position on the underside of the hull that allows air to continually enter the thru-hull fitting, this will cause the system to continually shut down due to loss of feed water. The resulting failure of the system to remain in operation is attributed to improper installation, is the liability of the installer, and is not covered by the Sea Recovery warranty.

CAUTION! The Sea Recovery System must not be tied into another existing auxiliary water line already supplying another accessory on the boat. Using one Thru Hull fitting for other equipment will cause the Sea Recovery System to draw air or cavitate leading to continual system shut down. The resulting failure of the system to remain in operation is attributed to improper installation, is the liability of the installer, and is not covered by the Sea Recovery warranty.



CAUTION! If the Sea Recovery System is connected to a Sea Chest or Stand Up Pipe, do not plumb the Sea Recovery System feed line to the "top" of the Sea Chest or Stand Up Pipe. If plumbed into the top of these feed water arrangements, the Sea Recovery System will experience continual shut down due to air inducement into the system. The resulting failure of the system to remain in operation is attributed to improper installation, is the liability of the installer, and is not covered by the Sea Recovery warranty. Plumb the Sea Recovery System to the "bottom" of such feed water arrangements to ensure a continual air free supply of feed water to the system.

1) THRU-HULL INLET FITTING

Problems and Symptoms appearing and caused by the THRU-HULL INLET FITTING:

a) Flat profile Inlet Thru Hull Fitting:

System runs fine when at anchor. However, when under way the System shuts off due to low pressure or low feed water flow.

A flat profile Inlet Thru Hull Fitting will cause a vacuum at the System's feed line cavitating the Booster Pump and reducing the efficiency of the Booster Pump resulting in low feed water pressure and low feed water flow.

Solution:

Change the flat profile Thru Hull Fitting to a forward facing scoop.

b) Debris is blocking the Inlet Thru Hull Fitting:

System feed water pressure is low and insufficient to keep the System in operation.

Marine growth or debris such as a plastic bag or rag covering the Inlet Thru-Hull Fitting will cause a vacuum at the System's feed line cavitating the Booster Pump and reducing the efficiency of the Booster Pump resulting in low feed water pressure and low feed water flow. **Solution**: Clean all marine growth and debris from the Inlet Thru-Hull Fitting.

System is newly installed and operation is being performed for the first time. The feed water pressure is low and insufficient to keep the System in operation.

A NEW boat, or newly installed System, may have protective shipping tape covering the Inlet Thru-Hull Fitting. A New boat, or newly installed System, may have manufacturing debris such as caulking slopped over the Inlet Thru Hull or a rag may be stuffed into the Inlet Thru-Hull fitting. A NEW Inlet Thru-Hull Fitting may have casting slag, that has not been machined off, partially covering the "fingers" or the inside of the fitting.

Solution: Inspect the Inlet Thru-Hull Fitting and clean all manufacturing debris and casting slag from the fitting.

2) SEA COCK VALVE

The Sea Cock Valve is usually a 1/4 turn Ball Valve although any positive closing and opening valve is acceptable.

Problems and Symptoms appearing and caused by the SEA COCK VALVE:

a) The Sea Cock Valve is closed when attempting to Start the System.

System does not register feed water flow and feed water pressure when attempting to start. An error screen appears and the System shuts down.

When the System is not in use it is good practice, for the safety of the Boat, to close the Sea Cock Valve. Don't forget to open it prior to starting the System.

Solution: Open the Sea Cock Valve.

b) The Sea Cock Valve seal is worn or the seal is loose causing air to enter the System Feed Line.

System feed water pressure is low and insufficient to keep the System in operation. This section of the Feed Line is under a vacuum condition when the System is in operation. If the valve's seal is worn or loose air can enter the feed line causing the System to lose pressure.

Look for air bubbles moving through the Sea Strainer, or feed line.

Solution: Change the valve seals, tighten them, or if necessary replace the valve.

3) INLET CONNECTOR

AS WELL AS ALL FITTINGS AND CONNECTIONS PRIOR TO THE INLET OF THE BOOSTER PUMP:

Problems and Symptoms appearing and caused by any fitting or connection in the Suction portion of the Feed Line:

a) One or more fittings or connections in the Suction portion of the Feed Line is causing air to enter the Feed Line.

> System feed water pressure is low and insufficient to keep the System in operation. This section of the Feed Line is under a vacuum condition when the System is in operation.

Look for air bubbles moving through the Sea Strainer, or feed line.

Solution: Tighten any loose fitting or connection at the Inlet of the Booster Pump or prior to it that is allowing air to enter the feed line.

Replace worn or broken seal or O-ring at the Inlet of the Booster Pump or prior to it that is allowing air to enter the feed line.

Check positioning of all valves at or prior to the Inlet of the Booster Pump that may be allowing air to enter the feed line.

4) INLINE VACUUM / PRESSURE GAUGES

Problems and Symptoms appearing and caused by the Inline Vacuum/Pressure Gauges:

a) A Vacuum/Pressure gauge needle does not move; or does not register proper vacuum or pressure.

The Vacuum/Pressure Gauges have a very small orifice at the bottom of the pipe fitting end. This orifice can become plugged with debris or corrosion.

Solution: Using a small diameter wire clean the debris from the orifice.

5) SEA STRAINER

Problems and Symptoms appearing and caused by the Sea Strainer:

a) The Sea Strainer O-Ring seal is not properly seated, is worn, or is not properly compressed allowing air to enter the Feed Line.

> System feed water pressure is low and insufficient to keep the System in operation. This section of the Feed Line is under a vacuum condition when the System is in operation. If the Sea Strainer

O-Ring is not properly seated air will enter the feed line causing the System to loose pressure.

Look for air bubbles moving through the Sea Strainer and into the Feed Line.

Solution: Properly seat or replace the Sea Strainer O-Ring.

The Sea Strainer mesh screen element is the first line of defense to trap large suspended solids entering the Feed Line. Depending on Feed Water conditions the screen may plug up rapidly. Marine growth, plastic bags, jelly fish, and other debris can easily enter the feed line and plug up the Sea Strainer mesh screen.

System feed water pressure is low and insufficient to keep the System in operation because the Sea Strainer mesh screen is blocking feed water flow.

Solution: Regularly check and clean the Sea Strainer mesh screen. Keep it clear and free of debris.

6) BOOSTER PUMP

b)

The Booster Pump is a centrifugal type pump. When mounted at or below feed water level it is able to draw feed water and deliver it with pressure into the prefiltration components and High Pressure Pump. If mounted above feed water level the Booster Pump may have trouble priming if air enters the feed line.

Prior to assuming that the Booster Pump's Electric Motor has failed, perform a Function Test as described in Section 6.

Problems and Symptoms appearing and caused by the Booster Pump:

a) The Booster Pump leaks feed water between the pump and motor.

The Booster Pump has a ceramic and carbon seal. Ceramic and carbon seals will weep if the pump is not operated for extended periods of time. When used regularly the seal will give approximately 2000 hours of use. The seal continually wears during use and must be replaced approximately every 2000 hours of use. If left unused for extended periods of time seal replacement may be required sooner.

Solution: Replace seal.

7) T-CONNECTOR PRESSURE PICK-UP

Booster Pump Outlet/Prefilter Inlet for line pressure pick up to Low Pressure Transducer #1 between the outlet of the Booster Pump and the inlet of the first prefiltration component.

Problems and Symptoms appearing and caused by the T-Connector Pressure Pick-Up:

a) The Low Pressure Transducer #1 does not register pressure.

The 1/4 in. (5 mm) 0.D. tube connecting the T-Connector to the Low Pressure Transducer Manifold may become kinked or debris may block the tube.

Solution: Replace any hose or tube that is kinked. Disconnect each end of the tube and blow air through the tube to ensure that it is not blocked.

8) LOW PRESSURE TRANSDUCER #1

Booster Pump Outlet or 1st Prefilter Inlet for line pressure pick up from the Outlet of the Booster Pump to the Inlet of the 1st Prefiltration component.

The Low Pressure Transducer sends a DC voltage signal to the System Control Logic. The minimum value is .5 VDC when no pressure is applied to it, and the maximum value that the System will accept is 4.5 VDC. The variation of voltage output from the Transducer is converted to pressure value by the System Control Logic.

Problems and Symptoms appearing and caused by the Low Pressure Transducer #1:

a) The Low Pressure Transducer #1 does not register pressure or the pressure displayed is inaccurate.

The 1/4 in. (5 mm) 0.D. tube connecting the T-Connector to the Low Pressure Transducer Manifold may become kinked or debris may block the tube.

Solution: Replace any hose or tube that is kinked. Disconnect each end of the tube and blow air through the tube to ensure that it is not blocked.

The pressure readings at the Touch Pad are inaccurate. The minimum voltage output is below .5VDC and or the maximum voltage output is above 5 VDC.

Solution: Check wiring and connections to and from the Transducer. Replace the Transducer.

9) PLANKTON FILTER

This optional filter assembly contains a cleanable ultra fine monel mesh screen. The mesh screen traps suspended solids or biological growth such as plankton. It also provides longer life to the Pre-filter Elements and in turn provides lower system maintenance costs. As with all prefiltration components the Plankton Filter mesh screen must be free of debris in order for the Feed Water to flow through it.

Problems and Symptoms appearing and caused by the Plankton Filter:

a) The Feed Water Pressure into the Plankton Filter is higher than normal, and the Feed Water Pressure into the High Pressure Pump is lower than normal.

> The pressure differential readings across the Plankton Filter indicate that the element is filled with debris blocking the feed water.

Solution: Clean the Plankton Filter Element.

10) MULTI MEDIA FILTER

This optional filter assembly contains a back-washable bed of sand and gravel. The sand traps suspended solids larger than 30 microns which provides longer life to the pleated cartridge prefilter elements minimizing maintenance intervals, maintenance labor, and filter element cost. Pressure and flow will be restricted as the sand bed becomes clogged with debris and marine growth. The sand bed is washable by reversing the feed water flow across it. This process is referred to as Back Washing.

Problems and Symptoms appearing and caused by the Plankton Filter:

 a) The Feed Water Pressure into the Multi Media Filter is higher than normal, and the Feed Water Pressure into the High Pressure Pump is lower than normal.

> The pressure differential readings across the Multi Media Filter indicate that the Multi Media Filter requires back washing.

Solution: Back wash the Multi Media Filter.

11) DUAL PRE-FILTER

This two stage filter removes suspended solids first through a 20 micron cartridge filter element then through a 5 micron cartridge filter element. By stepping the filtration both prefilter elements gain longer life and require less maintenance labor and prefilter element replacement cost. As the cartridge filter elements become plugged up with debris pressure and flow drop resulting in System shut down due to low pressure into the High Pressure Pump. The cartridge filter elements may be cleaned once to gain approximately 50% of the original life. After the first cleaning they must be discarded and replaced with new elements.

WARNING! PREFILTER ELEMENT:

Do not use third party prefilter elements, use only Sea Recovery prefilter elements. Third party prefilter elements do not properly fit and the seams fall apart. They also allow by-pass resulting in premature fouling of the R.O. membrane element and extensive damage to the High Pressure Pump. Damage to the R.O. membrane element or High Pressure Pump caused by the use of third party, non Sea Recovery, Prefilter Elements is the responsibility and liability of the operator and not covered by the Sea Recovery Warranty.

PREFILTER ELEMENT CAUTION! Do

not use "string wound" or "fiber" prefilter elements. These types of elements are designed for the Photographic Film Developing Industry. When used in sea water, they will plug up rapidly in 1/10th or less the time. This will cause frequent shut downs of the system and very frequent changing which will result in very high cost of maintenance and user frustration.

CAUTION! Hand tighten the bowl onto the filter top housing. DO NOT over tighten. DO NOT use any wrench or device to tighten the bowl. It is O-ring sealed, hand tightening is adequate. Over tightening will stress the bowl and top causing it to crack.

Problems and Symptoms appearing and caused by the Prefilter:

a) The Feed Water Pressure into the Prefilter is higher than normal, and the Feed Water Pressure into the High Pressure Pump is lower than normal. The pressure differential readings across the Prefilter indicate that the elements are filled with debris blocking the feed water.

Solution: Replace the Prefilter Elements.

12) COMMERCIAL PRE-FILTER

The Commercial Prefilter housing contains a 5 micron cartridge filter element that has 38 square feet of filtering surface area. This over size cartridge provides extended life that greatly reduces maintenance and prefilter element replacement cost. As the cartridge filter element becomes plugged up with debris pressure and flow drop resulting is System shut down due to low pressure into the High Pressure Pump. The cartridge filter element may be cleaned once to gain approximately 50% of the original life. After the first cleaning it must be discarded and replaced with a new element.

WARNING! PREFILTER ELEMENT: Do

not use third party prefilter elements, use only Sea Recovery prefilter elements. Third party prefilter elements do not properly fit and the seams fall apart. They also allow by-pass resulting in premature fouling of the R.O. membrane element and extensive damage to the High Pressure Pump. Damage to the Sea Recovery System caused by the use of third party, non Sea Recovery, Prefilter Elements is the responsibility and liability of the operator and not covered by the Sea Recovery Warranty.



CAUTION! Finger tighten the lid locking ring onto the base. DO NOT over tighten. DO NOT use any wrench or device to tighten the lid locking ring. The lid is O-ring sealed, two finger tightening is adequate. Over tightening will stress the threads on the base and the lid locking ring causing them to crack.

Problems and Symptoms appearing and caused by the Prefilter:

a) The Feed Water Pressure into the Prefilter is higher than normal, and the Feed Water Pressure into the High Pressure Pump is lower than normal.

Troubelshooting

The pressure differential readings across the Prefilter indicate that the element is filled with debris blocking the feed water.

Solution: Replace the Prefilter Element.

13) T-CONNECTOR PRESSURE DIFFERENTIAL PICK-UP

The T Connector is for line differential pressure pick up between optional prefiltration components to the Differential Pressure Transducer #3. This Transducer allows the operator to determine exactly which prefiltration component requires servicing.

Problems and Symptoms appearing and caused by the T-Connector Pressure Pick-Up:

a) The Pressure Differential Transducer does not register pressure.

The 1/4 in. (5 mm) 0.D. tube connecting the T-Connector to the Low Pressure Transducer Manifold may become kinked or debris may block the tube.

Solution: Replace any hose or tube that is kinked. Disconnect each end of the tube and blow air through the tube to ensure that it is not blocked.

14) PRESSURE DIFFERENTIAL TRANSDUCER

The Pressure Differential Transducer for line pressure reading across (between) prefiltration components allowing the operator to determine which prefiltration component requires servicing.

The Pressure Differential Transducer sends a DC voltage signal to the System Control Logic. The minimum value is .5 VDC when no pressure is applied to it, and the maximum value that the System will accept is 4.5 VDC. The variation of voltage output from the Transducer is converted to pressure value by the System Control Logic.

Problems and Symptoms appearing and caused by the Pressure Differential Transducer:

a) The Pressure Differential Transducer does not display on the Touch Screen.

Solution: Refer to Section 6 to Set Up and Inform the System Control Logic that the Pressure Differential Transducer has been installed and connected.

b) The Pressure Differential Transducer does not register pressure or the pressure displayed is inaccurate. The 1/4 in. (5 mm) 0.D. tube connecting the T-Connector to the Pressure Differential Transducer may become kinked or debris may block the tube.

Solution: Replace any hose or tube that is kinked. Disconnect each end of the tube and blow air through the tube to ensure that it is not blocked.

The pressure readings at the Touch Pad are inaccurate. The minimum voltage output is below .5VDC and or the maximum voltage output is above 5 VDC.

Solution: Check wiring and connections to and from the Transducer. Replace the Transducer.

15) OIL/WATER SEPARATOR

The Oil/Water Separator housing contains a 10 micron coalescing filter element. This Oil/Water Separator is positioned after the Prefilter in the Feed Water Line. Unlike a conventional cartridge filter element, the water flow is into the center and out ward. The purpose of this filter is to coalesce and trap oil so that it doesn't reach the R.O. membrane element. Oil will permanently foul the R.O. membrane element.

> WARNING! OIL/WATER SEPARATOR ELEMENT: Do not use third party Oil/ Water Separator elements, use only Sea Recovery supplied elements. Third party elements do not properly fit and will not adequately coalesce the oil from the feed water. They also allow by-pass resulting in premature fouling of the R.O. Membrane Element and extensive damage to the High Pressure Pump. Damage to the Sea Recovery System caused by the use of third party, non Sea Recovery, Oil/Water Separator Elements is the responsibility and liability of the operator and not covered by the Sea Recovery Warranty.

CAUTION! Finger tighten the lid locking ring onto the base. DO NOT over tighten. DO NOT use any wrench or device to tighten the lid locking ring. The lid is O-ring sealed, two finger tightening is adequate. Over tightening will stress the threads on the base and the lid locking ring causing them to crack. Problems and Symptoms appearing and caused by the Oil/Water Separator:

 a) The Feed Water Pressure into the Oil/Water Separator is higher than normal, and the Feed Water Pressure into the High Pressure Pump is lower than normal.

> The pressure differential readings across the Oil/ Water Separator indicate that the element is filled with debris blocking the feed water.

Solution: Replace the Oil/Water Separator Element.

16) T-CONNECTOR PRESSURE PICK-UP

Outlet of Last Prefiltration component - Inlet of High Pressure Pump

This T-Connector is for line pressure pick up to Low Pressure Transducer #2 between the outlet of the last prefiltration component and the inlet of the High Pressure pump.

Problems and Symptoms appearing and caused by the T-Connector Pressure Pick-Up:

a) The Low Pressure Transducer #2 does not register pressure.

The 1/4 in. (5 mm) 0.D. tube connecting the T-Connector to the Low Pressure Transducer Manifold may become kinked or debris may block the tube.

Solution: Replace any hose or tube that is kinked. Disconnect each end of the tube and blow air through the tube to ensure that it is not blocked.

17) LOW PRESSURE TRANSDUCER #2

Located on the High Pressure Pump Inlet. The Low Pressure Transducer #2 is for line pressure pick up at the Inlet of the High Pressure Pump.

The Low Pressure Transducer sends a DC voltage signal to the System Control Logic. The minimum value is 0.5 VDC when no pressure is applied to it, and the maximum value that the System will accept is 4.5 VDC. The variation of voltage output from the Transducer is converted to pressure value by the System Control Logic.

Problems and Symptoms appearing and caused by the Low Pressure Transducer #2:

a) The Low Pressure Transducer #2 does not register pressure or the pressure displayed is inaccurate.

Solution: Replace any hose or tube that is kinked. Disconnect each end of the tube and blow air through the tube to ensure that it is not blocked. The pressure readings at the Touch Pad are inaccurate. The minimum voltage output is below 0.5 VDC and or the maximum voltage output is above 5 VDC.

Solution: Check wiring and connections to and from the Transducer. Replace the Transducer.

18) TRANSDUCER MANIFOLD

The Transducer Manifold must be replaced if broken and allowing leakage.

19) STANDARD HP PUMP ASSEMBLY

The Std High Pressure pump is a marine quality stainless steel manifold, positive displacement ceramic plunger pump, operates with minimal noise and vibration.

Problems and Symptoms appearing and caused by the Std HP Pump:

- a) Pulsations at low and high pressure gauges.
 - **Possible cause**: Worn or broken valve, valve spring, valve seat. Debris in valve chamber.

Solution: Check valve chamber for debris, inspect valve seat. Replace valve assembly as necessary.

b) Water leaks between the pump manifold and rear crankcase section.

Possible cause: Worn seals or seals damaged due to running dry.

Solution: Inspect seals and replace if necessary.

c) Normal flow when not pressurized but flow drops dramatically when pressurized.

Possible cause: Worn seals or seals damage due to running dry, broken valve, valve spring, or debris in valve chamber.

Solution: Check seals and valve chambers, clean chamber or replace parts as necessary.

20) OPTIONAL HP PUMP ASSEMBLY

The Electric Motor is 3 horse power, Totally Enclosed Fan Cooled, 2 pole, dual Cycle, and dual Voltage.



WARNING! The High Pressure Pump MUST rotate in the COUNTER CLOCKWISE DIRECTION ONLY Rotating the High Pressure Pump in the clockwise direction will cause extensive damage to it. Never operate the High Pressure Pump in the clockwise direction. **WARNING**! When switching from Three Phase Generator power to Three Phase Shore power ALWAYS check phases prior to operating the System else Reverse Rotation along with extensive damage to the High Pressure Pump will occur should the power be out of phase.

This High Pressure Pump is a Quintiplex Radial Axial Positive Displacement Plunger Pump made of high grade Duplex material specifically designed for sea water Reverse Osmosis applications. The Pump is connected to the attached electric motor with a flex coupler and safety bell housing.

As with all Positive Displacement pumps it must receive a specified minimum amount of water at a positive pressure. A vacuum at the inlet of the pump will cause cavitation and damage. This pump does not use oil, it is self lubricated with the feed water. Internal components are designed for 8,000 hours of continual service in sea water. As with any component exposed to sea water, use is best.

Problems and Symptoms appearing and caused by the High Pressure Pump or its Electric Motor:

Prior to assuming that the High Pressure Pump's Electric Motor has failed, perform a Function Test.

a) Single Phase Motor

The Single Phase (115 or 230 VAC) Electric Motor "hums", pulls starting current (locked rotor) amperage, does not rotate, and trips the supply power circuit breaker when attempting to operate the System.

The Single Phase Electric Motor is a capacitor start motor. If the motor was started with low voltage, a drop in voltage during starting, and if this was repeated several times in rapid concession the capacitor will short out. Without the aid of a working capacitor the motor will "hum", pull starting current (locked rotor) amperage, not rotate, and trip the supply power circuit breaker when attempting to operate the System.

Low voltage will also cause the same symptom. Low voltage is caused by an undersized power supply or generator, undersized power lead wires to the System or motor, loose power wire, or connection at the motor or within the power supply line, and "burnt" contacts on the motor starter relay (contactor). **Solutions**: Check wiring size and connections to, from, and in between the Power Supply and the electric motor. Correct wire size or any loose wires.

Check the capacitor on the motor, and replace it if it has shorted out.

Measure voltage at the motor during attempt to start it. If voltage drops more than 10% locate and correct the reason.

Check the motor starter relay (contactor) for "burnt" contacts.

b) Three Phase Motor

The Three Phase (230/380/460 VAC) Electric Motor "hums", pulls starting current (locked rotor) amperage, does not rotate, and trips the supply power circuit breaker when attempting to operate the System.

The Three Phase Electric Motor requires all three power lines (all three phases) to be operative else it will "single phase" causing extensive damage to the motor's internal windings.

Low voltage will also cause the same symptom. Low voltage is caused by an undersized power supply or generator, undersized power lead wires to the System or motor, loose power wire, or connection at the motor or within the power supply line, and "burnt" contacts on the motor starter relay (contactor).

Solutions: Check wiring size and connections to, from, and in between the Power Supply and the electric motor. Correct wire size or any loose wires.

Measure voltage at the motor during attempt to start it. If voltage drops more than 10% locate and correct the reason.

Check the motor starter relay (contactor) for "burnt" contacts.

Ensure all three phases have power.

c) Grinding Sound

The Electric Motor makes an unusual "grinding" sound when operated.

Solutions: Check and replace as necessary the front and rear bearings.

Check to see if the fan is rubbing against the fan guard.

d) Grinding Noise

The High Pressure Pump makes an unusual "grinding" noise.

The pump will make a grinding noise if its drive shaft has been forced into the pump body. The Electric Motor and Pump are coupled with a "Flex Coupler" specially designed for use with this specialized pump. Never replace the Flex Coupler with another make or style. ALWAYS leave 3/32 in. (2mm) spacing between the two mating Flex Couplers. ALWAYS ensure that the Safety Bell Housing attached to the electric motor and the pump seats evenly on both ends.

Internal spacing of moving components within the High Pressure Pump hold to very tight tolerance. Any debris larger than 10 micron entering the High Pressure Pump will cause abrasion to the pump's internal parts, and will cause an audible grinding noise. Hard debris, such as sand or metal, will cause the pump to "freeze up" and will cause extensive damage to the internal parts of the pump.

If the System incorporates a Multi Media Filter use caution to not allow sand to enter the High Pressure Pump. When changing Prefilter Elements use caution to not allow debris to enter the High Pressure Pump.

Damage to the High pressure Pump caused by debris is the responsibility of the person performing maintenance to the System, is the liability of the person performing maintenance to the System, and is not covered by the Sea Recovery warranty.

Solutions: Check spacing between the motor's and pump's flex coupler. Spacing must be minimum 3/32 in. (2mm) and maximum 1/8 in. (3mm).

Check Safety Bell Housing to ensure it is flush and secured to both the motor and pump.

Check Pump for signs of foreign debris entering the inlet.

e) Decreased Pressure

The High Pressure Pump flow and or pressure have decreased from normal.

As with all High Pressure Pumps, over time of operation flow and pressure will decline due to internal wear. Under normal use and care no significant pressure or flow loss will occur for 8,000 hours of operation or longer.

Do not confuse low feed water flow and low feed water pressure with a High Pressure Pump problem. All positive displacement pumps must receive a specific flow at a minimum pressure else cavitation will occur. Check to ensure that the Booster Pump is delivering at least 4.5 U.S. Gallons (17 Liters) Per Minute of feed water at 10 to 40 PSI (69 to 276 kPa) at the Inlet of the High Pressure Pump. Note: Systems operating on 50 Hz power will deliver 3.75 U.S. Gallons (14.2 Liters) Per Minute of feed water.

Solutions: If Feed Water Flow and Pressure into the High Pressure Pump are within minimum specifications, and if the electric motor is rotating at the proper rotation (the proper cycles are present from the power source) yet the High Pressure Pump has lost Flow and or Pressure then return the High Pressure Pump to Sea Recovery for servicing.

f) Leaks between Pump and Motor

The High Pressure Pump leaks water between the pump and motor.

The HP Pump has a ceramic and carbon seal. Ceramic and carbon seals will weep if the pump is not operated for extended periods of time. When used regularly the seal will give approximately 8,000 hours of use. The seal continually wears during use and must be replaced approximately every 8,000 hours or at the sign of leakage.

Solution: Return the High Pressure Pump to Sea Recovery for service and Seal replacement.

g) Knocking Noise

The High Pressure Pump makes an unusual "very loud knocking" noise.

All positive displacement pumps will make a very loud knocking noise if they do not receive sufficient flow at a positive pressure. This knocking noise results from cavitation which is caused by insufficient feed water flow at an insufficient pressure.

Solutions: Service the Prefiltration Section (Low Pressure Section) of the System. Check all components between the Inlet Thru-Hull Fitting and the Inlet of the High Pressure Pump to determine what is causing the loss in feed water flow and pressure to the High Pressure Pump.

21) HIGH PRESSURE HOSE

The High Pressure Hose has been assembled with crimp fittings by Sea Recovery. The High Pressure Hose is NOT

repairable. Should a leak, damage, or failure develop replace the High Pressure Hose.

Solutions: Replace a damaged High Pressure Hose

22) REVERSE OSMOSIS MEMBRANE AND VESSEL ASSEMBLY

The Reverse Osmosis Membrane Element allows potable water molecules to pass through while rejecting the salt ions. Only a small percentage of the Seawater Feed becomes fresh Product Water. The remainder carries the rejected salt ions out of the R.O. membrane element in a concentrated brine stream. The R.O. System may have one or two R.O. membrane elements and Vessel in series depending on the specific model and system capacity.

Problems and Symptoms appearing and caused by the Reverse Osmosis Membrane and Vessel Assembly:

 Prior to assuming that there is a problem with the R.O. membrane elements due to your observance that:

The System does not produce the correct amount of Product Water (too much or too little)

The System produces poor quality Product Water, high in Salinity

The System Operating Pressure is excessively higher than 800 PSI (55 BAR) when operating in normal Sea Water at moderate temperatures (77° F or 25° Celsius)

The System Operating Pressure is excessively lower than 800 PSI (55 BAR) when operating in normal Sea Water at moderate temperatures (77° F or 25° Celsius)

Go to Section 6 to ensure that the Model Set-Up has been properly performed.

b) Product Water Flow suddenly and dramatically increases and Product Water Salinity increases making the Product Water unpotable:

> The Pressurized Feed Water and the unpressurized Product Water are separated by an O-Ring which seals on the Product Water Tube at each end of the R.O. Membrane element and the End Plug at each end of the Pressure Vessel. Should this O-Ring fail Feed Water will mix with Product Water. If this happens the Product Water will be very salty, the Product Water Flow will increase dramatically, and the Brine Flow will decrease appropriately (by the increase in Product Water).

Solution: Replace the O-Ring if wear or damage is present.

Should the End Plug develop a crack, between the product water port and the pressurized feed water, similar increase in Product Water flow and high Product Water salinity will occur.

Solution: Replace the End Plug if it is damaged or cracked.

At ONE end only of the R.O. membrane element there is a "U" cup seal referred to as the "brine seal". NEVER use two Brine Seals. NEVER place a Brine Seal on both ends of the R.O. membrane element. This will cause an air pocket between the outer surface of the R.O. membrane element and the inner wall of the Pressure Vessel. The air pocket would allow the R.O. membrane element to expand outward during operation causing irreversible mechanical damage to the R.O. membrane element resulting in higher than normal Product Water Flow and High Product Water Salinity.

Solution: Replace the R.O. membrane element. NEVER place two Brine Seals on one R.O. membrane element.

NEVER Block the Product Water Line. NEVER place a valve in the Product Water Line that can close and block the Product Water Line. Blockage of the Product Water line will result in high pressure build up of 950 PSI (66 BAR) within the line and within the product water tube and product water channel of the R.O. membrane element. If the System is shut down while the Product Water Line is blocked irreversible damage to the R.O. Membrane element will occur.

Solution: Determine what blocked the Product Water Line and correct the condition. Replace the R.O. membrane element.

Chemical attack, one that will dissolve the membrane surface such as an oxidant like Chlorine, has destroyed the R.O. membrane element surface.

Solution: Determine the source and correct the situation. Replace the R.O. membrane element.

 Product Water Flow slowly, over months, decreases and Product Water Salinity, slowly over months, increases, quality decreases: As the Reverse Osmosis Membrane Element is exposed, operated or not, to Sea Water eventually biological matter will coat the membrane surface causing a drop in production, loss of product water flow accompanied by an increase in salt passage in the product water. Fresh Water Rinsing will minimize and slow down the biological fouling that naturally occurs. Chemical Cleaning at appropriate intervals will remove the biological fouling and extend the life of the R.O. membrane element.

Solution: Refer to Section 7 R.O. membrane element Cleaning procedures or replace the R.O. membrane element(s).

As the RO membrane element is operated eventually dissolved solids, salts or minerals, will build up on the membrane surface causing a drop in production, loss of product water flow accompanied by an increased percentage of dissolved solids, salt, in the product water. Chemical Cleaning at appropriate intervals will dissolve the salt and mineral fouling and extend the life of the R.O. membrane element.

Solution: Refer to Section 7 for R.O. membrane element cleaning procedures or replace the R.O. membrane element(s).

 Product Water Flow suddenly decreases and Product Water Salinity, suddenly increases, quality decreases:

> Chemical, one that will foul or plug up the membrane surface, or Oil attack to the R.O. membrane element will cause the production to suddenly decrease and the product water quality will suddenly worsen.

> **Solution**: Replace the R.O. membrane element(s) if they have been attacked by Chemicals or Oil.

e) Feed Water leaks from the Pressure Vessel:

The High Pressure fittings entering the Pressure Vessel are O-Ring sealed at the End Plug that they attach to. Should a leak develop at a High Pressure Fitting inspect the respective O-Ring for signs of wear or damage.

Solution: Replace the O-Ring if wear or damage is present.

The End Plugs seal against the inner surface of the High Pressure Vessel. The O-Ring that creates this seal is the "Brine O-Ring". Should a leak develop between the End Plug and the inside wall of the Pressure Vessel remove the end plug and inspect the Brine O-Rings for wear or damage. Replace them if wear or damage is present.

Solution: Replace the O-Ring if wear or damage is present.

23) HIGH PRESSURE MANIFOLD

There are no parts within the High Pressure Manifold that would require troubleshooting. If it is broken or leaks then replace it.

24) HIGH PRESSURE TRANSDUCER

The High Pressure Transducer attaches to the High Pressure Manifold measures the System Operating Pressure from the Outlet of the High Pressure Pump through the R.O. membrane and vessel and into the Automatic Back Pressure Regulator.

The High Pressure Transducer sends a DC voltage signal to the System Control Logic. The minimum value is 0.5 VDC when no pressure is applied to it, and the maximum value that the System will accept is 4.5 VDC. The variation of voltage output from the Transducer is converted to pressure value by the System Control Logic.

Problems and Symptoms appearing and caused by the High Pressure Transducer:

a) The High Pressure Transducer does not register pressure or the pressure displayed is inaccurate.

The pressure readings at the Touch Pad are inaccurate. The minimum voltage output is below 0.5 VDC and or the maximum voltage output is above 5 VDC.

Solution: Check wiring and connections to and from the Transducer. Replace the Transducer.

25) BACK PRESSURE REGULATOR

Back Pressure Regulator adjusts the system operating pressure to varying feed water temperatures and salinities.

The Back Pressure Regulator Valve contains a seal that is serviceable.

Rotating the Back Pressure Regulator clock wise to increase operating pressure until the specified flow of Product water is achieved or until the System Operating Pressure reaches 950 PSI (66 BAR) which ever comes first. The System Control Logic will not allow Product Water production to exceed the specific set flow rate.This protects the R.O. membrane element(s) from prematurely fouling. The System Control Logic will also not allow the System Operating pressure to exceed 950 PSI (66 BAR). This protects the R.O. Membrane Element(s) and the High Pressure Pump Electric Motor.

Problems and Symptoms appearing and caused by the Back Pressure Regulator:

a) The Operating Pressure does not increase or decrease when adjusting the BPR.

The set screws holding the Valve shaft may have become loose. The BPR knob is turning but the valve shaft is not.

Solution: Tighten the set screws to secure the BPR knob and valve shaft if they are loose.

b) The valve shaft does not rotate at all.

Solution: Repair or replace the Back Pressure Regulator.

26) BRINE DISCHARGE FLOW METER

The Brine Discharge Flow Meter measures the brine water rate of flow from the R.O. Membrane Element and Vessel. By adding the amount of Product Water flow to the Brine Discharge Flow the operator is able to determine the total Feed Water Flow which is helpful in diagnosing problems with the High Pressure Pump.

Problems and Symptoms appearing and caused by the Brine Discharge Flow Meter:

Prior to assuming that the Brine Discharge Water Flow Meter has failed, check the Control Logic model setup. Refer to Section 6.8.

a) The Brine Flow Meter does not register the proper Brine Water Flow at the Touch Pad.

Debris may be trapped within the flow meter body causing false readings.

Solution: Remove the Flow Meter from the System. Using a water hose force water into the outlet of the flow meter to dislodge any trapped debris.

Solution: Replace the Brine Flow Meter.

There may be a substantial water leak prior to the Brine Flow Meter resulting in a lower than normal reading.

Solution: Correct and repair any water leaks.

Feed Water may be exiting the Product Water Line resulting in lower than normal Brine Water Flow. Abnormalities that would allow Feed Water to by-pass into the Product Water Line would include: The R.O. membrane element is not installed; the R.O. membrane element is damaged allowing brine water to mix with product water; a damaged O-Ring or cracked End Plug is allowing brine water to mix with product water. All of these abnormalities result in higher than normal Product Water Flow reading and lower than normal Brine Flow reading.

Solution: Ensure that the R.O. membrane elements are installed. Replace any damaged R.O. membrane elements. Replace any damaged Product Water O-Rings. Replace any cracked End Plugs.

b) The Brine Flow Meter does not register any flow at all at the Touch Pad.

There may be a loose wire, loose connection, broken wire, or damaged Flow Meter.

Solution: Check all wiring and plug connections. Replace the Flow Meter if determined to be non functional.

27) BRINE DISCHARGE T-CONNECTOR

This T connector collects the brine discharge water and unpotable product water for routing out of the System in one line. If it breaks or leaks replace it.

28) BRINE DISCHARGE CONNECTOR

This 90° elbow fitting or Multi Media Filter Waste T fitting attaches to the over board thru-hull fitting for connecting the brine discharge hose. If it breaks or cracks replace it.

29) THRU HULL DISCHARGE FITTING**

The Discharge Thru-Hull Fitting should be installed above water level for discharge of the Brine Discharge Water from the system. If it breaks or cracks replace it.

30) PRODUCT WATER T COLLECTOR

The T collector combines the product water from the two individual R.O. Membrane Elements. If it breaks or cracks replace it.

31) SALINITY PROBE

The Salinity Probe electronically measures, with temperature compensation, the salinity content of the Product Water. The Salinity Probe is calibrated at the factory to 800 PPM TDS NaCl at 77° Fahrenheit (25° Celsius). Although the Salinity Probe is temperature compensated, it is not 100% linear across the full range that it must measure. The full range of salinity that the probe must attempt to measure is from 5 to 2000 PPM at 34° to 122°F (1° to 50° Celsius). Always reference the probe accuracy and calibration to 800 PPM TDS NaCl at 77° Fahrenheit (25° Celsius).

Debris or biological growth can cause the Salinity Probe to give incorrect measurement of the Product Water Salinity.

Solution: Clean the Salinity Probe contact pins annually or at any sign of incorrect reading.

The Salinity Probe may have drifted from it's original calibration point.

Solution: Replace the Salinity Probe.

32) PRODUCT WATER FLOW METER

The Product Water Flow Meter measures the Product water rate of flow from the R.O. Membrane Element and Vessel. By adding the amount of Product Water flow to the Brine Discharge Flow the operator is able to determine the total Feed Water Flow which is helpful in diagnosing problems with the High Pressure Pump.

Problems and Symptoms appearing and caused by the Product Water Flow Meter:

Prior to assuming that the Product Water Flow Meter has failed, check the Control Logic model setup.

a) The Product Flow Meter registers higher than System Product Water Flow specification at the Touch Pad.

Model set up was performed incorrectly at the Touch Pad.

Solution: Check control logic setup. Refer to Section 6.8.

One of the following abnormalities is causing High Product Water Flow: Damage to the R.O. membrane element; a Product Water O-Ring; an End Plug is cracked and allowing Brine Water by-pass into the Product Water; a blockage in the Brine Discharge Line is causing reverse flow of Brine Water into the 3-way Product Water Diversion Valve.

Solution: Locate the damaged R.O. membrane element(s) and replace it/them. Locate the damaged or missing Product Water O-Ring and replace it. Locate the cracked End Plug and replace it. Locate the blockage in the Brine Discharge Line.

The Product Water Flow rate is lower than normal because the Feed Water temperature is lower than normal, the Feed Water salinity is higher than normal, or the R.O. membrane element is fouled.

Solution: If Temperature or Salinity of the Feed Water are the cause of the lower than normal Product Water Flow rate this is normal and no corrective action is required.

If the reason for lower than normal Product Water Flow rate is due to fouled R.O. membrane element(s) refer to R.O. Membrane Element cleaning procedures in Section 7, or replace the R.O. membrane element(s).

33) 3-WAY PRODUCT WATER DIVERSION SOLENOID VALVE

The 3-Way Product Water Diversion Solenoid Valve, Electric Solenoid Actuated, is energized by the System Electronic Controller to the "Potable" position when the system produces water which meets the set salinity requirement. If the Product Water being produced is "Unpotable", high in salinity, then no signal is sent to the valve, and it thus remains in the normal open position. The "fail safe" normal open position diverts the unpotable Product Water to discharge.

Problems and Symptoms appearing and caused by the 3-Way Product Water Diversion Solenoid Valve:

Prior to assuming that the 3-Way Product Water Diversion Valve's Solenoid has failed, perform a Function Test as described in Section 6.4.

a) The 3-Way Product Water Diversion Solenoid Valve is allowing Brine Discharge Water to mix with Potable Water.

> There is a blockage in the Brine Discharge line creating pressure on the Brine Water. This abnormal pressure is forcing open the seat of the 3-Way Product Water Diversion Solenoid Valve allowing Brine Water to mix with Product Water.

> **Solution**: Determine the cause of excess pressure in the Brine Discharge Line and correct it so that no back pressure is present in the Brine Discharge Line.

The 3-Way Product Water Diversion Solenoid Valve seat is not properly allowing Brine Water to mix with Product Water.

Solution: Replace Valve.

 b) The 3-Way Product Water Diversion Solenoid Valve does not switch to Potable Water even though the Touch Pad indicates that the System is OK performing normally and producing Potable Product Water. The Solenoid is not actuating the Valve's seat.

Solution: Check for 12 VDC at the valve's Solenoid, and at the Main Printed Circuit Board. Check for loose Wire and correct it.

Check the valve's solenoid continuity and functionality, refer to Section 8. Replace the Solenoid Valve if the Solenoid is found to be non-functional.

c) The 3-Way Product Water Diversion Solenoid Valve is always in the "good water" position even when the Touch Pad indicates that the Product Water is high in salinity.

The Manual By-Pass button located on the side of the solenoid is in the Manual By-Pass position.

Solution: Release the button to the normal position. Refer to Section 8.

34) CHARCOAL FILTER

The Charcoal Filter is designed to remove foul odors from the Product Water. Sulfurous odor (rotten egg smell) transmitted to the Product Water is caused when biological matter decays in the feed water section. Fresh water flushing of the system helps to minimize this.

Problems and Symptoms appearing and caused by the Charcoal Filter:

a) The Product Water has a smell of rotten egg.

The smell originates in the Feed Water and passes through the R.O. membrane element into the Product Water.

Solution: Change Prefilter Elements with new elements and Fresh Water Flush the System to minimize the decaying biological matter.

Change the Charcoal Filter Element with a new element.

Drain and replace the Product water in the Fresh Water Tank.

35) pH NEUTRALIZING FILTER

The product water from the system will be slightly acidic, approximately pH 6.5. This is normal for any Reverse Osmosis System. The pH Neutralizer Filter replaces alkaline, calcium carbonate, which neutralizes the pH of the product water back to a normal of pH 7.5. The life of the neutralizing cartridge depends on the amount of use, amount of product water flowing through it. Replace the element as necessary.



CAUTION: Use only Sea Recovery replacement pH cartridges. Third party pH cartridges are for use with very low flow rates and cause excessive restriction resulting in Product Water Line pressure build up. These third party cartridges will damage the R.O. Membrane Element and components in the Product Water Line. Damage to the Sea Recovery System caused by the use of Non Sea Recovery supplied pH Neutralizing Cartridge is the liability and responsibility of the operator and not covered by the Sea Recovery Warranty.

36) ULTRA VIOLET STERILIZER***

The UV Sterilizer destroys at least 99.9% of any virus, bacteria, and other micro-organisms which may pass through the R.O. Membrane Element. The UV sterilizer is recommended if the Product Water Storage Tank is not otherwise treated by means such as chlorination.

The UV Lamp is rated for approximately 4,400-8,000 hours of use. When the intensity of the lamp diminishes replace the lamp.

Problems and Symptoms appearing and caused by the Ultra Violet Sterilizer:

Prior to assuming that the UV Sterilizer Ballast and or Lamp have failed, perform a Function Test as described in Section 6.4.

 a) The UV Lamp is not properly functioning: The UV Lamp flickers on and off and does not remain illuminated steady.

> **Solution**: Replace the UV Lamp with a new lamp. The UV Lamp illuminated steady but has lost it's original intensity.

> **Solution**: Replace the UV Lamp with a new lamp. The UV Lamp does not illuminate at all.

> Solution: Replace the UV Lamp with a new lamp.

Check the condition of the UV Lamp Ballast to ensure its functionality.

37) PRODUCT WATER CONNECTOR

The Product Water Connector attaches to the Potable Water unpressurized tank for connection of the Product Water hose. Replace it if it is damaged or cracked.

38) POTABLE WATER STORAGE TANK**

Storage tank may be any non pressurized container suitable for storing Potable Water, i.e. existing water storage tank on a boat or cistern for a home. This container must not be pressurized.

39) AIR ENTRAINMENT TANK** (accumulator)

Some Fresh Water Pressure Systems rely only on the Pressure Pump to deliver pressurized Fresh Water to the boat or home piping. Other Fresh Water Pressure Systems incorporate an Air Entrainment Tank. It is not important to the System which configuration the boat or home has. The only requirement to the System, for Fresh Water Flushing, is that the Fresh Water Pressure System in the boat or home must deliver to the System during the Fresh Water Flush cycle a minimum of 4.5 U.S. Gallons (17 Liters) Per Minute at minimum 25 PSI (173 kPa) If the Fresh Water Flush cycle is unable to perform due to insufficient Fresh Water flow and pressure replace the Pressure Pump with a pump capable of meeting the minimum standards stated above.

40) AUTOMATIC FRESH WATER FLUSH

Includes a 2-Way Solenoid Valve, potable water Check Valve, Carbon Filter, and feed water Check Valve that allow automated flushing of the System with Fresh Water. This process is automatic at each shut down of the system and repeats automatically. Fresh Water Flushing replaces the seawater in the system with less corrosive fresh water, and this also reduces the biological growth and subsequent decay that naturally occur if the feed water (sea water) is not flushed from the system with fresh water during disuse.

- a) Fresh Water 2-Way Solenoid Valve energizes to allow fresh water to flush the System at shut down and automatically every preset number of days. In the de-energized position the valve isolates the feed water from the fresh water.
- b) Potable water Check Valve is another safe guard to isolate the fresh water from the feed water.
- c) Fresh Water Flush Carbon Filter removes chlorine, if present, in the fresh water prior to flowing through the R.O. Membrane Element.
- Feed water Check Valve ensures that the fresh water used to flush the system travels through the system and prevents it from exiting the inlet thru hull fitting.

Fresh Water Flush 2-Way Solenoid Valve is normally closed and actuates to open during the fresh water flush cycle to allow fresh water into the system.

Problems and Symptoms appearing and caused by the Fresh Water Flush 2-Way Solenoid Valve:

 The Fresh Water Flush Cycle is off but fresh water is passing through the Fresh Water Flush 2-Way Solenoid Valve

The valve ports may be improperly allowing by-pass.

Solution: Replace the valve.

 b) The Fresh Water Flush Cycle is on but fresh water does not pass through the Fresh Water Flush 2-Way Solenoid Valve

The valve ports may be improperly allowing by-pass.

Solution: Replace the valve.

The valve's solenoid may be electrically non functional.

Solution: Check for 12 VDC. If present, replace the valve. If 12 VDC is not present troubleshoot the electronics.

Fresh Water Flush Check Valve stops feed water from entering the potable water line.

Problems and Symptoms appearing and caused by the Fresh Water Flush 2-Way Solenoid Valve:

a) The Fresh Water Flush Check Valve is allowing feed water to mix with potable water.

Solution: Replace the Fresh Water Flush Check Valve.

Fresh Water Flush Charcoal Filter removes chlorine, if present, in the fresh water prior to flowing through the R.O. membrane element.

Problems and Symptoms appearing and caused by the Fresh Water Flush Charcoal Filter:

a) The Charcoal Filter is no longer removing the chlorine from the Fresh Water.

As the Charcoal Filter becomes saturated it looses its ability to remove chlorine from the Fresh Water.

Solution: Replace the Charcoal Filter Element every 3 months.

Fresh Water Flush Tee Connector and Check Valve stops fresh water from exiting the Inlet Thru Hull Fitting and routes the fresh water through the system during the Fresh Water Flush Cycle. If debris causes the valve to not properly seat clean the internal components of the valve.

41) RINSE CLEAN INLET VALVE*** and RINSE CLEAN OUTLET VALVE***

These two 3-way PVC Ball Valves are used in conjunction with each other to simplify the storage and cleaning procedures by allowing the operator to turn a valve rather than disconnect a hose. Also used for a manual fresh water flush if the Automatic Fresh Water Flush System is not installed.

Problems and Symptoms appearing and caused by the Rinse Clean Inlet and Outlet Valves:

a) The position of these valves cause the feed and brine water to travel in a specific direction.

If the direction of feed water and or brine water travel is incorrect then one or both of the valves are positioned incorrectly for the given operation or cycle.

Solution: Refer to the Piping and Interconnect Diagrams to determine the proper positioning of these valves.

42. CLEANING BUCKET**

This can be any non ferrous (non iron) container capable of holding at least 10 U.S. Gallons (37.8 Liters) of water. This container is used during the R.O. membrane Element cleaning, storing, or winterizing process.

a) The bucket or container must not leak.

The bucket or container leaks.

Solution: Replace the leaky bucket or container.

9.3 ELECTRICAL TROUBLESHOOTING

CAUTION - ELECTRICAL SHOCK HAZARD: A Volt / Ohm Meter will be necessary to Troubleshoot and Repair abnormalities or failures in the Electrical and Electronic circuits and components. The following procedures expose the technician to High Voltage and electrical shock hazard. Only attempt this if you are a qualified electrician and only if surrounding conditions are safe.

1. SYSTEM TOUCH SCREEN

The System Touch Screen is where all system functions are operated by touching the screen and where all operating conditions are monitored. Problems and Symptoms appearing and caused by the Touch Pad:

 The Touch Screen "blacks out" or "whites out".
 Extreme temperatures will cause an LCD Touch Screen to gain or loose contrast.

Solution: Bring the temperature in the area to a more moderate setting.

b. The Touch Screen is sometimes slow in responding. The System Control Logic is continually processing a great amount of data while controlling various aspects and components within the System. Some of the data being processed is critical and takes priority, such as monitoring the System Operating Pressure. During data processing or control the Control Logic will process or control the critical aspects of operation prior to responding to commands from the Touch Screen. In other words, it places less priority on your command if it is involved in a critical process. However, the command given from the Touch Pad for Emergency Stop will take priority over all other functions.

> **Solution**: Delayed response to Touch commands is normal depending on the data being processed at that instant by the System Logic Controller.

c. The Touch Screen "freezes" or "locks up" on a specific screen and does not allow further Touch Commands.

Control Logic has become scrambled and bidirectional communication between the Touch Screen logic and the Main Printed Circuit Board logic are corrupted.

Solution: Re-boot the System. Switch power off to the System, wait at least 30 seconds, and reapply power to the System. Start the System and operate normally.

d. The Touch Screen accepts some commands but not other commands. The commands that it does not accept are all physically located in the same area on the Touch Screen.

The Touch Screen can become damaged in a specific physical area of the Screen, as well as the whole screen, causing no response from a Touch command.

Solution: Confirm that a specific area of the screen, or entire screen, is non responsive. Replace the Touch Screen.

e. The Touch Screen does not illuminate when power is applied to the System.

Power and control signals may not be reaching the Touch Screen.

Solution: Check for a loose wire or connection between the Main Printed Circuit Board and the Touch Screen.

e. The Touch Screen does not respond when Touching a "switch" or feature directly over the outline of the "switch" or feature. However, the Touch Screen does respond if the Screen is Touched below, on top of, or to the side of the same "switch" or feature.

> The LCD Touch Screen must be calibrated (aligned) during the manufacturing assembly process. If the calibration (alignment) has drifted the active response area will not be in alignment with the "switch" or feature.

Solution: Replace the Touch Screen.

2. REMOTE CONTROL TOUCH PANEL***

Refer to SYSTEM TOUCH SCREEN for similar troubleshooting.

3. SOFT MOTOR STARTER***

The Soft Motor Starter, used only in AC (Alternating Current) Single Phase systems, reduces the initial startup amperes required to start the motor and in turn allows a smaller sized KW generator to start the system. Starting amperage is reduced by 40% with the Soft Start installed. The maximum design rated Horse Power that the Soft Motor Starter will accept is 3 Horse Power.

Should the Soft Motor Starter fail to function refer to wiring diagrams in Section 4. Check all wiring for correct position and tight connection. Check wiring from the incoming power, through the Soft Motor Starter, and at the Electric Motor that it is controlling.

Owner or Installer Supplied Items that are Not Numbered or shown on the Piping and Interconnect Diagrams but are included in the Electrical Diagrams in Section 4:

FRESH WATER TANK LOW LEVEL SWITCH **:

This owner/installer supplied Fresh Water Tank Low Level Switch provides an optional feature to the System Control Logic that works in conjunction with the Automatic Fresh Water Flush option.

When installed and connected to the Main Printed Circuit Board, the Fresh Water Tank Low Level Switch must be connected as a N.O. (Normally Open) 1PST (One Pole Single Throw) switch.

When the Fresh Water Tank is empty the switch is Open. As water rises a few inches in the tank the switch Closes. This informs the System Control Logic that there is sufficient Fresh Water to perform the Automatic Fresh Water Flush Cycle.

If this Switch is Open, indicating that the Fresh Water Tank is empty the Fresh Water Flush cycle will be automatically canceled by the System Control Logic.

FRESH WATER TANK HIGH LEVEL SWITCH **:

This owner/installer supplied Fresh Water Tank High Level Switch provides an optional feature to the System Control Logic that allows the System to shut off automatically when the Fresh Water Tank is full, when the System is operated in the Automatic mode. Additionally, the System will not start in the Automatic mode when the Fresh Water Tank High Level Switch signals the System Control Logic that the Fresh Water Tank is full.

When installed and connected to the Main Printed Circuit Board, the Fresh Water Tank High Level Switch must be connected as a N.C. (Normally Closed) 1PST (One Pole Single Throw) switch.

When the Fresh Water Tank is several inches below the full mark the switch is Closed. As water rises and reaches the top of the full mark the switch Opens. This informs the System Control Logic that the Fresh Water Tank is full, the System will shut down if operating in the Automatic mode, and the System will not start in the Automatic mode.

If operation of the System is desired when the Fresh Water Tank Switch signals the System Control Logic that the Fresh Water Tank is full then the System may be operated in the Manual mode.

4. ELECTRICAL CHASSIS

The Electrical Control Box contains all of the Electronic and Electrical circuits and components. Troubleshooting of major components is described below:

- a. Fuses
- b. High Pressure Pump Contactor
- c. Booster Pump Contactor
- d. Fresh Water Flush Relay
- e. Customer Supplied Alarm
- f. 12 VDC Power Supply

- g. Main Printed Circuit Board
- h. Step Down Transfer used in 3 phase systems only

Additional external devices connected to the Main Printed Circuit Board:

- a. UV Sterilizer
- b. 3-Way Product Water Diversion Solenoid Valve

1 Fuses

There are 2 fuses protecting the 12 VDC Power Supply primary circuit. Should one or both of these fuses fail this is an indication of high current draw from any one of several 12 VDC devices in the System. Devices powered from the 12 VDC produced by the 12 VDC Power Supply include:

- a. Main Printed Circuit Board/Main Touch Screen
- b. Remote Touch Screen
- c. High Pressure Pump Contactor
- d. Booster Pump Contactor
- e. Fresh Water Flush Relay
- f. Automatic Fresh Water Flush Valve Motor Actuator
- g. 3-Way Product Water Diversion Valve Solenoid
- h. UV Sterilizer

Troubleshooting the cause of fuse failure must include physical inspection and electrical check of all of these devices and all wires connected to these devices in order to pinpoint the cause of the high current resulting in the failure of the fuse(s).

The System can operate on one bad fuse but if both fuses are bad the System will not operate.

2 High Pressure Pump Contactor

Should the High Pressure Pump Electric Motor fail to start check for operating voltage at the following component and in the following order:

- a. High Pressure Pump Electric Motor Power Leads at the Electric Motor Junction Box
- b. Main Terminal Strip power from Contactor to Motor
- c. High Pressure Pump Contactor T (Terminal)
- d. High Pressure Pump Contactor L (Line)
- e. Main Terminal Strip power from Power Source to Contactor

Check for Control Voltage at the Terminal Strip.

3 Booster Pump Contactor

Should the Booster Pump Electric Motor fail to start check for operating voltage at the following component and in the following order:

- a. Booster Pump Electric Motor Power Leads at the Electric Motor Junction Box
- b. Main Terminal Strip power from Contactor to Motor
- c. Booster Pump Contactor T (Terminal)
- d. Booster Pump Contactor L (Line)
- e. Main Terminal Strip power from Power Source to Contactor

Check for Control Voltage at the Terminal Strip.

4 Customer Supplied Alarm

The maximum allowable current consumption at the customer's supplied alarm is 1 Ampere at 12 VDC.

5 12 VDC Power Supply

The 12 VDC Power Supply provides power to:

- a. Main Printed Circuit Board/Main Touch Screen
- b. Remote Touch Screen
- c. High Pressure Pump Contactor
- d. Booster Pump Contactor
- e. Fresh Water Flush Relay
- f. Automatic Fresh Water Flush Valve
- g. 3-Way Product Water Diversion Valve Solenoid
- h. UV Sterilizer

If the 12 VDC Power Supply is not functional then all of the above components will not function, and the System will not function.

Should the 12 VDC Power Supply fail, check for allowable high voltage (64 to 264 VAC) into it and regulated low voltage (12 VDC) out of it:

- a. Check for operating voltage at the electrical chassis supplying voltage to the 2 fuses
- b. Check for operating voltage at the input of the 2 fuses
- c. Check for operating voltage at the output of the 2 fuses
- d. Check for operating voltage at the input of the 12 VDC Power Supply
- e. Check for 12 VDC at the output of the 12 VDC Power Supply.

6 Main Printed Circuit Board

The Main printed Circuit Board (inside the Main Touch Screen) controls, supplies power to, and or receives signals from the various electronic and electrical components within the System.

Always troubleshoot and track voltage at the end of the line first and work your way up to the start of the line. For example, when determining why a Booster Pump is not operating first check the voltage at the Booster Pump and work your way back to each component checking for voltage across each connection and each component.

7 Step Down Transformer used in 3 phase systems only


The Step Down Transformer is not required for single phase systems. It is only required for three phase systems. It accepts the high voltage operating power at its primary and steps the voltage down to 115 VAC out of the transformer's secondary for primary input power to the 12 VDC Power Supply.

SYSTEM MAIN CONTROLLER UPDATE AS OF 10/30/2017

System Fault Error Messages

The Aquamatic, Aquamatic XL and AquaWhisper DX control system contains fault log message center. During operation, if a dangerous condition exists, or a critical monitoring component fails which would result in the control systems inability to accurately detect a dangerous condition. The detected condition or failure is deemed as a 'Critical Error'. These types or faults result in a rapid shutdown of the water maker and all associated equipment. The fault log message center is the information window used by the operator to examine system faults or failures.

When these operational faults or equipment failure happens, the controller will automatically switch the display screen to the following information window:

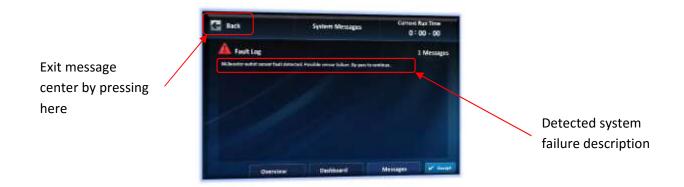

1. To stop the alarm press, Accept.

System Alarm codes and likely causes

Number	Alarm Displayed	Likely Causes	
01	Automatic start requested with system locked in E-Stop. Please clear E-Stop.	The E-Stop button was pressed in when an automatic start was requested. Release the E-stop button before continuing.	
02	System emergency stop requested in automatic mode. All moving machinery stopped.	The E-Stop button was pressed while the system was running. Release the E-stop button before attempting to run the unit again.	
03	Automatic start requested with booster pump running in manual mode.	The booster pump was running in manually mode, and the operator requested starting the system in automatic mode. Stop the booster pump in manual control screen before re-attempt to start the system in automatic mode.	

04	Booster outlet sensor fault detected. Possible sensor failure. By-pass to continue.	The booster pump outlet pressure transducer sensor is not reporting values as expected. The transducer could be unplugged, a wiring fault may exist, or the sensor itself may have failed. The fault must be fixed and cleared before running the system again. If an emergency exists the system can still be run by activating the sensor by-pass function. Please contact your dealer for help.
05	HP pump inlet sensor fault detected. Possible sensor failure. By-pass to continue.	The high-pressure pump inlet pressure sensor is not reporting values as expected. The transducer could be unplugged, a wiring fault may exist, or the sensor itself may have failed. The fault must be fixed and cleared before running the system again. If an emergency exists the system can still be run for a limited time by activating the sensor by-pass function. Please contact your dealer for help.
06	HP pump outlet sensor fault detected. Possible sensor failure. By-pass to continue.	The high-pressure pump inlet pressure sensor is not reporting values as expected. The transducer could be unplugged, a wiring fault may exist, or the sensor itself may have failed. The fault must be fixed and cleared before running the system again. If an emergency exists the system can still be run for a limited time by activating the sensor by-pass function. Please contact your dealer for help.
09	Salinity sensor fault detected. Possible sensor failure. Only manual mode permitted.	The salinity sensor temperature function is no longer readable by the control system, this is usually an indication of water penetration into the sensor itself causing failure. The system will default to manual mode only if salinity readings are still available. The user can divert potable water into the ships storage tank, but if salinity readings are not available, the user must bypass this sensor to gain access to potable water diversion functions. Please contact your dealer for help.
10	Product flow sensor fault detected. Possible sensor failure. By-pass to continue.	The product water flow meter is no longer sending reading to the controller. The sensor could be unplugged, a wiring fault may exist, or the sensor itself may have failed. Automatic operation is not available. The sensor must be fixed or replaced before Automatic mode is available. If an emergency exists, the system can still be run in automatic mode by activating the sensor by-pass function. Please contact your dealer for help.

11	Brine flow sensor fault detected. Possible sensor failure. By-pass to continue.	The brine water flow meter is no longer sending signals into the controller. The sensor could be unplugged, a wiring fault may exist, or the sensor itself may have failed. Automatic operation is not available. The sensor must be fixed or replaced before Automatic mode is available. If an emergency exists, the system can still be run in automatic mode by activating the sensor by-pass function. Please contact your dealer for help.	
12	High pressure pump inlet pressure low. Please check filtration for high fouling.	Inlet pressure to the high-pressure pump fell below minimum allowable set-points. This is usually attributed to booster pump cavitation (air in the feed line), a filter is clogged, or a large system leak. Check your system for leaks, and check feed lines for possible air vacuum leak. If none of these conditions exist, change your filtration elements and attempt to re-start the system again.	
13	High pressure pump inlet pressure high. Pump damage can occur if started.	Inlet pressure to the high-pressure pump is above maximum allowable set-points. This is usually attributed to feed line over pressurization, check your incoming feed water line for malfunction of any boosting devices installed, and finally check rotation direction of the high pressure pump itself. If incorrect rotation is present this can cause over pressurization of the feed line. Lastly check that any high-pressure check valves installed are functioning correctly.	
14	HP pump inlet sensor in by-pass & HP pump outlet pressure low. Possible cavitation	The system was operating with the high-pressure pump inlet sensor in bypass mode. During operation, the high-pressure pump achieved minimum allowable outlet pressure, but then outlet pressure dropped below the low set point. This is a good indication to the controller that pump cavitation was occurring. The system was stopped to protect the pump from damage. Follow the items listed in fault description 12 above, to locate the possible reason for this pump inlet cavitation.	
15	HP pump inlet sensor & HP pump outlet sensor in by-pass. Operation not possible.	The user has requested that both the inlet pressure transducer and outlet pressure transducer of the high- pressure pump be set into bypass. Requests for this state are usually not permitted by the bypass screen manager. However, if for some reason these settings have been allowed, the unit will fail an automatic startup attempt as with both sensors bypassed, it is impossible to apply any protective measures to ensure high pressure pump failsafe operation. Deactivate one of these sensor bypasses to continue. If both sensors are malfunctioning, the unit cannot be run until at least one sensor is fixed or replaced.	

16	HP pump outlet exceeded maximum permissible pressure. System stopped.	During normal operation, in manual and automatic mode, the system exceeding maximum pressure allowed. A fault has occurred and the system will activate an emergency shutdown to protect the water maker and ship equipment. Re-start the system, if back pressure regulator initialization completes correctly and the system re-starts; its highly possible a rapid change in system pressure occurred for some unknown external reason and the change was so rapid that the automatic pressure regulator was not able to adjust quickly enough to compensate. If this happen during system commissioning check BPR wiring.		
17	HP pump outlet sensor in by-pass & brine flow low. Possible cavitation.	The system was operating with the high-pressure pump outlet sensor in bypass mode. During operation, the control system detected that brine flow dropped below calculated levels. This is a good indication that pump cavitation was occurring. The system was stopped to protect the pump from damage. Follow the items listed in fault description 12 on previous page, to locate the possible reason for this pump inlet cavitation.		
18	BPR initialization fault. BPR is jammed. Please attempt recovery in 'Customer Options'.	The control system attempted to initialize the automatic back pressure regulator assembly, during this initialization a motor over current was detected. This indicates the pressure regulator is jammed, follow the instructions listed in section 15 to attempt to free up the regulator. If these steps do not release the regulator removal of the system top cover and manual intervention with a wrench may be required.		
19	System emergency stop requested in manual. All moving machinery stopped!	Once the system was running in manual mode the E- Stop button was pressed. Release the E-stop button before attempting to run the unit again.		
20	Brine flow low during manual operation. Possible pump cavitation.	The system was operating with the high-pressure pump outlet sensor in bypass mode. During operation, the control system detected that brine flow dropped below calculated levels. This is a good indication that pump cavitation was occurring. The system was stopped to protect the pump from damage. Follow the items listed in fault description 12 on previous page, to locate the reason for this pump inlet cavitation.		
21	Brine flow low during fresh water flush. Possible loss of feed supply.	The system was fresh water flushing the unit, but detected that brine water flow rates are much lower than expected. This usually indicates a loss of fresh water supply to the unit. Please check this water supply to ensure it is not isolated elsewhere in the ship. If fresh water is present, check correct operation of the fresh water flush valve.		

22	Operation requested in feed water warmer than system temperature specifications.	The user requested system operation, but the feed water is hotter than permitted for accurate system operation. The system salinity sensor is calibrated to read salinity accurately in water up to 40C. Water above this temperature will yield unknown results and as such, the control system will not allow operation in these waters.		
23	Operation requested in feed water colder than system temperature specifications.	The user requested system operation, but the fee water is colder than permitted for accurate syste operation. The system salinity sensor is calibrated to read salinity accurately in water down to 5C. Wate below this temperature will yield unknown results ar could freeze once purified by the system R membranes and as such, the control system will no allow operation in these waters.		
24	Maximum emergency operation time expired. Please contact Parker for assistance.	The system has been operating with a critical sensor bypass mode for the maximum allowable time. The ur will no longer operate until this fault is repaired. emergencies, it is possible to reset the by-pa operation timer. Please contact Parker further help		
25	Operator did not increase system pressure within allowed time.	The system was started in either manual mode or the system is an AquaWhisper DX. Once the HP pump is activated, the user has a finite time in which to adjust system pressure to above minimum (>250PSI), if this step is not taken, the system automatically shuts down and generates this message.		
26	BPR drive current exceeded. BPR is jammed	During operation of the system BPR, the current required to turn the unit exceeded the allowable maximum. This indicates to the controller that the BPR is jammed, or the motor has failed and has an internal short circuit. If the BPR is not jammed and moves freely, Contact Parker for further assistance		
27	BPR jam occurred while opening valve. Auto release will be attempted once alarm is accepted.	While operating the BPR valve in a clockwise direction, the valve current rose exponentially, indicating the valve has reached a fully closed position, when this message is accepted by the user, the control system will use all available motor power to release the valve from this jammed position.		
28	BPR jam occurred while closing valve. Auto release will be attempted once alarm is accepted.	While operating the BPR valve in a counterclockwise direction, the valve current rose exponentially, indicating the valve has reached a fully open position, when this message is accepted by the user, the control system will use all available motor power to release the valve from this jammed position.		

System Warning Messages

The Aquamatic, Aquamatic XL and AquaWhisper DX control system contains a system warning message center. These types of faults are meant to bring attention to the user that the system is not running normally. These faults are ok for a short term, but may lead to a larger problem if not corrected. When a system performance related issue is detected the system alarm output will sound and a warning will be logged in the warning massage center.



1. To stop the alarm press, Accept.

System warning notifications and likely causes

Number	Message Displayed Possible Causes	
49	Booster pump outlet sensor has been set to by-pass by system user.	The operator has entered the emergency override screen and activated the emergency by-pass of the booster pump outlet pressure sensor. The system can only operate in this state for a limited time. Consult Parker for additional information
50	HP pump inlet sensor has been set to by-pass by system user.	The operator has entered the emergency override screen and activated the emergency by-pass of the high-pressure pump inlet pressure sensor. The system can only operate in this state for a limited time. Consult Parker for additional information
51	HP pump outlet sensor has been set to by-pass by system user. Manual operation only.	The operator has entered the emergency override screen and activated the emergency by-pass of the high-pressure pump outlet pressure sensor. The system can only operate in this state for a limited time. Consult Parker for additional information.

53	Product water salinity sensor has been set to by-pass by user. Manual operation only.	The operator has entered the emergency override screen and activated the emergency by-pass of the system salinity sensor. Manual operation of the unit is still possible. However, operation of the product diversion valve will need to be carried out manually.	
54	Product flow sensor has been set to by-pass by user. Manual operation only.	The operator has entered the emergency override screen and activated the emergency by-pass of the system product flow sensor. The system can still function in this mode but only for a limited time. Consult Parker for additional information.	
55	Brine flow sensor has been set to by-pass by user.	The operator has entered the emergency override screen and activated the emergency by-pass of the system brine flow sensor. The system can still function in this mode but only for a limited time. Consult Parker for additional information.	
56	HP pump inlet pressure sensor in by-pass. Emergency operation mode active.	The operator has activated the emergency by-pass of the HP Pump inlet pressure sensor, and is nor operating the system. Operation can continue until the maximum preset time has elapsed (50hrs). Contact Parker for additional information	
57	HP pump outlet pressure sensor in by-pass. Emergency operation mode active	The operator has activated the emergency by-pass of the HP Pump outlet pressure sensor, and is now operating the system. Operation can continue until the maximum preset time has elapsed (50hrs). Contact Parker for additional information	
58	Salinity probe 'In Air'. System automatic controls changed to manual mode only.	The salinity probe is reporting values only seen when the probe element is not submerged in water, this can happen when the system has been dormant for extended periods of time. In these eventualities, running the system in manual mode is possible. Once the probe senses water this mode will automatically be turned off. On the next automatic start up, automatic mode will be used.	
59	System at maximum operating pressure but product flow rates are lower than expected.	The system has reached maximum operating pressure; however, the expected production flow has not been achieved. This could be the result of bad quality feed water, very cold feed water, or a clogging of the system membranes. The system will continue to operate in this way until turned off, or until the condition is fixed (warmer feed water, better quality feed water, etc).	
60	Extended delay in production of potable water. Check settings & feed water quality.	The system is running in automatic mode, but has not been able to produce potable water within the normal time frames. Check system pressure settings, if needed, verify system feed water is within normal specifications.	

61	Product water quality lost. Possible feed water quality issue. Attempting to rectify.	The system is running in automatic mode and was producing potable water, but for some unknown reason the water quality of the product water deteriorated and is no longer acceptable. Check system pressure settings	
62	High pressure pump hours high. Mechanical inspection of pump recommended.	The high-pressure pump has run for more than the recommended maximum number of hours between services, and now requires inspection. This detailed service is highly recommended to extend the life of your unit	
63	High pressure pump oil hours high. Pump oil replacement recommended.	The high-pressure pump has run for more than the recommended number of hours between oil inspections, and now requires this inspection or possible oil change. This quick service is highly recommended to extend the life of your unit.	
64	Brine flow sensor in by-pass mode. Emergency operation mode active.	The operator has activated the emergency by-pass of the system brine flow sensor, and is now operating the system. Operation can continue until the maximum preset time has elapsed (50hrs). Contact Parker for additional information	
65	Tank level control detected product tank full. System will restart when tank is low.	The vessel potable water storage tank reports being full, and the system has been stopped to avoid overflowing of this tank. Once the tank reports low levels the system will re-start automatically, providing the user has not operated the system and power to the system has not been disconnected.	
66	System HP pump output below minimum. Please increase system pressure using BPR	The system was started in either manual mode or the system is an AquaWhisper DX. Once the HP pump is activated, the user has a finite time in which to adjust system pressure to above minimum (>250PSI), if this step is not taken within 60 seconds of pump activation, the system automatically generates this message. If the pressure is not increased above minimum with a 10-minute period, the control system will shut the water maker down	

Aqua Whisper DX Modular 450-1800 Section 10 - EXPLODED PARTS VIEW

Parts View

10 EXPLODED PARTS VIEW

10.1 WHEN ORDERING

When ordering Parts or Accessories from your local Sea Recovery Dealer or from Sea Recovery direct, in order to save time and to ensure that you receive the correct part provide the following information:

System Model System Style System Production		System Serial #	
Aqua Whisper DX	Whisper DX Modular 450-1 (one short 21 in. (53.3 cm) long R.O. Membrane Element)		SN
Aqua Whisper DX Modular 700-1 (one medium 31 in. (78.7 cm) long R.O. Membrane Element) S		SN	
Aqua Whisper DX	Modular	900-1 (one long 40 in. (101.6 cm) long R.O. Membrane Element)	SN
Aqua Whisper DX Modular 900-2 (two short 21 in. (53.3 cm)" long R.O. Me		900-2 (two short 21 in. (53.3 cm)" long R.O. Membrane Element)	SN
Aqua Whisper DX	Modular	1400-2 (two medium 31" long R.O. Membrane Element)	SN
Aqua Whisper DX	Modular	1800-2 (two long 40" long R.O. Membrane Element)	SN

AND

SYSTEM INFORMATION FROM THE SYSTEM INFORMATION SCREEN

SERIAL NUMBER helps us to determine the latest physical version and configuration of your system which is necessary to ensure that we provide you with the correct information or parts.

SIZE tells us the production capacity of your system which gives us a bench mark in diagnosing product water flow and pressure concerns.

FWF tells us if you have installed and are utilizing the Fresh Water Flush feature.

TOTAL TIME assists us in diagnosing abnormalities that can occur at given operational time intervals such as required pump maintenance, or R.O. membrane element condition.

DV Set Point helps us to determine if the R.O. membrane element is losing its rejection capabilities or if the 3-Way Product Water Diversion Solenoid Valve Set Point is simply adjusted too high or too low.


CONTROL VER allows us to determine the specific sequential operation of the system based on the version of the programmed control logic.

AND provide us with information on the part that you wish to order:

Part Number Part Description Quantity


Having this information will expedite your request and ensure that you receive the correct part.

10.2 TUBES AND FITTINGS

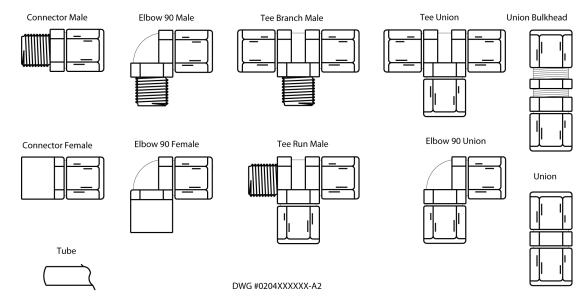

Specify Type of Fitting	Specify Tube Size	ecify Tube Size Specify Pipe Size Specify Male		Male or F	or Female	
					-	
Connector Male	1/4" 0.D.	1/4	MNPT	or	FNPT	
Connector Female	3/8" 0.D.	3/8	MNPT	or	FNPT	
Elbow 90 Male	1/2" O.D.	1/2	MNPT	or	FNPT	
Elbow 90 Female	5/8" O.D.	3/4	MNPT	or	FNPT	
Tee Branch Male						
Tee Run Male						
Tee Union						
Elbow Union						
Union Bulkhead						
Union						


LOW PRESSURE THERMAL PLASTIC TUBE FITTING

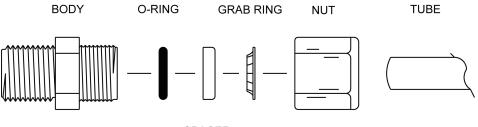

SPACER

10.3 INSTALLATION KIT B001940001


ITEM	PART NO	DESCRIPTION	QTY	UM
1	061100043000	WASHER FLAT OS 1/4"SS	12.00	EACH
2	061172143016	SC HEX "A" 1/4 X 1 SS	12.00	EACH
3	05181432AA	HOSE CLAMP 1/2"	4.00	EACH
4	05181434AA	HOSE CLAMP 3/4" SS	22.00	EACH
5	061170628016	SC PHIL PAN "A" 10 X 1 SS	5.00	EACH
6	061080028000	WASHER FLAT #10 SS	5.00	EACH
7	2115031700	RUBBER MOUNT 90 LB AQM	4.00	EACH
8	061110049000	WASHER FENDER 5/16"SS	4.00	EACH
9	061172149036	SC HEX "A" 5/16 2 3/8 SS	4.00	EACH
10	B651930002	OWNERS MANUAL AQWM-DX	1.00	EACH
11	B645800001	MCC-1 ALKALINE CLEANER	1.00	EACH
12	B645800002	MCC-2 ACID CLEANER	1.00	EACH
13	0328066666	HOSE CLEAR BRAID 3/4"	50.00	FEET
14	0101013783	ELB90 3/4 FPT X 3/4 FPT PVC	1.00	EACH
15	0101653783	ADAP 3/4 MPT X 3/4 BARB PVC	3.00	EACH
16	0421051239	SEA STRAINER-3/4 BRONZE	1.00	EACH
17	0101073783	ELB90 3/4 MPT X 3/4 BARB PVC	2.00	EACH
18	0101423783	TEE 3/4 FT X 3/4 FT X 3/4 FT P	2.00	EACH
19	0101293483	RB 3/4 MT X 1/4 FT PVC	2.00	EACH
20	0204020869	ELB90 1/4 TUBE X 1/4 MPT PLAST	2.00	EACH
21	0312121969	TUBE 1/4 BLACK	20.00	FEET
22	0101292383	RB 1/2 MT X 1/4 FT PVC	1.00	EACH
23	0101422583	TEE 1/2 FT X 1/2 FT X 1/2 FT P	1.00	EACH
24	0101652683	ADAP 1/2 MPT X 3/4 BARB PVC	2.00	EACH
25	0101652583	ADAP 1/2 MPT X 1/2 BARB PVC	1.00	EACH
26	0328065066	HOSE CLEAR BRAID 1/2"	50.00	FEET
27	0101012583	ELB90 1/2 FPT X 1/2 FPT PVC	1.00	EACH
28	0312123569	TUBE 3/8 BLACK	20.00	FEET

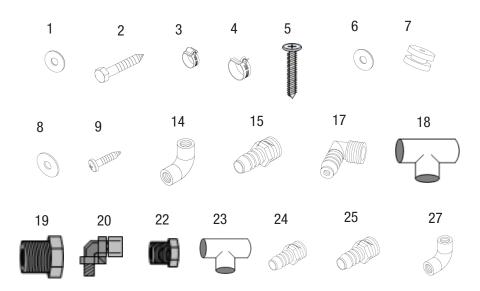






16 Weight Handler SEA STRAINER BRONZE






TUBE 1/4 BLACK 20 fT.



HOSE CLEAR BRAID 1/2" I.D. QTY: 50 FEET (15.24 METERS)



HOSE CLEAR BRAID 3/4" I.D. QTY: 50 FEET (15.24 METERS)




Tube 3/8 Black 20 Ft

10.4 MAJOR PARTS

SEA STRAINER 1.

L L
Ň
>
4
<u> </u>
<u> </u>
5
Ъ


ITEM	PART NUMBER	DESCRIPTION	QTY	U/M
1-13	0421051239	SEA STRAINER-3/4" BRONZE		
1	(PART OF ITEM 1)	CAP BRONZE (NOT SOLD SEPARATELY)	1	EACH
2	0421051239-2	0-RING, CAP SEAL 3/4" BRONZE SEA STRAINER	1	EACH
3	0421051239-7	BASKET MONEL, 3/4" BRONZE SEA STRAINER	1	EACH
4	(PART OF ITEM 1)	BODY (NOT SOLD SEPARATELY)	1	EACH
5	0421051239-4	0-RING SIGHT GLASS 3/4" BRONZE STRAINER	1	EACH
6	(PART OF ITEM 1)	SIGHT GLASS (NOT SOLD SEPARATELY)	1	EACH
7	(PART OF ITEM 1)	SCREW 1/4-20 X 5/8" HS (NOT SOLD SEPARATELY)	4	EACH
8	(PART OF ITEM 1)	WASHER 1/4" PFW-2 SET (NOT SOLD SEPARATELY)	4	EACH
9	(PART OF ITEM 1)	0-RING DRAIN PLUG (NOT SOLD SEPARATELY)	1	EACH
10	(PART OF ITEM 1)	DRAIN PLUG (NOT SOLD SEPARATELY)	1	EACH
11	(PART OF ITEM 1)	UPPER BRACKET (NOT SOLD SEPARATELY)	1	EACH
12	(PART OF ITEM 1)	LOWER BRACKET (NOT SOLD SEPARATELY)	1	EACH
13	(PART OF ITEM 1)	STRAP (NOT SOLD SEPARATELY)	1	EACH
14	0101653783	ADAP 3/4 MPT X 3/4 BARB PVC	2	EACH
15	05181434AA	HOSE CLAMP 3/4" SS	4	EACH
16	0101073783	ELB90 3/4 MPT X 3/4 BARB PVC	2	EACH
17	061170628016	SC PHIL PAN "A" 10 X 1 SS	5	EACH
18	061080028000	WASHER FLAT #10 SS	5	EACH

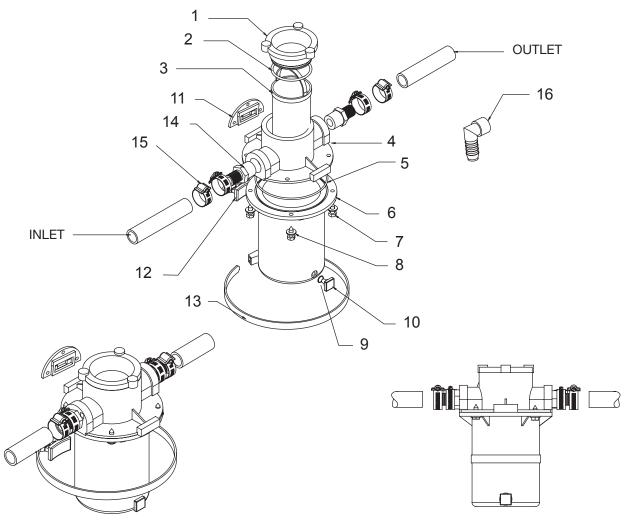

2. BOOSTER PUMP HEAD ASSY


ITEM	PART NUMBER	DESCRIPTION	QTY	U/M
13	B655800009	SEAL KIT		
14	291211181PP	IMPELLER KIT		
15-24	1221515772	BOOSTER PUMP HEAD N200		
15	061080028000	WASHER FLAT # 10 SS	7	EACH
16	061010057000	Nut Hex 3/8" SS	7	EACH
17	569030012A	SCREW HEX 5/16-18 X 2 1/2"	7	EACH
18	26141260PP	GASKET BOOSTER PUMP N200	1	EACH
19	061142157016	BOLT HEX 3/8-16 X 1" SS	2	EACH
20	5680010001A	MOTOR MOUNTING BRACKET	1	EACH
21	1221515772-3	DRAIN PLUG	1	EACH
22	1221515772-1	BOOSTER PUMP VOLUTE N200	1	EACH
23	1221515772-3	SEAL	1	EACH
24	29121181PP	IMPELLER	1	EACH

BOOSTER PUMP HEAD ASSY 50/60/1

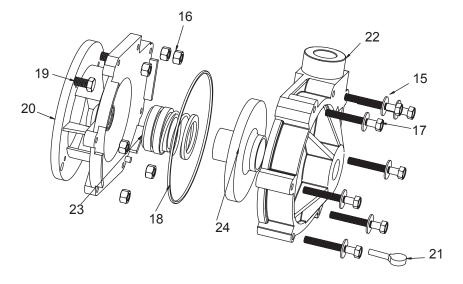


MAINTENANCE SEAL KIT B655800009

(6 13

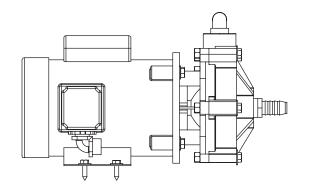

MAINTENANCE IMPELLER KIT 291211181PP






3. BOOSTER PUMP ASSY 1 PHASE B016120001


	Ç	1	1
ŝ			
•		>	2
	C	'	1
•	Ì		
	2		

≥

ITEM PART NUMBER DESCRIPTION 1-12 B016120001 B00STER PUMP ASSY AQM 50/60/1 SINGLE PHASE 115-2

1-12	B016120001	BOOSTER PUMP ASSY AQM 50/60/1 SINGLE PHASE 115-230 VAC	1	EACH
		60HZ & 100-220 VAC 50HZ		
1	1221515772	BOOSTER PUMP HEAD N200	1	EACH
2	1519081110	MOTOR 1/2 HP 110/230-50/60/1PH	1	EACH
3	061080056000	WASHER FLAT 3/8" SS	4	EACH
4	0101653783	ADAP 3/4 MPT X 3/4 BARB PVC	1	EACH
5	0101073783	ELB90 3/4 MPT X 3/4 BARB PVC	1	EACH
6	063200066000	NUT LOCK 1/2" STEEL	1	EACH
7	1920023632	STRAIN RELIEF 90 CG90-6250	1	EACH
8	31313849CD	TERMINAL CONN AW 22/12 GAUGE	2	EACH
9	061100043000	WASHER FLAT OS 1/4" SS	4	EACH
10	061172143016	SC HEX "A" 1/4 X 1 SS	4	EACH
11	061142157016	BOLT HEX 3/8-16 X 1 SS	4	EACH

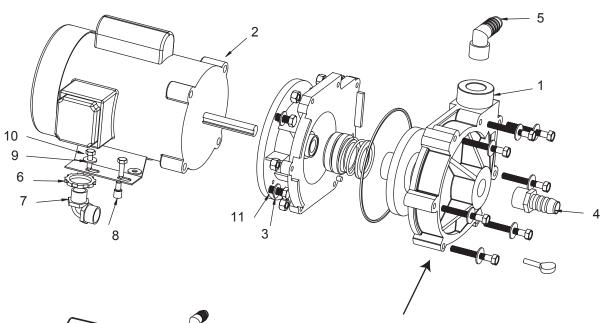




Refer to the Pump Head Assy drawing for details.

QTY


U/M

ITEM	PART NUMBER	DESCRIPTION	QTY	U/M
1-13	B016120002	BOOSTER PUMP ASSY AQM 50/60/3 THREE PHASE 200-380 VAC 50HZ	1	EACH
		& 208-460 VAC 60HZ		
1	1221515772	BOOSTER PUMP HEAD N200	1	EACH
2	0101073783	ELB90 3/4 MPT X 3/4 BARB PVC	1	EACH
3	1520181110	MOTOR 1/2 HP 208/230/460 50/60	1	EACH
4	061080056000	WASHER FLAT 3/8" SS	4	EACH
5	0101653783	ADAP 3/4 MPT X 3/4 BARB PVC	1	EACH
6	3131210495	WIRE NUT YELLOW	3	EACH
7	063200066000	NUT LOCK 1/2" STEEL	1	EACH
8	1920023632	STRAIN RELIEF 90 CG90-6250	1	EACH
9	31313849CD	TERMINAL CONN AW 22/12 GAUGE	1	EACH
10	061172143016	SC HEX "A" 1/4 X 1 SS	4	EACH
11	061100043000	WASHER FLAT OS 1/4" SS	4	EACH
12	061142157016	BOLT HEX 3/8-16 X 1 SS	4	EACH
13	1221514722-3	BOOSTER PUMP BRACKET MOUNTING	1	EACH

4. BOOSTER PUMP ASSY 3 PHASE B016120002

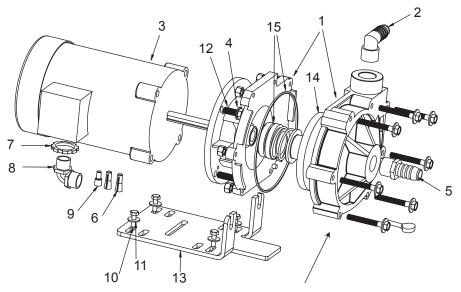

Refer to the Pump Head Assy drawing for details.

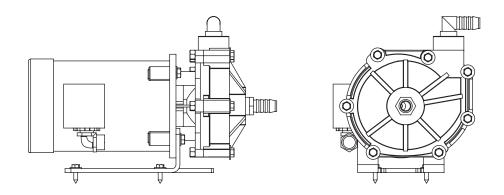


MEDIA FILTER ASSY B071080002

5.

I

TEM	PART NUMBER	DESCRIPTION	ΩΤΥ	U/M
				U/IVI
1-31	B071080002	MEDIA FILTER -ASSY/AW >SEP 98		
9-14	0708040468	MEDIA FILTER 818 ALMOND AW >SEP 98	1	EA
9	0708040468-1	TANK MEDIA FILTER ASSY/AW >SEP 98	1	EA
10	0708040400-1	LID MEDIA FILTER ASSY/AW >SEP 98	1	EA
11	0708040400-2	LATTERAL PICK UP MEDIA FILTER ASSY/AW >98	1	EA
12	2614017300	0-RING 334 MEDIA LID 97	1	EA
13	2614017400	0-RING 117 MEDIA TOP INLET	1	EA
15	01013737CL	NIPPLE 3/4" NPT X CLOSE PVC	2	EA
16	0101693783	UNION 3/4" SL X 3/4" SL PVC	1	EA
17	0101673783	UNION 3/4" FNPT X 3/4" FNPT PVC	1	EA
18	0101343783	PLUG 3/4" MNPT PVC	2	EA
19	20200404010	BRACKET "L" MOUNTING FEET	4	EA
20	061172143016	SC HEX "A" 1/4" X 1" SS	8	EA
21	061100043000	WASHER FLAT OS 1/4" SS	8	EA
22	061060045000	NUT HEX 1/4-20 X 3/4" W/INSERT SS	8	EA
23	061161130028	SC PHIL OVAL 10-24 X 1 3/4" SS	6	EA
24	1453131700-02	VALVE BRACKET 3/4" SL, SET	3	EA
25	0312121969	TUBE 1/4" BLACK NYLON	2	FT
26	0204010869	ELB90 1/4" TUBE X 1/4" FNPT PLAST	2	EA
27	10181522CC	GAUGE -30-0-70 CBM 1/4" MNPT	2	EA
28	05180851CC	GAUGE BRACKET CBM SS	2	EA
29	05181434AA	HOSE CLAMP 3/4" SS	12	EA
30	4643070155	MEDIA GARNET 8-12 100# BAG	17	LB
31	4643020255	MEDIA SAND A1000 (100LB BAG)	25	LB

Note: Item 1-8 are shown on the Multi-Media Filter Piping.

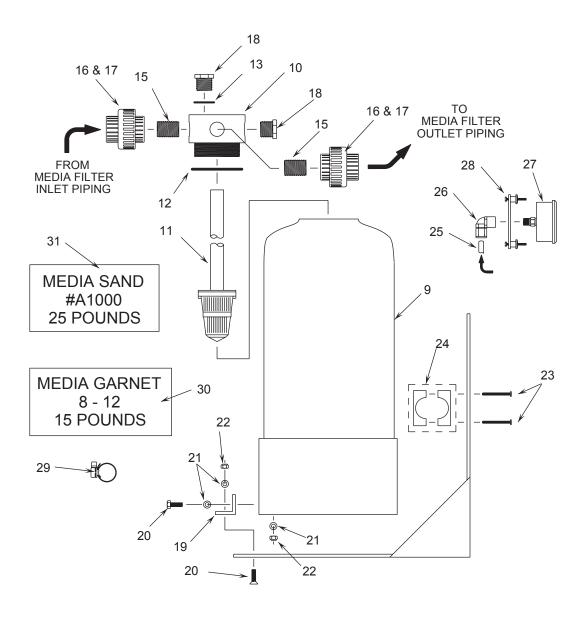


Note: Item 1-8 are shown on the Multimedia Filter Piping illustration.

MULTI MEDIA FILTER PIPING


6.


TEM	PART NUMBER	DESCRIPTION	QTY	U/M
1	0301096600	PIPE PVC SCH 80 3/4" PER FOOT	5	EA
2	0101053783	ELBOW 90 3/4" SL X 3/4" SL PVC	12	EA
3	14011317AR	VALVE 3-WAY BALL 3/4" SLIP	3	EA
4	0101463783	TEE 3/4" SL X 3/4" X 3/4" SL	4	EA
5	0101323483	REDUCER BUSHING 3/4" SL X 1/4" FT PVC	2	EA
6	0101652683	ADAPTER 1/2" MT X 3/4" BARB PVC	3	EA
7	0204020869	ELBOW 90 1/2" MT X TUBE PLASTIC	2	EA
8	0101313683	REDUCER BUSHING 3/4" SLIP X 1/2" FT PVC	3	EA

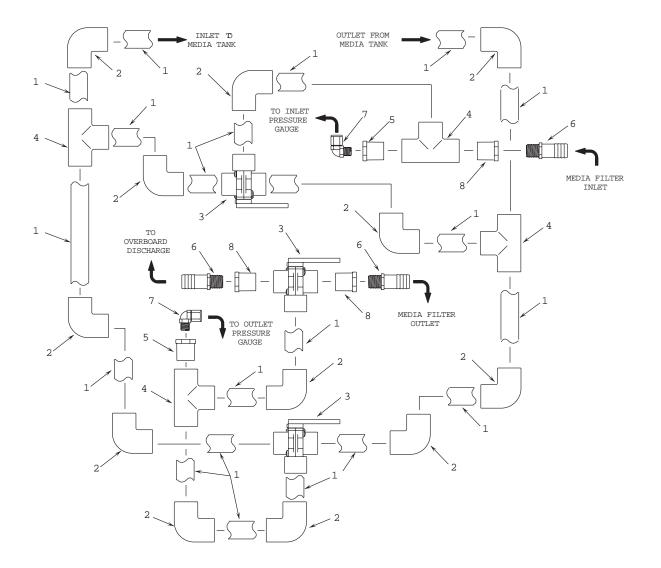


ITEM	PART NUMBER	DESCRIPTION	QTY	U/M
1-11	B008800001	PLANKTON FILTER ASSY-AW SINGLE		
1-3	0713020473	FILTER HOUSING/LID 3/4" X 10"	1	EA
1	(PART OF ITEM 1)	LID 10 INCH PREFILTER BLUE HOUSING (NOT SOLD SEPARATELY)	1	EA
2	(PART OF ITEM 1)	BOWL 10 INCH PREFILTER BLUE HOUSING (NOT SOLD SEPARATELY)	1	EA
3	2614010473	0-RING 237 10 INCH PREFILTER BLUE HOUSING	1	EA
4	0805823578	ELEMENT PLANKTON	1	EA
5	20200402100	BRACKET PREFILTER/CHRCL/PLNKTN	1	EA
6	061170628016	SC PHIL PAN "A" 10 X 1" SS	4	EA
7	065080028000	WASHER FLAT #10 NYLON	4	EA
8	0101073783	ELB90 3/4" MPT X 3/4" BARB PVC	2	EA
9	061172143016	SC HEX "A" 1/4 X 1" SS	4	EA
10	061100043000	WASHER FLAT OS 1/4" SS	4	EA
11	05181434AA	HOSE CLAMP 3/4" SS	4	EA

7. PLANKTON FILTER ASSY-SINGLE B008800001

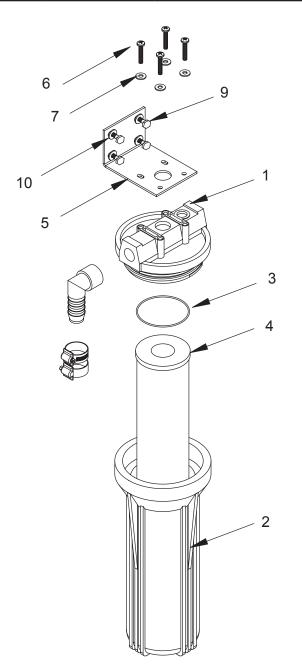






8. PLANKTON FILTER ASSY-DOUBLE B008800002

/iew	
-	
Parts	

ITEM	PART NUMBER	DESCRIPTION	QTY	U/M
1-16	B008800002	PLANKTON FILTER ASSY-AW DOUBLE		1
1-3	0713020473	FILTER HOUSING/LID 3/4"" X 10"	2	EA
1	(PART OF ITEM 1)	LID 10 INCH PREFILTER BLUE HOUSING (NOT SOLD SEPARATELY)	2	EA
2	(PART OF ITEM 1)	BOWL 10 INCH PREFILTER BLUE HOUSING (NOT SOLD SEPARATELY)	2	EA
3	2614010473	0-RING 237 10 INCH PREFILTER BLUE HOUSING	2	EA
4	0805823578	ELEMENT PLANKTON	2	EA
5	20200402100	BRACKET PREFILTER/CHRCL/PLNKTN	2	EA
6	061170628016	SC PHIL PAN "A" 10 X 1" SS	8	EA
7	065080028000	WASHER FLAT #10 NYLON	8	EA
8	01013737CL	NIPPLE 3/4" NPT X CLOSE PVC	4	EA
9	061172143016	SC HEX "A" 1/4" X 1" SS	8	EA
10	061100043000	WASHER FLAT OS 1/4" SS	8	EA
11	0101073783	ELB90 3/4" MPT X 3/4" BARB PVC	3	EA
12	0101013783	ELB90 3/4" FPT X 3/4" FPT PVC	2	EA
13	0101423783	TEE 3/4" FT X 3/4" FT X 3/4" FT PVC	2	EA
14	0101653783	ADAP 3/4" MPT X 3/4 BARB PVC	3	EA
15	0328066666	HOSE CLEAR BRAID 3/4"	1.5	FT
16	05181434AA	HOSE CLAMP 3/4" SS	12	EA

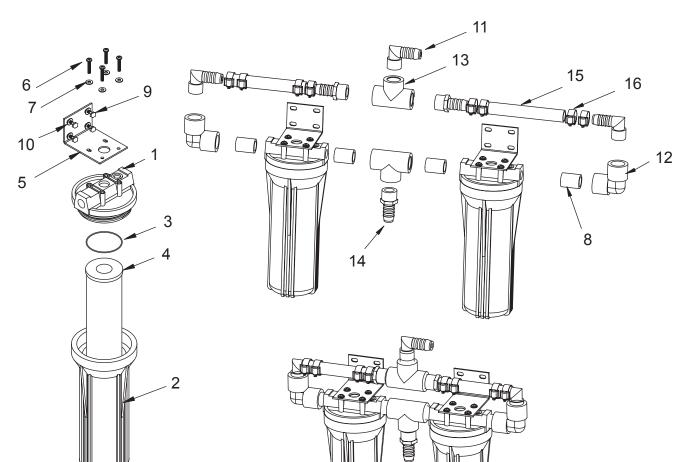

PREFILTRATION CARTRIDGE FILTER ELEMENT WARNING:

Do not use third party Prefiltration Elements (Plankton Filter Elements, Prefilter Elements, Commercial Prefilter Elements, or Oil/Water Separator Elements). Use only Sea Recovery supplied Prefiltration Elements. Third party prefiltration elements on the market do not properly fit into the Sea Recovery Filter Housings, the seams fall apart, and they will allow by-pass resulting in EXTENSIVE AND EXPENSIVE DAMAGE TO THE HIGH PRESSURE PUMP AS WELL AS PREMATURE FOULING OF THE R.O. MEMBRANE ELEMENT.

Damage caused to the Sea Recovery High Pressure Pump, R.O. Membrane Element, or any other component from the use of third party, non Sea Recovery supplied, filter elements is the responsibility and liability of the operator and is not covered by the Sea Recovery Warranty.


FILTER ELEMENT CAUTION:

Do not use "string wound" or "fiber" type prefilter elements. These type of elements are designed for the Photographic Film Developing industry. When used in sea water they will plug up rapidly in 1/10th or less the time causing frequent shut down of the system and very frequent changing resulting in very high cost of maintenance.


PRE FILTER-DUAL ASSY B108140001

9.


ITEM NO.	PART NUMBER	DESCRIPTION	QTY.
TIEMINU.		DESCRIPTION	QIT.
1	0713020873	FILTER HOUSING/LID 1/2" X 20	2
2	20200402101	DUAL BRACKET, PRE-FILTER, CHRCL/PLNKTN	1
3	0801130257	ELEMENT PREFILTER 10-25	1
4	0801060157	ELEMENT PREFILTER 10-05	1
5	0112072600	ELBOW .50 MPT X 3/4 BARB NYLON	2
6	061170628016	SC PHIL PAN "A" 10 X 1 SS	8
7	061080028000	WASHER FLAT #10 SS	8
8	061142145012	BOLT HEX 1/4-20 X 3/4 SS	4
9	061100043000	WASHER FLAT OS 1/4"SS	4
10	061060045000	NUT HEX 1/4-20 W/INSERT SS	4
11	01013725CL	NIPPLE 1/2 NPT X CLOSE PVC	1

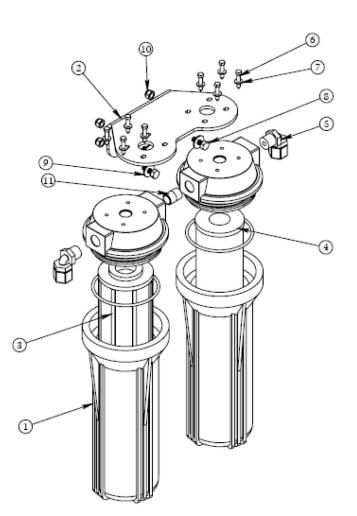

COMMERCIAL PREFILTER CONNECTION AND WATER FLOW

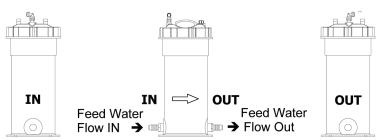


Commercial Prefilter is plumbed as per the raised arrows and markings IN and OUT




Feed Water Flow through the Commercial Prefilter Element is from the OUTSIDE of the Element to the INSIDE CENTER of the Element

OIL/WATER SEPARATOR CONNECTION AND WATER FLOW

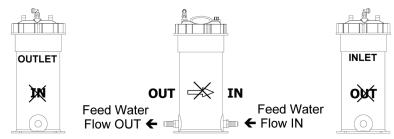


Oil/Water Separator utilizes the same housing as the Commercial Prefilter, however it is plumbed OPPOSITE of the Commercial Prefilter and OPPOSITE of the raised arrows and markings IN and OUT Separate Labels are placed on the Oil/Water Separator indicating correct INLET and OUTLET




10. COMMERCIAL PREFILTER ASSY B109120001

Parts View


ITEM	PART NUMBER	DESCRIPTION	QTY	U/M
1-16	B109120001	COMMERCIAL PREFILTER ASSY 32.5 SQ FT		1
1-9	07620310WA	FILTER HOUSING 32.5 SQFT >10/05	1	EA
1	07620310WA-02	LID FILTER HOUSING 32.5 SQ FT	1	EA
2	07620310WA-07	SAFETY AIR BLEED VALVE FLTR HOUSING 32.5	1	EA
3	07620310WA-03	LID LOCK RING FILTER HOUSING 32.5 SQ FT	1	EA
4	07620310WA-06	0-RING LID CPF/OWS 32.5 SQ FT	1	EA
5	07620310WA-01	BASE FILTER HOUSING 32.5 SQ FT	1	EA
6	22130102BE	LABEL COMM PRE FILTER	2	EA
7	2234011260	LABEL INLET(SRC BLUE)	1	EA
8	2234011360	LABEL OUTLET (SRC BLUE)	1	EA
9	2234010460	LABEL SEA RECOVERY CORP LARGE	2	EA
10	0801063357	ELEMENT CPFE AW 5 MIC 32.5 SQFT	1	EA
11	0101653783	ADAP 3/4" MPT X 3/4" BARB PVC	2	EA
12	05181434AA	HOSE CLAMP 3/4" SS	4	EA
13	061172143016	SC HEX "A" 1/4" X 1" SS	4	EA
14	061100043000	WASHER FLAT OS 1/4" SS	4	EA
15	0204020100	ELB90 1/4 TUBE JGX 1/4" MNPT	1	EA
16	0204990300	PLUG 1/4JG	1	EA
17	0312121969	TUBE 1/4	20	FT

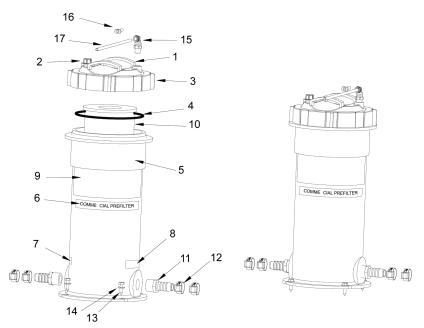

COMMERCIAL PREFILTER CONNECTION AND WATER FLOW

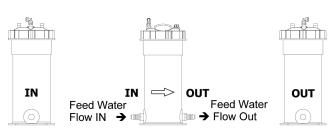


Commercial Prefilter is plumbed as per the raised arrows and markings IN and OUT



Prefilter Element is from the OUTSIDE of the Element to the INSIDE CENTER of the Element

ITEM	PART NUMBER	DESCRIPTION	QTY	U/M
1-16	B111120001	OIL WATER SEPARATOR ASSY 32.5 SQ FT		
1-9	07620310WA	FILTER HOUSING 32.5 SQFT >10/05	1	EA
1	07620310WA-02	LID FILTER HOUSING 32.5 SQ FT	1	EA
2	07620310WA-07	SAFETY AIR BLEED VALVE FLTR HOUSING 32.5	1	EA
3	07620310WA-03	LID LOCK RING FILTER HOUSING 32.5 SQ FT	1	EA
4	07620310WA-06	0-RING LID CPF/OWS 32.5 SQ FT	1	EA
5	07620310WA-01	BASE FILTER HOUSING 32.5 SQ FT	1	EA
6	22130101BE	LABEL OIL WATER SEPERATOR	2	EA
7	2234011260	LABEL INLET(SRC BLUE)	1	EA
8	2234011360	LABEL OUTLET (SRC BLUE)	1	EA
9	2234010460	LABEL SEA RECOVERY CORP LARGE	2	EA
10	08020723KD	ELEMENT OWSE 32.5 SQ FT	1	EA
11	0101653783	ADAP 3/4" MPT X 3/4" BARB PVC	2	EA
12	05181434AA	HOSE CLAMP 3/4" SS	4	EA
13	061172143016	SC HEX "A" 1/4" X 1" SS	4	EA
14	061100043000	WASHER FLAT OS 1/4" SS	4	EA
15	0204020100	ELB90 1/4 TUBE JGX 1/4" MNPT	1	EA
16	0204990300	PLUG 1/4JG	1	EA
17	0312121969	TUBE 1/4" BLACK	20	FT

11. OIL WATER SEPERATOR ASSY B111120001

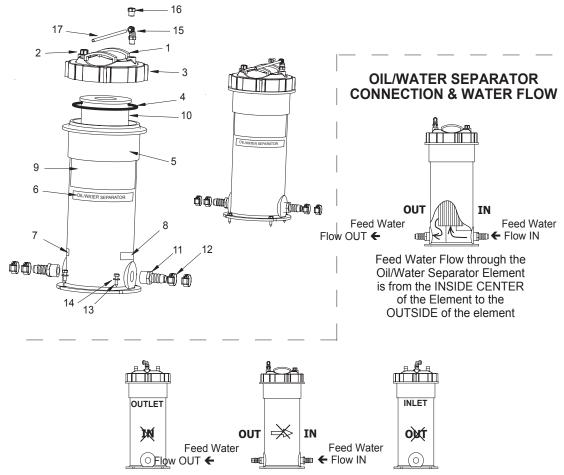

Oil/Water Separator utilizes the same housing as the Commercial Prefilter, however it is plumbed OPPOSITE of the Commercial Prefilter and OPPOSITE of the raised arrows and markings IN and OUT Separate Labels are placed on the Oil/Water Separator indicating correct INLET and OUTLET

HIGH PRESSURE PUMP WARNING:

Two similar pumps are commercially available. One has a lower water flow rate, the other has a higher water flow rate than the Sea Recovery High Pressure Pump.

The commercially available lower water flow rated pump will cause:

- a. Poor quality Product Water.
- b. Low Product Water Flow.
- c. Excessive operating pressure as the System attempts to adjust pressure to achieve rated Product Water Flow.
- d. Immediate fouling of the Sea Recovery Aqua Whisper R.O. Membrane Elements resulting in unrecoverable damage to them.

The commercially available higher water flow rated pump will cause:


- a. Low feed water pressure into the high pressure pump.
- b. Line pressure loss of feed water resulting in continual system shut down.
- c. Cavitation to the high pressure pump resulting in premature failure of the pump.
- d. Extensive Line Pressure Build-Up in the High Pressure Hoses and Manifolds.
- d. Telescoping damage of the R.O. Membrane Elements due to excessive feed flow across them.
- e. Over heating of the High Pressure Pump Electric Motor due to excessive load.

NEVER REPLACE THE SEA RECOVERY HIGH PRESSURE PUMP WITH A THIRD PARTY, NON SEA RECOVERY SUPPLIED, HIGH PRESSURE PUMP. THE SEA RECOVERY AQUA WHISPER HIGH PRESSURE PUMP IS NOT AVAILABLE THROUGH ANY SOURCE OTHER THAN SEA RECOVERY and SEA RECOVERY DEALERS. WHEN REPAIRING OR REPLACING THE HIGH PRESSURE PUMP ENSURE THAT THE MARINE DEALER HAS OBTAINED THE REPAIR PARTS OR THE PUMP FROM SEA RECOVERY.

DAMAGE CAUSED TO THE SEA RECOVERY SYSTEM RESULTING FROM THE USE OF NON SUPPLIED SEA RECOVERY PARTS OR COMPONENTS IS THE RESPONSIBILITY AND LIABILITY OF THE MARINE DEALER THAT SUPPLIED THE PUMP OR PARTS AND THE OPERATOR AND IS NOT COVERED BY THE SEA RECOVERY WARRANTY.

ITEM NO.	PART NUMBER	DESCRIPTION	QTY.
1	061080056000	WASHER FLAT 3/8" SS	8
2	061142157016	BOLT HEX 3/8-16 X 1 SS	4
3	20200239001	PLATE, MOTOR MOUNT, MODULAR	1
4	061060057000	NUT HEX 3/8-16 W-INSERT SS	4
5	061142157028	BOLT HEX 3/8-16 X 1 3/4 SS	4
6	2115031020-1	RUBBER MOTOR MOUNT 40LB	4
7	2115031020-2	RUBBER MOTOR MOUNT 40LB	4
8	12180512C0	HP PUMP-GP 4.2 GPM SS LEFTHAND	1
9	15AC062412	MOTOR 2.5 HP 110-220/50-60 1PH	1
10	061142150012	BOLT HEX 5/16-18 X 3/4 SS	4
11	061060050000	HEX NUT 5/16-18 W/INSERT SS	4
12	061100049000	WASHER FLAT OS 5/16" SS	4


12. HP PUMP ASSY-SINGLE PHASE-B156930003 (Standard)

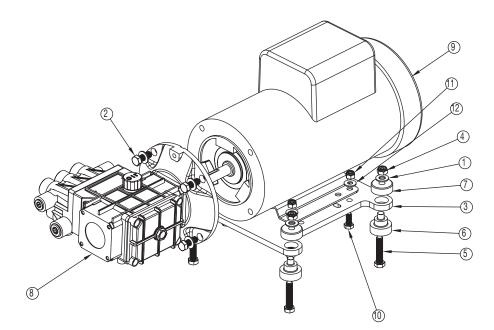

13. HP PUMP ASSY-3 PHASE 50Hz- B156930005 (Standard)


>
e.
N
rts
Pal

ITEM NO.	PART NUMBER	DESCRIPTION	QTY.
1	061080056000	WASHER FLAT 3/8" SS	8
2	061142157016	BOLT HEX 3/8-16 X 1 SS	4
3	20200239001	PLATE, MOTOR MOUNT, AQM II MODULAR	1
4	061060057000	NUT HEX 3/8-16 W-INSERT SS	4
5	061142157028	BOLT HEX 3/8-16 X 1 3/4 SS	4
6	2115031020-1	RUBBER MOTOR MOUNT 40LB. AQM II	4
7	2115031020-2	RUBBER MOTOR MOUNT 40LB. AQM II	4
8	82012005	MOTOR 2.4 HP 220-460/50-60 3PH	1
9	12180512C0	HP PUMP-GP 4.2 GPM SS LEFTHAND	1
10	061100049000	WASHER FLAT OS 5/16" SS	4
11	061060050000	HEX NUT 5/16-18 W/INSERT SS	4
12	061142150012	BOLT HEX 5/16-18 X 3/4 SS	4

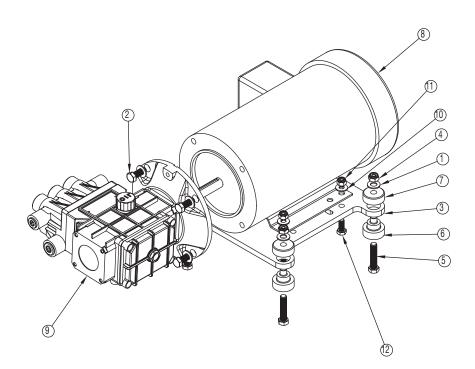

ITEM NO.	PART NUMBER	DESCRIPTION	QTY.
1	061080056000	WASHER FLAT 3/8" SS	8
2	061142157016	BOLT HEX 3/8-16 X 1 SS	4
3	20200239001	PLATE, MOTOR MOUNT, AQM II MODULAR	1
4	061060057000	NUT HEX 3/8-16 W-INSERT SS	4
5	061142157028	BOLT HEX 3/8-16 X 1 3/4 SS	4
6	2115031020-1	RUBBER MOTOR MOUNT 40LB. AQM II	4
7	2115031020-2	RUBBER MOTOR MOUNT 40LB. AQM II	4
8	12180512C0	HP PUMP-GP 4.2 GPM SS LEFTHAND	1
9	82012005	MOTOR 2.4 HP 220-460/50-60 3PH	1
10	061142150012	BOLT HEX 5/16-18 X 3/4 SS	4
11	061060050000	HEX NUT 5/16-18 W/INSERT SS	4
12	061100049000	WASHER FLAT OS 5/16" SS	4

14. HP PUMP ASSY-3 PHASE 60Hz- B156930004 (Standard)

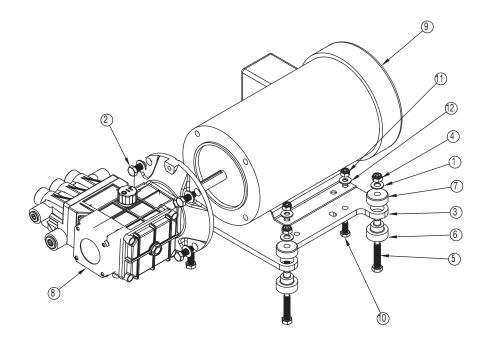

15. HP PUMP ASSY-12180513CO-RIGHT

iTEM	PART #	DESCRIPTION
1-52	12180513C0 RIGHT	PUMP HP 4,2 GPM SS RIGHT (COMPLETE HP PUMP)
1-29	12180512C0-CCAR	DRIVE END PUMP HP 4.2 GPM SS RIGHT (STUFFED CRANKCASE SECTION)
30-52	12180511C0-WE	WET END PUMP HP 4.2 GPM SS (STUFFED MANIFOLD)
3 1	12180510CO-01	Crankcase
2	12180510CO-02	Connecting Rod
	12180512CO-03	Crankshaft 5/8" Hollow 4.2 GPM
4	12180510CO-04	Bearing
5	12180510CO-05	Oil Seal, Crankshaft
6	12180510CO-06	Retainer, Oil Seal
7	12180510CO-07	O-Ring, Oll Seal Retainer/Side Cover
8	12180510CO-08	Flange, NEMA 56C Face
9	12180510CO-09	Screw SHCS 18mm Long
10 11	12180510CO-10 12180510CO-11	Oil Cap Vented
12	12180510CO-11 12180510CO-12	Rear Cover Screw SHCS 16mm Long
13	12180510CO-12	Sight Glass
14	12180510CO-14	O-Ring, Rear Cover
15	12180510CO-15	Bushing
16	12180510CO-16	Washer
17	12180510CO-17	Screw HHCS 20mm long
18	12180510CO-18	Side Cover
19	12180510CO-19	Side Plate
20	12180510CO-20	Oil Drain Plug
21	12180510CO-21	Oil Seal Plunger
22	12180510CO-22	Wrist Pin
23	12180510CO-23	Plunger Rod
24	12180510CO-24	Slinger And Extension Bing
25	12180510CO-25	Anti-Extrusion Ring
26 27	12180510CO-26 12180510CO-27	O-Ring Plunger Plunger 18mm
28	12180510CO-28	Washer, Plunger Rod
29	12180510CO-29	Nut, Plunger Rod
30	12180510CO-30	Seal Retainer
31	12180510CO-31	Low Pressure Seal
32	12180510CO-32	O-Ring Seal Case
33	12180510CO-33	Seal Case
34	12180510CO-34	Square Ring, High Pressure Seal
35	12180510CO-35	Glide Ring, High Pressure Seal
36	12180510CO-36	Manifold
37	12180510CO-37	1/4 NPT Plug
38	12180510CO-38	3/8 NPT Plug
39	12180510CO-39	1/2 NPT Plug
40	12180510CO-40	O-Ring Valve Spacer
44	12180510CO-44	O-Ring Valve Plug Washer, Ribbed Lock
46 47	12180510CO-46 12180510CO-47	Screw SHCSM5 x 25mm Long
48	12180510CO-48	Screw SHCS M5 x 35mm Long
51	1218051300-51	Value Plug

Valve Plug

Pump Oil 16 oz.

Model Number

SRC HPP VK 2.3 - 4.2/SS

SRC HPPK 2.3 - 4.2/SS

SRC HPP SK GP/SS

Valve Assembly 2.3 through 4.2 GPM

Items in Kit

30. 31, 32, 33, 34 & 35

40, 44 & 52 30, 31, 32, 33, 34, 35, 40, 44 & 52

 $\frac{1}{3}$

4 4

6

6

3

6

6

Per Kit

51 52

12180513CO-51

12180513CO-52

REPAIR KITS P/N:


B647800003

B653090001

B654080002

B652090002




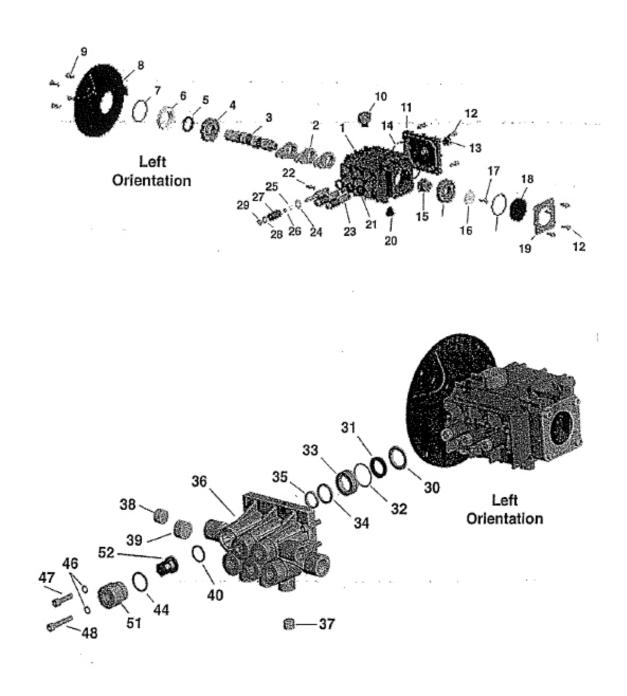

Parts View

16. HP PUMP ASSY-SINGLE PHASE B156140001 (Optional) HIGH PRESSURE PUMP AND MOTOR ASSEMBLY SINGLE PHASE ALTERNATING CURRENT 100/220 VAC 50 Hz, SINGLE PHASE & 115/230 VAC, 60 Hz, SINGLE PHASE


ITEM NO.	PART NUMBER	DESCRIPTION	QTY.
1	12207602RW	COUPLER TX1	1
2	2115031020-2	RUBBER MOTOR MOUNT 40LB. I	4
3	2317100300	TRANSDUCER 0-2000 PSI 7/16" SAE	1
4	061142150012	BOLT HEX 5/16-18 X 3/4 SS	4
5	061100049000	WASHER FLAT OS 5/16" SS	4
6	061060050000	HEX NUT 5/16-18 W/INSERT SS	4
7	061060057000	NUT HEX 3/8-16 W-INSERT SS	4
8	061142157028	BOLT HEX 3/8-16 X 1 3/4 SS	4
9	-	(NOT USED)	
10	2115031020-1	RUBBER MOTOR MOUNT 40LB.	4
11	061080056000	WASHER FLAT 3/8" SS	8
12	15AE261912	MOTOR 3/2.5 HP 115/230 1PH	1
13	061142157016	BOLT HEX 3/8-16 X 1 SS	4
14	12572405DS	HPRA PUMP 4.37 GPM V2	1
15	0101062683	ELB90 .50 FNPT X .75 BARB PVC	1
16	1317021869	ELB90 -6 FLARE X 3/4 UNF SS	1
17	353033002A	0-RING 017	1
18	061120091000	WASHER SPLIT LOCK M6 SS	1
19	061142191174	HEX BOLT M6 X 20MM SS	2
20	1220770101	BELL HOUSING AQ/AW 1PH	1
21	0117372530	NIPPLE 1/2NPT X 3.0 LG SS	1
22	2317100200	TRANSDUCER 0-200 PSI 7/16" SAE	1
23	20200239000	PLATE, MOTOR MOUNT,	1
24	4928402800	CONDUIT .50 FLEX BLK	1
25	1920016590	STRAIN RELIEF 90, .50 BLK W-NUT	1

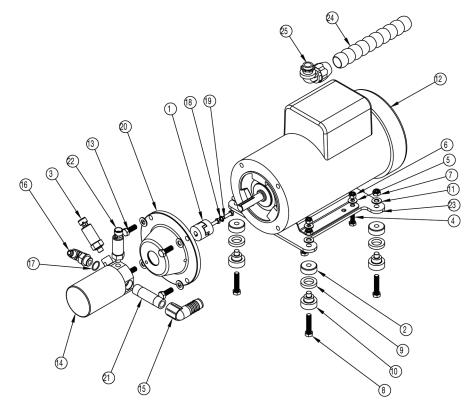

17. HP PUMP ASSY-3 PHASE B156140002 (Optional)

HIGH PRESSURE PUMP AND MOTOR ASSEMBLY THREE PHASE ALTERNATING CURRENT 200-220/380 VAC 50 Hz, 3 PHASE AND 208-230/460 VAC, 60 Hz, 3 PHASE


ITEM NO.	PART NUMBER	DESCRIPTION	QTY.
1	15AF271910	MOTOR 3/2.5 HP 3 PH 50/6	1
2	061080056000	WASHER FLAT 3/8" SS	8
3	061142157016	BOLT HEX 3/8-16 X 1 SS	4
4	12572405DS	HPRA PUMP 4.37 GPM V2	1
5	0101062683	ELB90 .50 FNPT X .75 BARB PVC	1
6	1317021869	ELB90 -6 FLARE X 3/4 UNF SS	1
7	12207602RW	COUPLER TX1	1
8	353033002A	0-RING 017	1
9	061120091000	WASHER SPLIT LOCK M6 SS	2
10	061142191174	HEX BOLT M6 X 20MM SS	2
11	1220770103	BELL HOUSING AQ/AW 3PH	1
12	0117372530	NIPPLE 1/2NPT X 3.0 LG SS	1
13	2317100300	TRANSDUCER 0-2000 PSI 7/16" SAE	1
14	2317100200	TRANSDUCER 0-200 PSI 7/16" SAE	1
15	061100049000	WASHER FLAT OS 5/16" SS	4
16	061060050000	HEX NUT 5/16-18 W/INSERT SS	4
17	061142150012	BOLT HEX 5/16-18 X 3/4 SS	4
18	20200239000	PLATE, MOTOR MOUNT,	1
19	061060057000	NUT HEX 3/8-16 W-INSERT SS	4
20	061142157028	BOLT HEX 3/8-16 X 1 3/4 SS	4
21	-	(NOT USED)	
22	2115031020-1	RUBBER MOTOR MOUNT 40LB.	4
23	2115031020-2	RUBBER MOTOR MOUNT 40LB.	4
24	1920016590	STRAIN RELIEF 90, .50 BLK W-NUT	1
25	4928402800	CONDUIT .50 FLEX BLK	1

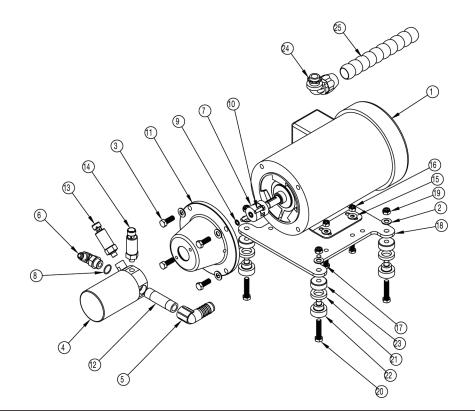

18. HP HOSE ASSEMBLY B3901200XX

PART NUMBER	DESCRIPTION	LENGTH	PORT
B390120001	HOSE HP ASSY AQMC & AQTC 450-1	17 3/4" / 451mm	INLET
B390120002	HOSE HP ASSY AQMC & AQTC 450-1	12" / 305mm	OUTLET
B390120003	HOSE HP ASSY AQMC & AQTC 700-1	19 3/4" / 502mm	INLET
B390120004	HOSE HP ASSY AQMC & AQTC 700-1	14 1/4" / 362mm	OUTLET
B390120005	HOSE HP ASSY AQMC & AQTC 900-1	23 3/4" / 603mm	NLET
B390120006	HOSE HP ASSY AQMC & AQTC 900-1	17 3/4" / 451mm	OUTLET
B390120007	HOSE HP ASSY AQMC & AQTC 900-2	17 3/4" / 451mm	INLET
B390120008	HOSE HP ASSY AQMC & AQTC 900-2	28 3/4" / 730mm	OUTLET
B390120009	HOSE HP ASSY AQMC & AQTC 1400-2	19 3/4" / 502mm	INLET
B390120000	HOSE HP ASSY AQMC & AQTC 1400-2	30 3/4" / 781mm	OUTLET
B390120011	HOSE HP ASSY AQMC & AQTC 1800-2	23 3/4" / 603mm	INLET
B390120012	HOSE HP ASSY AQMC & AQTC 1800-2	35 1/4" / 895mm	OUTLET

SPECIFY PART NUMBER AND DESCRIPTION OF SPECIFIC HIGH PRESSURE HOSE ASSEMBLY OR IF A SPECIAL LENGTH IS REQUIRED, SPECIFY MEASURED OVERALL LENGTH: FITTING TO FITTING

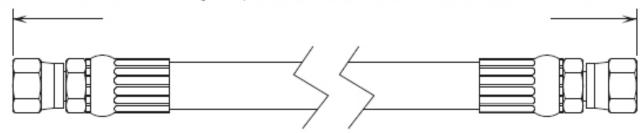

OVERALL LENGTH IS + / - 1/4" (6mm)

19. RO MEMBRANE-SINGLE ASSEMBLY B19800002X

SINGLE REVERSE OSMOSIS MEMBRANE/VESSEL ASSEMBLY

AQUA WHISPER MODEL AND STYLE	PART NUMBER	DESCRIPTION
AQUA WHISPER 450-1 COMPACT	B198000020	MEMBRANE RACK 450-1 AQMC
AQUA WHISPER 700-1 COMPACT	B198000021	MEMBRANE RACK 700-1 AQMC
AQUA WHISPER 900-1 COMPACT	B198000022	MEMBRANE RACK 900-1 AQMC

REFER TO ILLUSTRATION ON THE NEXT PAGE.

ITEM	PART NUMBER	DESCRIPTION	QTY	U/M
1	061060045000	NUT HEX 1/4-20 W/INSERT SS	2	EACH
2	061100043000	WASHER FLAT OS 1/4" SS	4	EACH
3	061142145016	BOLT HEX 1/4-20 X 1 SS	2	EACH
4	0117410800	NIPPLE HP MVA AW	2	EACH
5	2614017900	0-RING 115 INTERCONNECTAW	4	EACH
6	2453502400	END PLUG SINGLE 3" AW	1	EACH
7	2453512400	END PLUG DUAL 3" AW	1	EACH
8	20201030000	SEGMENT RING AW (SET)	2	EACH
9	0520210600	RETAINER PORT MVA AW	2	EACH
10	061162345012	SC SOC CAP 1/4-20 X 3/4 SS	6	EACH
11	0101370815	NIPPLE 1/4 NPT X 1 1/2 PVC	1	EACH
12	0204010869	ELB90 1/4 TUBE X 1/4 FPT PLAST	1	EACH
13	2614010100	0-RING 116 PRODUCTAS/AW	2	EACH
14	2614014900	0-RING 230 BRINE 3" END PLUG	4	EACH
15	2234011360	LABEL OUTLET (SRC BLUE)	1	EACH
16	2234011260	LABEL INLET(SRC BLUE)	1	EACH
17	2220010660	LABEL MEMBRANE SERIAL NO. SRC	1	EACH
18	0312121969	TUBE 1/4 BLACK	1.5	FEET
19	05202401GR	BRACKET MVA (AL) U CLAMP AW	2	EACH
20	0520051800	MVA RACK, AW SERIES >9/01	2	EACH
21	061161845012	SC ALLEN FLAT 1/4-20 X 3/4 SS	4	EACH
22	2632180426	DECOFELT 1/8 X 1 1/4 BLK ADH B	0.5	FEET
23	1317011769	ELB90 -6 FLARE X 1/4 FPT SS	2	EACH
24	0204990200	PLUG 3/8 JQ	1	EACH
25	0204690100	REDUCER 3/8 X1/4 JQ	1	EACH

FOR AQUA WHISPER DX 450-1:


26	B390120001	HOSE HP ASSY AQMC 450-1 17.75" INLET	1	EACH
27	B390120002	HOSE HP ASSY AQMC 450-1 12" OUTLET	1	EACH
28	2408132500	VESSEL HIGH PRESSURE 450GPD AW	1	EACH
29-30	2724011233	MEMBRANE 450GPD AW W/ BRINE SEAL	1	EACH
30	2614050433	BRINE SEAL 3"		


FOR AQUA WHISPER DX 700-1:

26	B390120003	HOSE HP ASSY AQMC 700-1 19.75" INLET	1	EACH
27	B390120004	HOSE HP ASSY AQMC 700-1 14.25" OUTLET	1	EACH
28	2408132500-01	VESSEL HIGH PRESSURE 700GPD AW	1	EACH
29-30	2724011333	MEMBRANE 700GPD AW W/ BRINE SEAL	1	EACH
30	2614050433	BRINE SEAL 3"		

FOR AQUA WHISPER DX 900-1:

26	B390120005	HOSE HP ASSY AQMC 900-1 23.75" INLET	1	EACH
27	B390120006	HOSE HP ASSY AQMC 900-1 17.75" OUTLET	1	EACH
28	2408132500-02	VESSEL HIGH PRESSURE 900GPD AW	1	EACH
29-30	2724011433	MEMBRANE 900GPD AW W/ BRINE SEAL	1	EACH
30	2614050433	BRINE SEAL 3"		

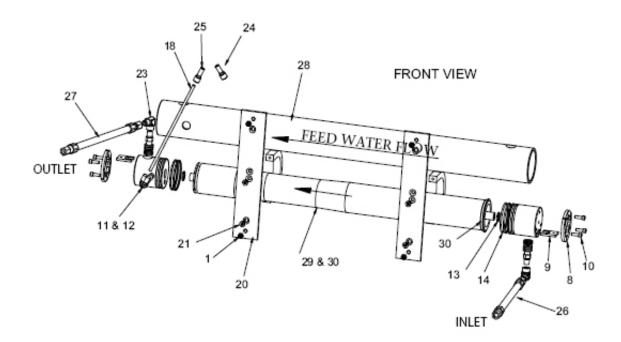

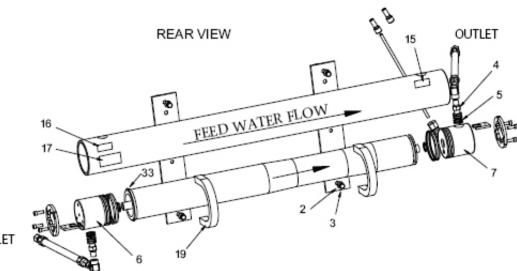

INLET

20. RO MEMBRANE-DOUBLE ASSEMBLY B19800002X

DOUBLE REVERSE OSMOSIS MEMBRANE/VESSEL ASSEMBLY FOR AQUA WHISPER COMPACT STYLE:

AQUA WHISPER DX MODEL AND STYLE	PART NUMBER	DESCRIPTION
AQUA WHISPER DX 900-2 COMPACT	B198000023	MEMBRANE RACK 900-2 AQMC
AQUA WHISPER DX 1400-2 COMPACT	B198000024	MEMBRANE RACK 1400-2 AQMC
AQUA WHISPER DX 1800-2 COMPACT	B198000025	MEMBRANE RACK 1800-2 AQMC

REFER TO ILLUSTRATION ON THE OPPOSITE PAGE.

ITEM	PART NUMBER	DESCRIPTION	QTY	U/M
1	061060045000	NUT HEX 1/4-20 W/INSERT SS	2	EACH
2	061100043000	WASHER FLAT OS 1/4"SS	4	EACH
3	061142145016	BOLT HEX 1/4-20 X 1 SS	2	EACH
4	0312121969	TUBE 1/4 BLACK	4	FEET
5	0117410800	NIPPLE HP MVA AW	2	EACH
6	2614017900	0-RING 115 INTERCONNECTAW	8	EACH
7	H36160522402	END PLUG 3" DUAL, HORIZON SEAF	1	EACH
8	2453502402	END PLUG DUAL 3" AW	1	EACH
9	2453502403	END PLUG SINGLE 3" AW	2	EACH
10	20201030000	SEGMENT RING AW (SET)	4	EACH
11	0520210600	RETAINER PORT MVA AW	4	EACH
12	061162345012	SC SOC CAP 1/4-20 X 3/4 SS	12	EACH
13	0101370815	NIPPLE 1/4 NPT X 1 1/2 PVC	2	EACH
14	0204010869	ELB90 1/4 TUBE X 1/4 FPT PLAST	2	EACH
15	2614010100	0-RING 116 PRODUCTAS/AW	4	EACH
16	2614014900	0-RING 230 BRINE 3" END PLUG	8	EACH
17	2234011360	LABEL OUTLET (SRC BLUE)	2	EACH
18	2234011260	LABEL INLET(SRC BLUE)	2	EACH
19	2220010660	LABEL MEMBRANE SERIAL NO. SRC	2	EACH
20	05202401GR	BRACKET MVA (AL) U CLAMP AW	4	EACH
21	0520051800	MVA RACK, AW SERIES >9/01	2	EACH
22	2417430800	INTERCONNECT MVA SS AW	1	EACH
23	061161845012	SC ALLEN FLAT 1/4-20 X 3/4 SS	8	EACH
24	2632180426	DECOFELT 1/8 X 1 1/4 BLK ADH B	1	FEET
25	0204690100	REDUCER 3/8 X1/4 JQ	2	EACH
26	0117010869	ELB90 1/4 FPT X 1/4 FPT SS	1	EACH
27	1317061769	ELB45 -6 FLARE X 1/4 MPT SS	1	EACH
28	1317011769	ELB90 -6 FLARE X 1/4 FPT SS	1	EACH

FOR AQUA WHISPER 900-2:


29	B390120007	HOSE HP ASSY AQMC 900-2 17.75" INLET	1	EACH
30	B390120008	HOSE HP ASSY AQMC 900-2 28.75" OUTLET	1	EACH
31	2408132500	VESSEL HIGH PRESSURE 450GPD AW	2	EACH
32-33	2724011233	MEMBRANE 450GPD AW W/ BRINE SEAL	2	EACH
33	2614050433	BRINE SEAL 3"		


FOR AQUA WHISPER 1400-2:

29	B390120009	HOSE HP ASSY AQMC 1400-2 19.75 INLET	1	EACH
30	B390120000	HOSE HP ASSY AQMC 1400-2 30.75 OUTLET	1	EACH
31	2408132500-01	VESSEL HIGH PRESSURE 700GPD AW	2	EACH
32-33	2724011333	MEMBRANE 700GPD AW W/ BRINE SEAL	2	EACH
33	2614050433	BRINE SEAL 3"		

FOR AQUA WHISPER 1800-2:

29	B390120011	HOSE HP ASSY AQMC 1800-2 23.75 INLET	1	EACH
30	B390120012	HOSE HP ASSY AQMC 1800-2 35.25 OUTLET	1	EACH
31	2408132500-02	VESSEL HIGH PRESSURE 900GPD AW	2	EACH
32-33	2724011433	MEMBRANE 900GPD AW W/ BRINE SEAL	2	EACH
33	2614050433	BRINE SEAL 3"		

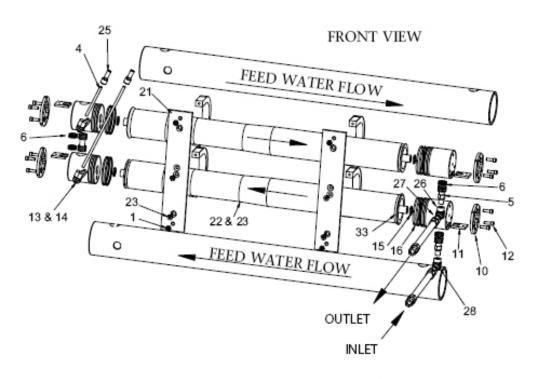

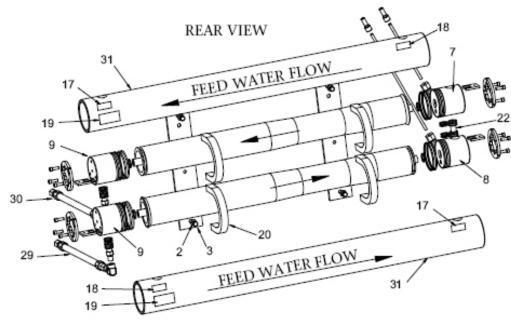

PREFILTRATION CARTRIDGE FILTER ELEMENT WARNING:

Do not use third party Prefiltration Elements (Plankton Filter Elements, Prefilter Elements, Commercial Prefilter Elements, or Oil/Water Separator Elements). Use only Sea Recovery supplied Prefiltration Elements. Third party prefiltration elements on the market do not properly fit into the Sea Recovery Filter Housings, the seams fall apart, and they will allow by-pass resulting in EXTENSIVE AND EXPENSIVE DAMAGE TO THE HIGH PRESSURE PUMP AS WELL AS PREMATURE FOULING OF THE R.O. MEMBRANE ELEMENT.

Damage caused to the Sea Recovery High Pressure Pump, R.O. Membrane Element, or any other component from the use of third party, non Sea Recovery supplied, filter elements is the responsibility and liability of the operator and is not covered by the Sea Recovery Warranty.


FILTER ELEMENT CAUTION:

Do not use "string wound" or "fiber" type prefilter elements. These type of elements are designed for the Photographic Film Developing industry. When used in sea water they will plug up rapidly in 1/10th or less the time causing frequent shut down of the system and very frequent changing resulting in very high cost of maintenance.

21. FRAME ASSEMBLY B586940002


Parts View

		BILL OF MATERIAL (B.O.M.)	
ITEM NO.	FILE/DWG. NAME	DESCRIPTION	QTY.
1	3120231000	BASE PLATE AQMM II ASSY	1
2	3120221302	COVER ENCLOSURE AQWM-DX HMI	1
3	31316801MT	MICRO BULKHEAD FEED-THRU ASSY	3
4	31316814MT	MICRO SINGLE ENDED CORDSET F	3
		FEMALE TO OPEN ENDED TERMINAL	
5	061110049000	WASHER FENDER .312 SS	4
6	061161631008	SC PHIL FLAT #10-32 x .50 SS	6
7	061172149036	SEC HEX -A-5_16 X 2 3_8 SS	4
8	1904010243	STRAIN RELIEF 3222 .75 BLK	3
9	1904011800	STRAIN RELIEF 3 HOLE X 6MM	6
10	2020043902	SPACER MOTOR MOUNT AQM II	4
11	2115031700	RUBBER MOTOR MOUNT 90LB AQM	4
12	2632112700X	PLUG BLANKING REMOTE AQM .625	4

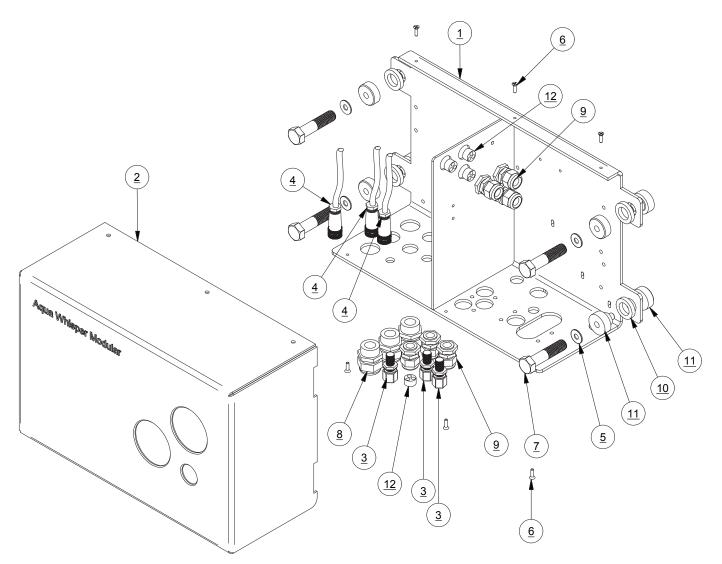

22. CONTROLLER CHASSIS ASSY-SINGLE PHASE B619940001

ITEM NO.	PART NUMBER	DESCRIPTION	QTY.
1	313106038F	HP PUMP CONTACTOR	1
2	31318301DX	EMI FILTER	1
3	B604150002	POWER SUPPLY ASSY	1
4	B619940001	DIN RAIL ASSY	1

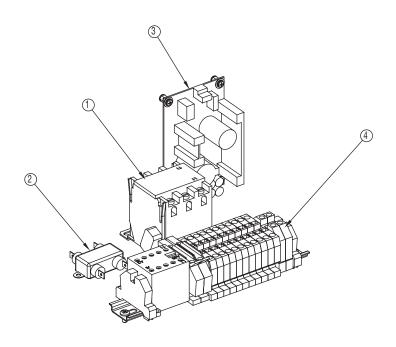


Parts View

23.


CONTROLLER CHASSIS ASSY-THREE PHASE B619940002

ITEM NO.	PART NUMBER	DESCRIPTION	QTY.
1	313106038F	HP PUMP CONTACTOR	1
2	3131131500	ELEC TRANSFORMER 480/120 BUCK	1
3	B604150002	POWER SUPPLY ASSY	1
4	B604150001	DIN RAIL ASSY	1
	ITEM NO. 1 2 3 4	1 313106038F 2 3131131500 3 B604150002	1 313106038F HP PUMP CONTACTOR 2 3131131500 ELEC TRANSFORMER 480/120 BUCK 3 B604150002 POWER SUPPLY ASSY

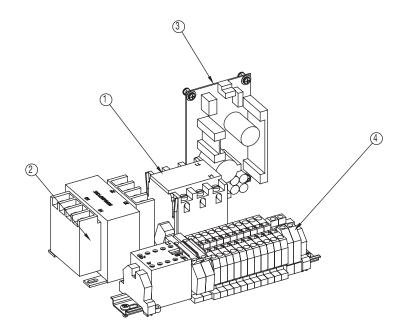

25. LP BACK PRESSURE PLATE ASSY B515150003

		PARTS LIST	
ITEM	PART NUMBER	DESCRIPTION	QTY
1	0101341883	PLUG 0.375 MT	2
2	14012007	MAMANIFOLD, AQM 1-4 DV, NYL, PRESS, LOW, 6X1.5X3	1
3	11026520AO	FLOWMETER IN-LINE .07-2.6GPM	1
4	11026920AO	FLOWMETER IN-LINE .53-7.9GPM	1
5	1401096100	VALVE SOLENOID 12VDC	1
6	20-4096	PROBE, CONDUCTIVITY, 5-WIRE, 5 LONG CABLE	1
7	3131680298	PLUG CONNECTOR DIN 3-PIN	1
8	0101371815	NIP 3-8NPTx1-1_2L PVC80	1
9	01015518HR	COUPLER .375 FIPT x .375 FIPT PVC	3
10	0112651900	ADAP .375 MPT X .50 BARB NYLON	1
11	0204012469	ELBOW,PP,1/2 ODx3/8 FT	1
12	0204021869	ELBOW,PP,3/8 ODx3/8 MT	1
13	0204022069	ELBOW,PP,3-8 ODx3-4 MT	1
14	0204022469	ELBOW,PP,1/2 ODx3/8 MT	1
15	0204091869	FITTING,PP,3/8 ODx3/8 MT	1
16	0204092569	FITTING,PP,1/2 ODx1/2 MT	1
17	30-0061	TEE, NYL, 3/4" FNPT	1
18	30-1544	BUSHING, NYL, .075NPT X .375FNPT	1
19	0204122569	FITTING, PP, 1/2"OD X 1/2FT	1
20	0312123569	TUBE .375 BLACK	1
21	0312124269	TUBE,PP,0.50 x 8.25	1
22	0117341869	PLUG .375 MNPT SS	1
23	061080028000	WASHER FLAT #10 SS	2
24	061160526048	SC 8-32 x 3.00 SS	2
25	061160630012	SC PHIL PAN 10-24 X .75 SS	2
26	0301094100	PIPE PVC SCH 80 .375 IN x 3	1
27	4942220809	WIRE 18GA 2COND BLUE FLEX C	4 FT

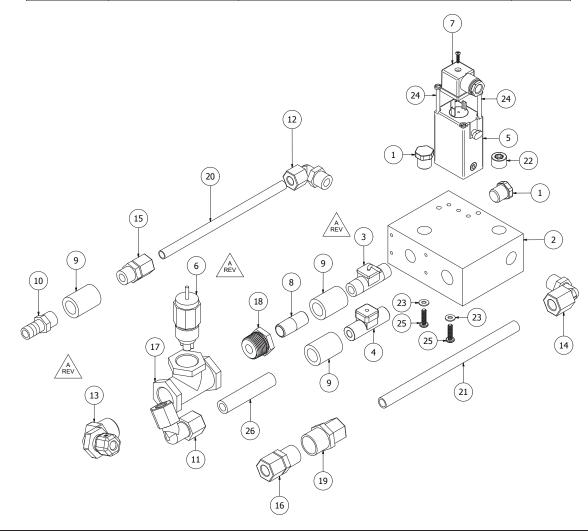

ITEM NO.	PART NUMBER	DESCRIPTION	QTY.
1	2317100200	TRANSDUCER 0-200 PSI 7/16" SAE	1
2	0112652500	ADAP 1/2 MNPT X 1/2 BARB NYLON	2
3	0101342583	PLUG 1/2 MPT PVC	1
4	590111401A	PLUG 7/16 -14 O-RING BOSS TYP	1
5	5301400801	MANIFOLD LP PICKUP, AQM II	1
6	0204090869	CONN .250 Tube x .250 MNPT PLASTIC	1


26. LP MANIFOLD-COMMERCIAL PREFILTER B502160001

1 (4) 6 \bigcirc \bigcirc \bigcap 5 0 2 0 3

27. LP MANIFOLD -DUAL PREFILTER B502160002

/iev
>
t St
ลิ


ITEM NO.	PART NUMBER	DESCRIPTION	QTY.
1	5301400801	MANIFOLD LP PICKUP, AQM II	1
2	2317100200	TRANSDUCER 0-200 PSI 7/16" SAE	1
3	0112652500	ADAP 1/2 MNPT X 1/2 BARB NYLON	2
4	0101342583	PLUG 1/2 MPT PVC	1

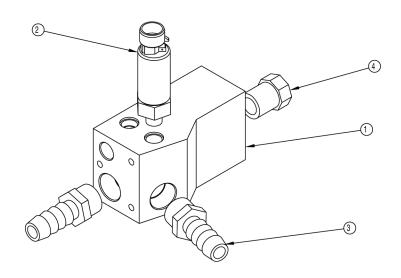

Parts View

ITEM NO.	PART NUMBER	DESCRIPTION	QTY.
1	5301160900	MANIFOLD HP AQW DX	1
2	0520210600	RETAINER PORT MVA AW	2
3	0117410800	NIPPLE HP MVA AW	2
4	2614017900	0-RING 115 INTERCONNECT AW	4
5	061170618109	SC PHIL PAN A #6 X .75 SS	2
6	10181421CC	GAUGE 0 -1400 CBM.ORING SEAL	1
7	2614015800	ORING 011 GAUGE-PRES SWITCH	2
8	0117230869	ELB90 ST .25 MPT X .25 FPT SS	1
9	1417017896	VALVE PRESS REGULATOR-AS	1
10	1317011769	ELB90 6 FLARE X .25 FPT SS	1
11	0204092369	CONN 1/2 TUBE X 1/4 MPT PLASTIC	1
12	061160131020	SC PHIL RD 10-32 X 1.25 SS	3
13	061010031000	NUT HEX 10-32 SS	3
14	061080028000	WASHER FLAT #10 SS	3

28. HP MANIFOLD ASSEMBLY B502930001

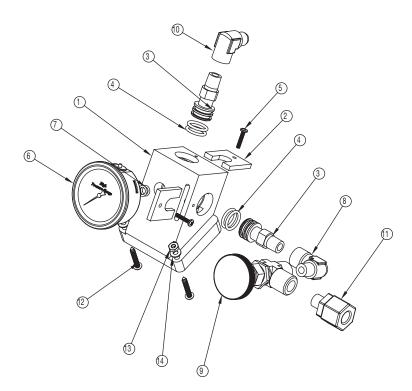

01013718CL


29. POST FILTER-DUAL ASSY B114140001

	<
	e S
	_
	-
	~
	2
	ar
1	

11

ITEM NO. PART NUMBER DESCRIPTION QTY. 0713020573 FILTER HOUSING/LID 3/8 X 10 2 1 2 20200402101 DUAL BRACKET, PRE-FILTER, CHRCL/PLNKTN 1 3 08251950AS ELEMENT PH 9 3/4" 1 4 CHARCOAL FILTER 10 IN 0803004773 1 5 0204021869 ELB90 3/8 TUBE X 3/8 MPT PLASTIC 2 6 061170628016 SC PHIL PAN "A" 10 X 1 SS 8 7 061080028000 WASHER FLAT #10 SS 8 4 8 061142145012 BOLT HEX 1/4-20 X 3/4 SS 9 061100043000 WASHER FLAT OS 1/4"SS 4 10 4 061060045000 NUT HEX 1/4-20 W/INSERT SS


NIPPLE 3/8 NPT X CLOSE PVC

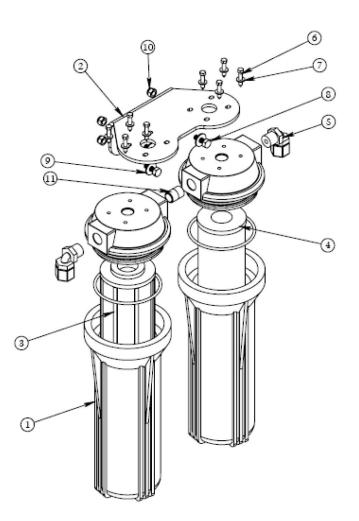

1

ITEM	PART NUMBER	DESCRIPTION	QTY	U/M
1-11	B591120001	CLEAN AND RINSE KIT AQM		
1	14011334AR	VALVE 3-WAY BALL 3/4" MPT	2	EA
2	0101063783	ELB90 3/4" FPT X 3/4" BARB PVC	4	EA
3	0101613783	ADAP 3/4" FPT X 3/4" BARB PVC	2	EA
4	0501164200	PIPE SUPPORT 1 1/8"	4	EA
5	061060026000	NUT HEX 8-32 W/INSERT SS	4	EA
	061161626012	SC PHIL FLAT 8-32 X 3/4" SS (NOT SHOWN)	4	EA
	061170628016	SC PHIL PAN "A" 10 X 1" SS (NOT SHOWN)	8	EA
8	065080028000	WASHER FLAT #10 NYLON	8	EA
9	20200404040	BRACKET CLEAN & RINSE KIT AS	2	EA
10	05181434AA	HOSE CLAMP 3/4" SS	12	EA
11	0328066666	HOSE CLEAR BRAID 3/4"	20	FT

30. CLEAN AND RINSE KIT B591120001

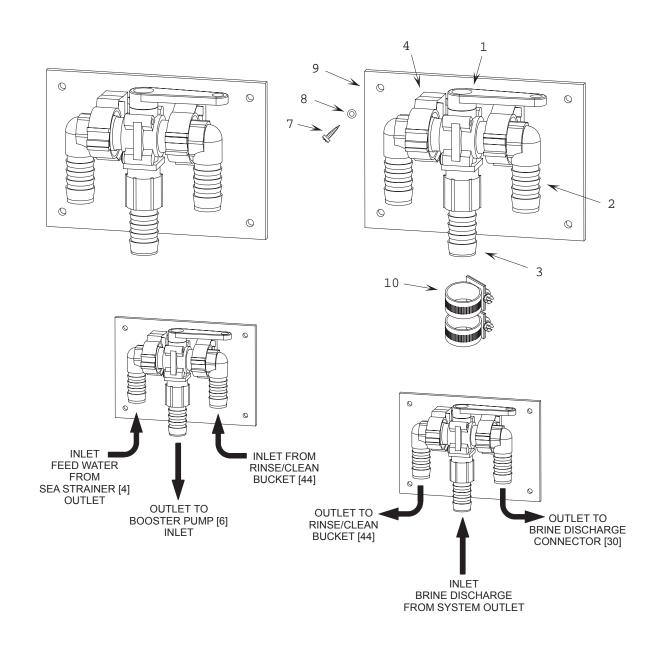


31. FRESH WATER FLUSH (.50 INCH) B598000008

ITEM	PART NUMBER	DESCRIPTION	U/M	QTY
1	0713020873	FILTER HOUSING 1/2" X 10	EACH	1
2	0803004773	CHARCOAL FILTER 10 IN	EACH	1
3	14172105AT	VALVE CHECK .25 MNPT SS	EACH	1
4	0204091769	CONN 3/8 TUBE X 1/4 MPT PLASTIC	EACH	1
5	1401095998	VALVE SOLENOID 12VDC AED/CSFE	EACH	1
6	0101340883	PLUG 1/4 MPT PVC	EACH	1
7	3131680298	PLUG CONNECTOR DIN 3-PIN	EACH	1
8	20200402102	SINGLE FILTER BRACKET	EACH	1
9	061172143016	SC HEX "A" 1/4 X 1.0 SS	EACH	4
10	061100043000	WASHER FLAT OS 1/4"SS	EACH	4
11	065080023000	WASHER FLAT #8 NYLON	EACH	4
12	0101423783	TEE .75 FNPT x .75 FNPT x .75 FNPT PVC	EACH	1
13	0101653783	ADAP 3/4 MPT X 3/4 BARB PVC	EACH	2
14	0501164200	PIPE SUPPORT 1 1/8" #36	EACH	1
15	0501164500	PIPE SUPPORT 1 1/4"	EACH	1
16	01013737CL	NIPPLE .75 NPT X CLOSE PVC	EACH	1
17	14012118AR	VALVE CHECK .75 FNPT WITH VITO	EACH	1
18	061170628016	SC PHIL PAN "A" 10 X 1 SS	EACH	8
19	065080028000	WASHER FLAT #10 NYLON	EACH	8
20	061161626012	SC PHIL FLAT 8-32 X 3/4 SS	EACH	2
21	061060026000	NUT HEX 8-32 W/INSERT SS	EACH	2
22	2020040002	BRACKET CHECK VALVE FWF	EACH	1
23	0204021969	ELB90 3/8 TUBE X 1/2 MPT PLAST	EACH	1
24	0204011769	ELB90 .375 TUBE x .25 FNPT PLASTIC	EACH	2
25	05181432AA	HOSE CLAMP 1/2" SS	EACH	4
26	0312123569	TUBE .375 BLACK	FEET	15
27	061170623008	SC PHIL PAN "B" #8 X 1/2" SS	EACH	4
28	0204092069	CONN 3/8 TUBE X 3/4 MPT PLASTIC	EACH	1
	0	n		


Refer to illustration on page 10-43

FRESH WATER FLUSH (.50 INCH) B598000008 - Illustration

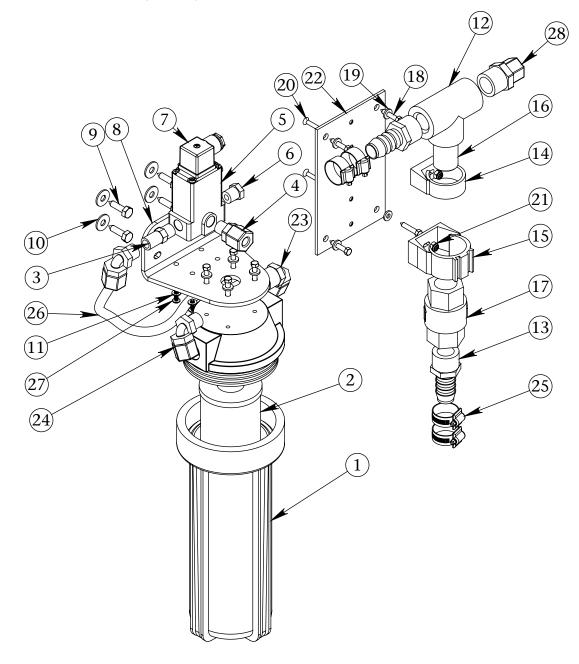


32. UV LIGHT ASSY B5262000CV


	BILL OF MATERIAL (B.O.M.)				
ITEM NO.	FILE/DWG. NAME	DESCRIPTION	QTY.		
1	40000306CV	UV STERILIZER 2 GPM 12VDC	1		
2	05011647AI	SUPPORT,PIPE,2.00	2		
3	0204091869	FITTING,PP,3/8 ODx3/8 MT	1		
4	0254011000	ELB90 0.25 MPT X 0.50BARB NY	2		
5	05181432AA	CLAMP,HOSE,SS,1/2"	4		
6	061100043000	WASHER FLAT OS .25 SS	2		
7	061142145020	SCREW,HEX HEAD,.25-20x1-1/4",SS	2		
8	061182143024	SC LAG 0.25 X 1.50 SS	2		
9	065070045000	NUT HEX .25-20 FLANGED	2		
10	2614019000	O-RING 212 QUARTZ SLEEVE	2		
11	B651830001A	OWNERS MANUAL QUICK INSTALLATION UV LIGHT SP SERIES	1		

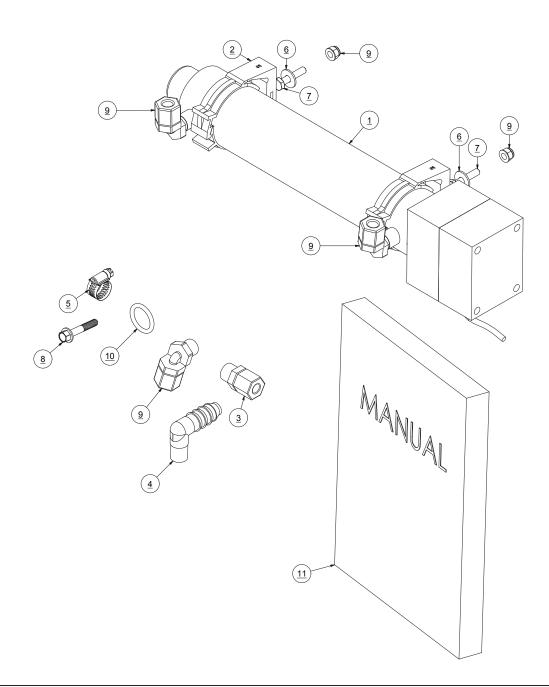

33. REMOTE KIT,100 FT CABLE,PARKER - 61012029

BILL OF MATERIAL (B.O.M.)				
ITEM	PART NUMBER	DESCRIPTION	QTY	
1	0901128	REMOTE CABLE ASSY 100' AQM 7IN	1	
2	11012072	BRACKET, FRONT COVER, HMI, AQM	1	
3	90012014	CONVERTER,12V TO 24V,HMI	1	
4	90012015	HMI, DISPLAY, 7 IN PROGRAMMED	1	
5	90012289	DONGLE,HMI,RS485,POWER,AQ	1	
6	061060020000	NUT,HEX 6-32 W-INSERT SS	2	
7	061080018000	WASHER FLAT #6 SS	2	
8	061080028000	WASHER FLAT #10 SS	4	
9	061160620008	SC PHIL PAN 6-32 X .50 SS	2	
10	061160620020	SC PHIL PAN 6-32 X 1 1/4 SS	4	
11	061170628016	SC PHIL PAN A #10 X 1 SS	4	

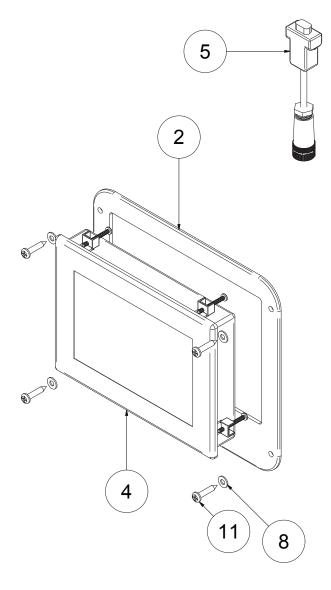


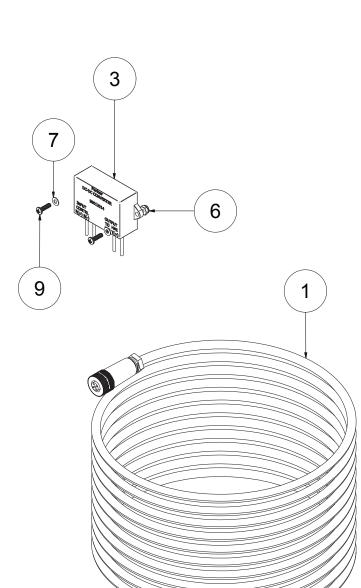

Ø


34. 61012030 REMOTE KIT,200 FT CABLE,PARKER

BILL OF MATERIAL (B.O.M.)				
ITEM	PART NUMBER	DESCRIPTION	QTY	
1	0901130	REMOTE CABLE ASSY 200' AQM 7IN	1	
2	11012072	BRACKET, FRONT COVER, HMI, AQM	1	
3	90012014	CONVERTER,12V TO 24V,HMI	1	
4	90012015	HMI, DISPLAY, 7 IN PROGRAMMED	1	
5	90012289	DONGLE,HMI,RS485,POWER,AQ	1	
6	061060020000	NUT,HEX 6-32 W-INSERT SS	2	
7	061080018000	WASHER FLAT #6 SS	2	
8	061080028000	WASHER FLAT #10 SS	4	
9	061160620008	SC PHIL PAN 6-32 X .50 SS	2	
10	061160620020	SC PHIL PAN 6-32 X 1 1/4 SS	4	
11	061170628016	SC PHIL PAN A #10 X 1 SS	4	

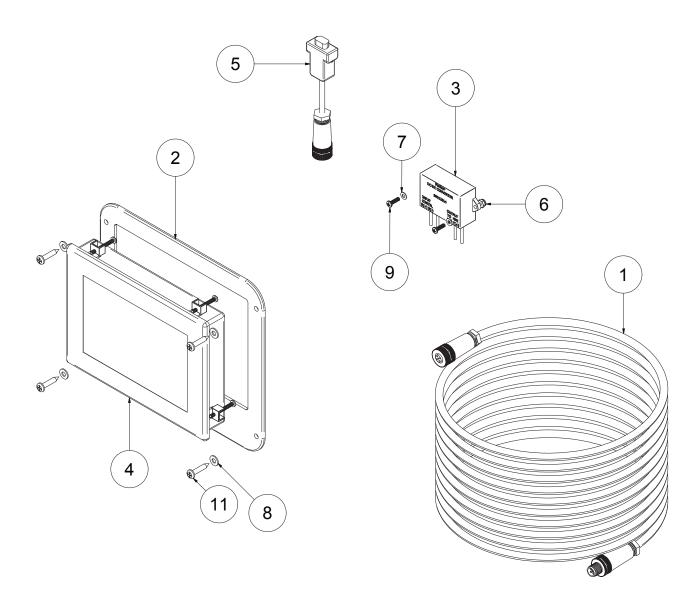


35. 61012032 REMOTE KIT,200 FT CBL,PRKR 4 IN HMI

BILL OF MATERIAL (B.O.M.)				
ITEM	PART NUMBER	DESCRIPTION	QTY	
1	0901130	REMOTE CABLE ASSY 200' AQM 7IN	1	
2	11012164	BEZEL4INCH NEW REMOTE HMI	1	
3	90012014	CONVERTER,12V TO 24V,HMI	1	
4	90012016	HMI, DISPLAY, 4.3" PROGRAMMED	1	
5	90012289	DONGLE,HMI,RS485,POWER,AQ	1	
6	061060020000	NUT, HEX 6-32 W-INSERT SS	2	
7	061080018000	WASHER FLAT #6 SS	2	
8	061080028000	WASHER FLAT #10 SS	4	
9	061160620008	SC PHIL PAN 6-32 X .50 SS	2	
10	061160620020	SC PHIL PAN 6-32 X 1 1/4 SS	4	
11	061170628016	SC PHIL PAN A #10 X 1 SS	4	

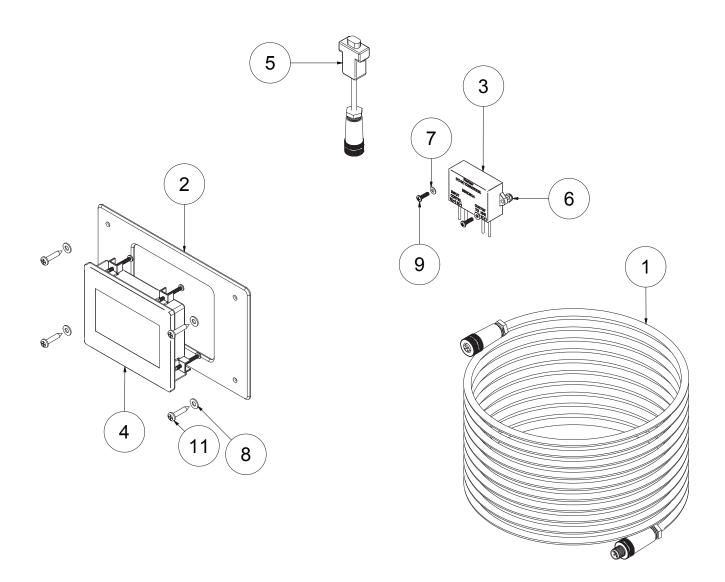


36. SOFT START ASSY

B596800015 SOFT START 115V 50-60HZ B596800014 SOFT START 230V 50-60HZ

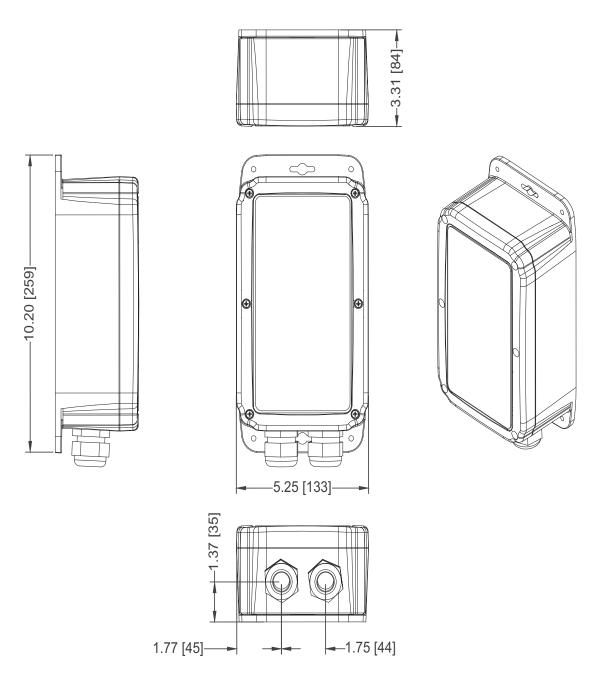

Aqua Whisper DX Modular 450-1800 Section 11 - FOLDOUT

Foldout

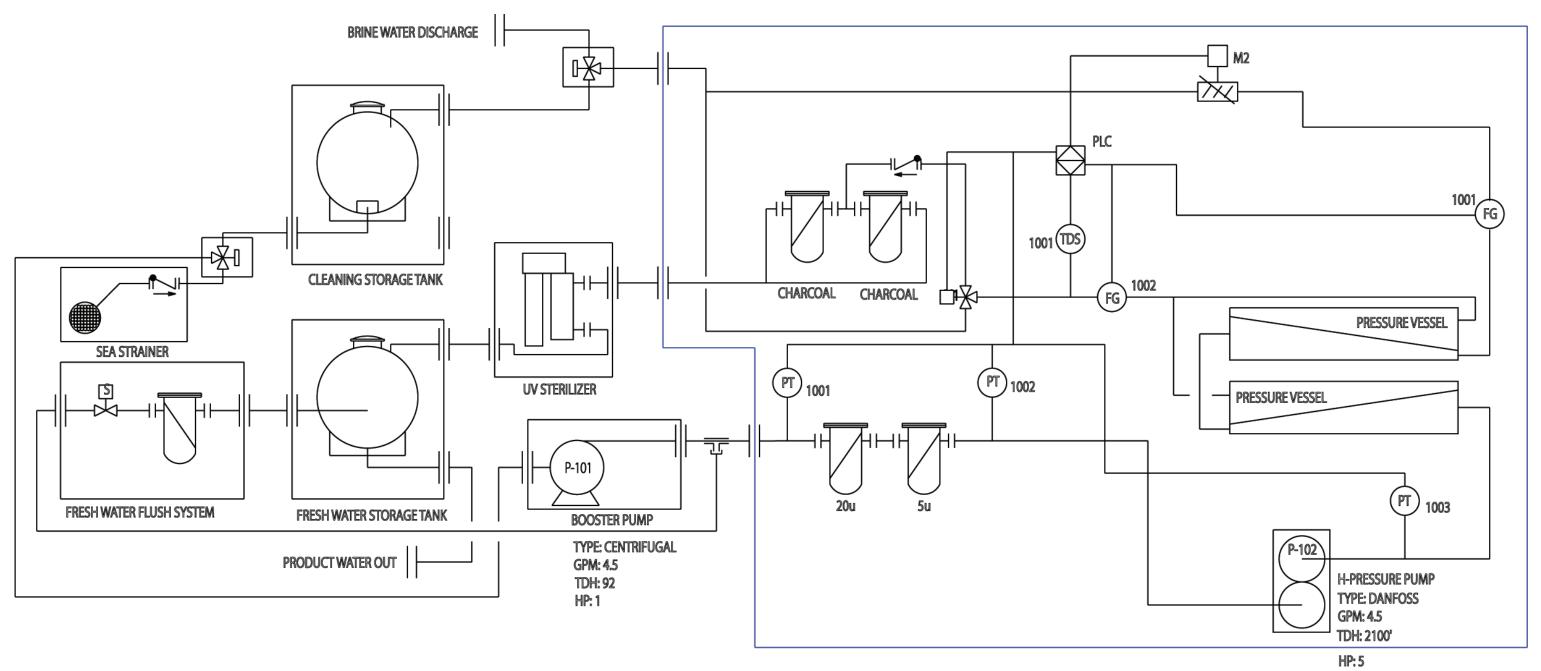


PT-Pressure Transducer PI-Pressure Indicator M-Meter FG-Flow Gauge TDS-TDS Meter P-Pump PLC-Program Logic Controller

Note: Illustration shows the optional HP Pump.

Standard P&ID

Sheet 11-1

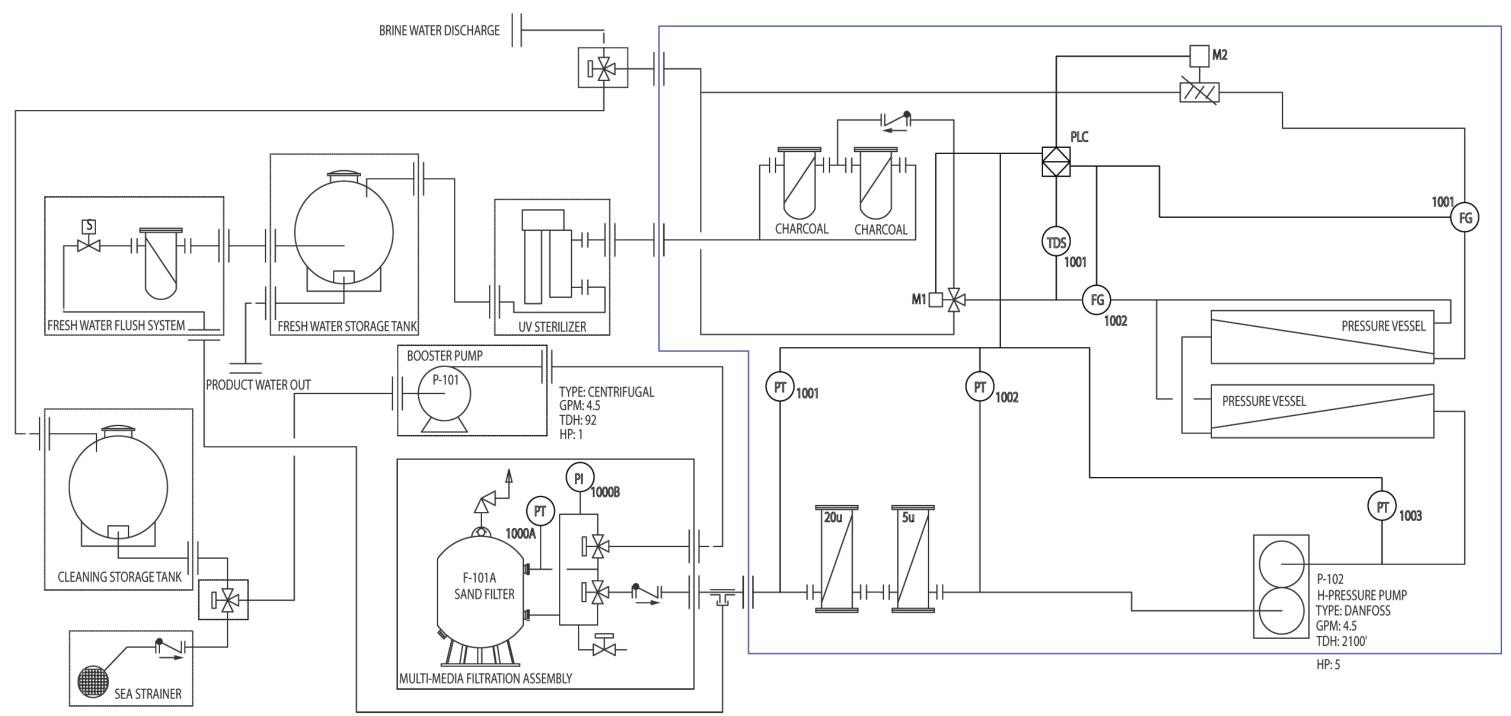


PT-Pressure Transducer PI-Pressure Indicator M-Meter FG-Flow Gauge TDS-TDS Meter P-Pump PLC-Program Logic Controller

Commercial P&ID


Sheet 11-2

Note: Illustration shows the optional HP Pump.

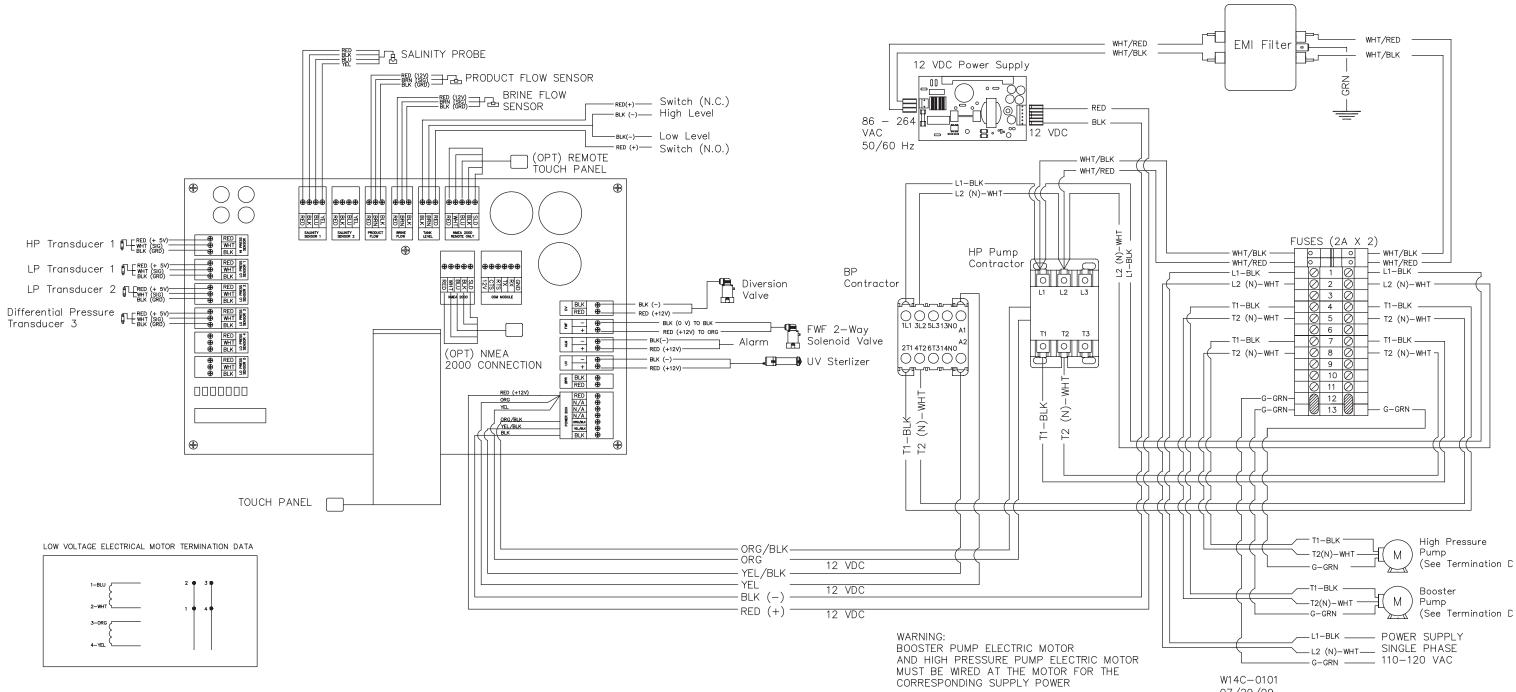

110-120 VAC, 50-60 HZ, Single Phase


07/29/09

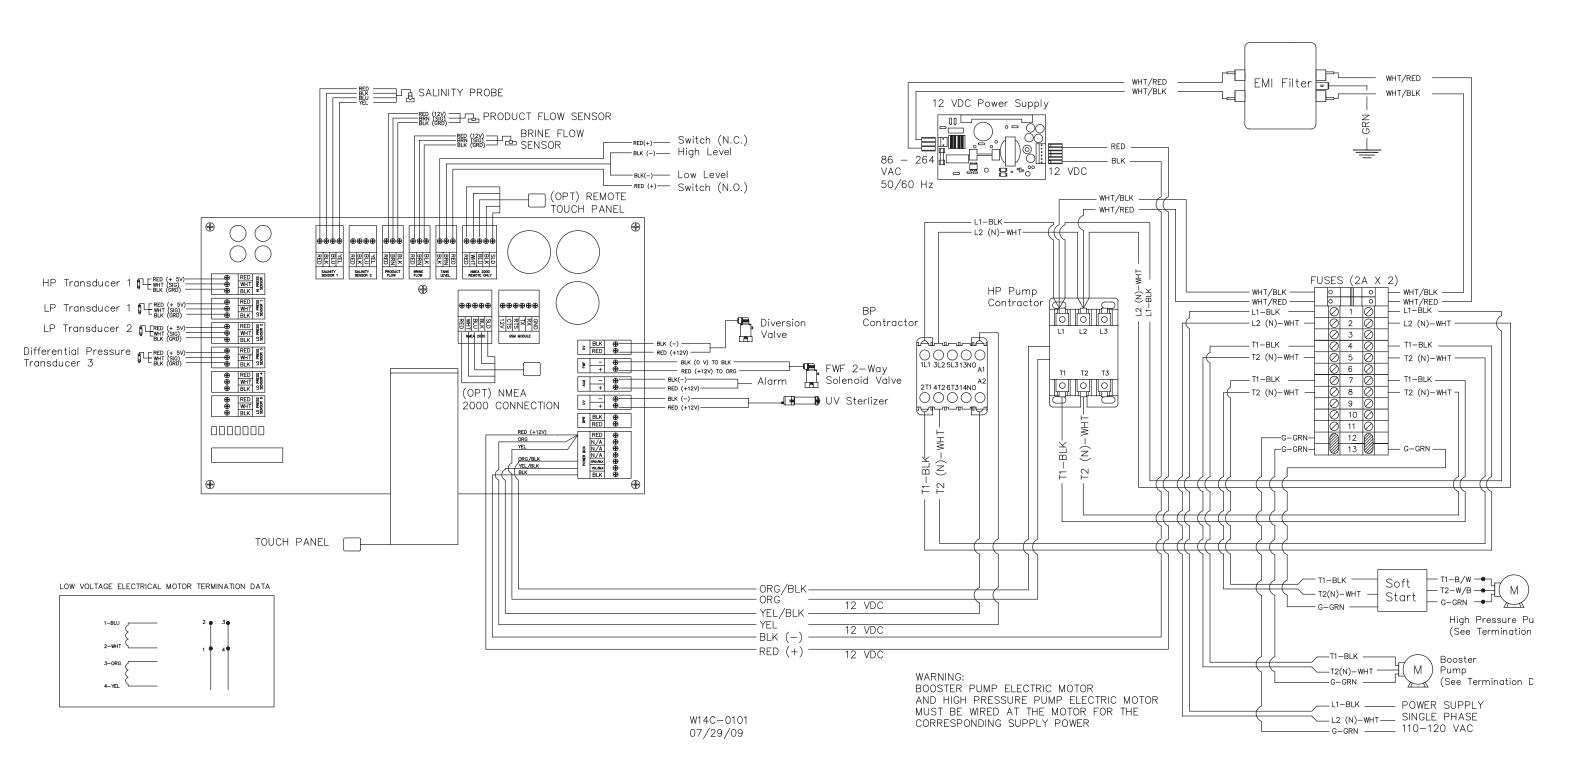


SALINITY PROBE 12 VDC Power Supply 酈腳計品 PRODUCT FLOW SENSOR 00 🖵 6 0 0 BRINE FLOW ER (20) - BKINE FI -RED(+)_____ Switch (N.C.) RED -BLK (-) High Level BLK VAC -BLK(-)— Low Level 50/60 Hz - (OPT) REMOTE TOUCH PANEL WHT/BLK WHT/RED – L1–BLK– \oplus • $\bigcirc \bigcirc$ — L2 (N)-WHT- $\check{\bigcirc}$ $\check{\bigcirc}$ HP Transducer 1 🗗 🖓 🗰 ⊕ HP Pump Contractor ⊕⊕⊕⊕⊕ ⊕⊕⊕⊕⊕⊕ LP Transducer 1 RP 12V GSW MODULE - 🖳 Diversion Contractor LP Transducer 2 L1 L2 L3 Valve 1A
 BLK
 ⊕
 BLK
 (-)


 BLK
 ⊕
 RED
 (+12V)
 Differential Pressure بطيط ------A RED SS WHT BLK 9 0000 1L1 3L2 5L3 13N0 Transducer 3 BLK (0 V) TO BLK <u>₹</u> - ⊕ RED (+12V) TO ORG -T1 T2 T3 RED STAN ____ Alarm 📙 Solenoid Valve BLK(-)-- RED (+12V)-----2T1 4T2 6T3 14N0 (OPT) NMEA 00000 3 - ⊕ — BLK (-)-UV Sterlizer 2000 CONNECTION - RED (+12V) ᢊ᠋ᡐᡎ᠆ᡎ᠆ᡎ᠋᠆ᡎᡇ BLK OF WHT 0000000 THW -(N) BLK YEL ORG/BLK BLK (N)-Τ2 BIK Ľ \oplus \oplus T1-T2 TOUCH PANEL HIGH VOLTAGE ELECTRICAL MOTOR TERMINATION DATA - ORG/BLK-- ORG 12 VDC - YEL/BLK ² 3 - YEL 1-BLU 12 VDC -BLK (-) -RED (+) 12 VDC WARNING: BOOSTER PUMP ELECTRIC MOTOR


BOOSTER PUMP ELECTRIC MOTOR AND HIGH PRESSURE PUMP ELECTRIC MOTOR MUST BE WIRED AT THE MOTOR FOR THE CORRESPONDING SUPPLY POWER

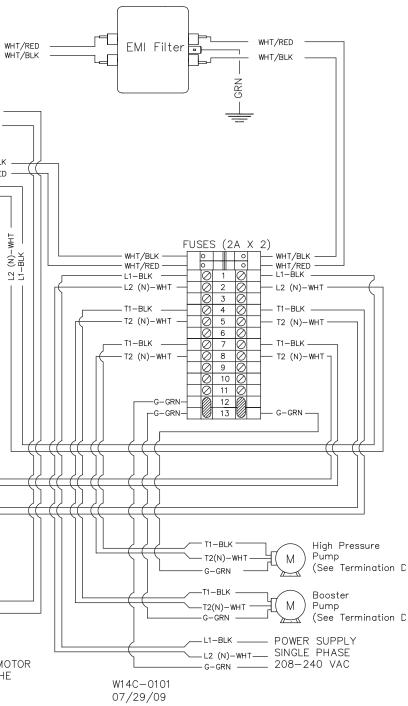


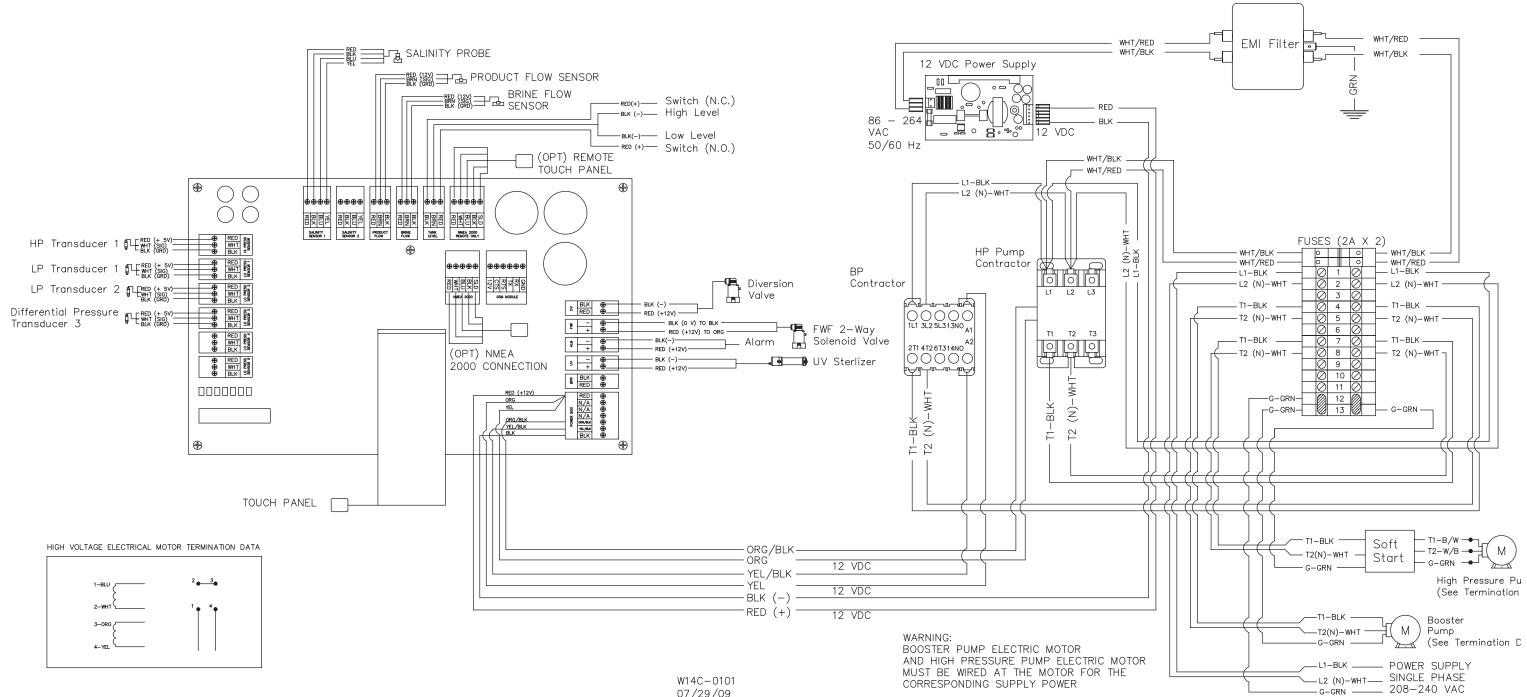


07/29/09

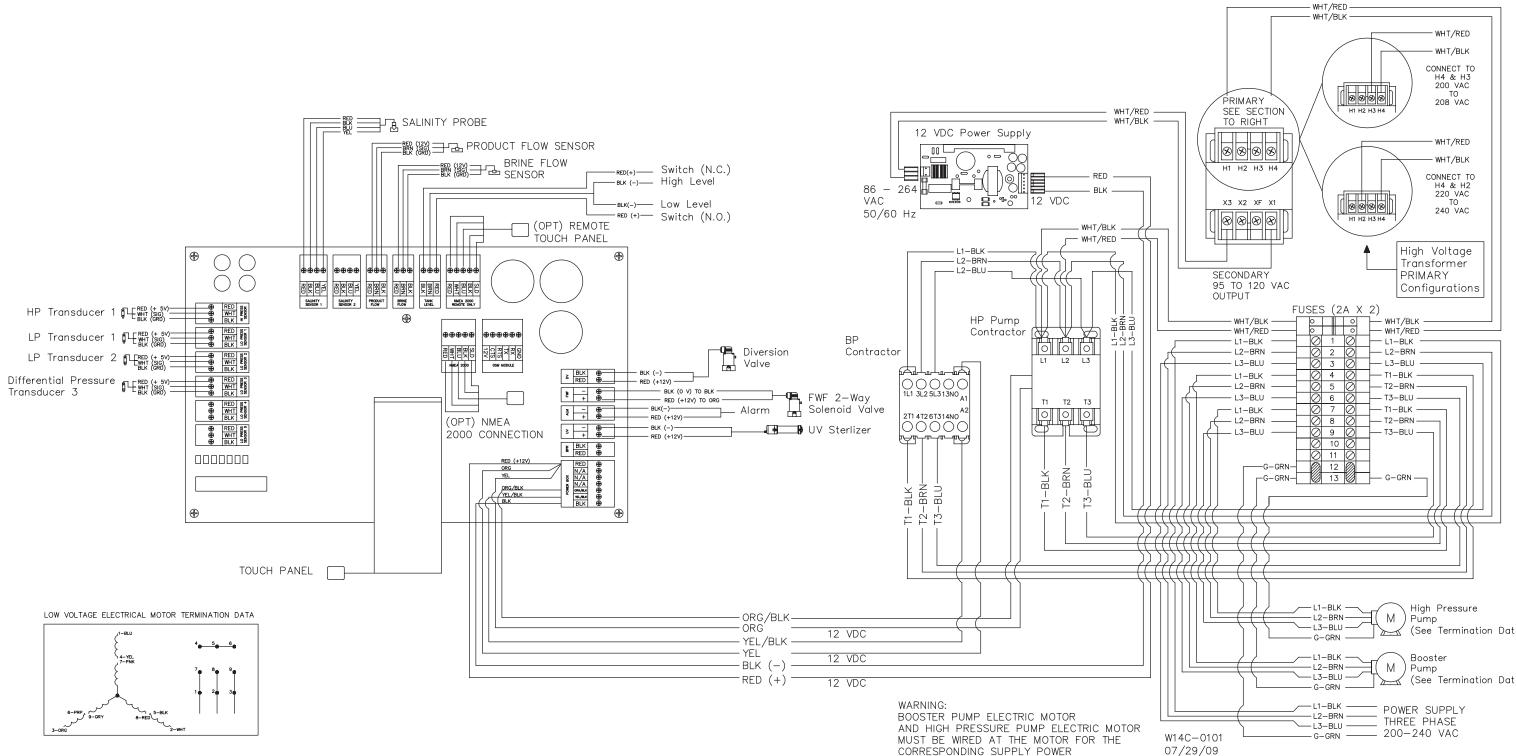


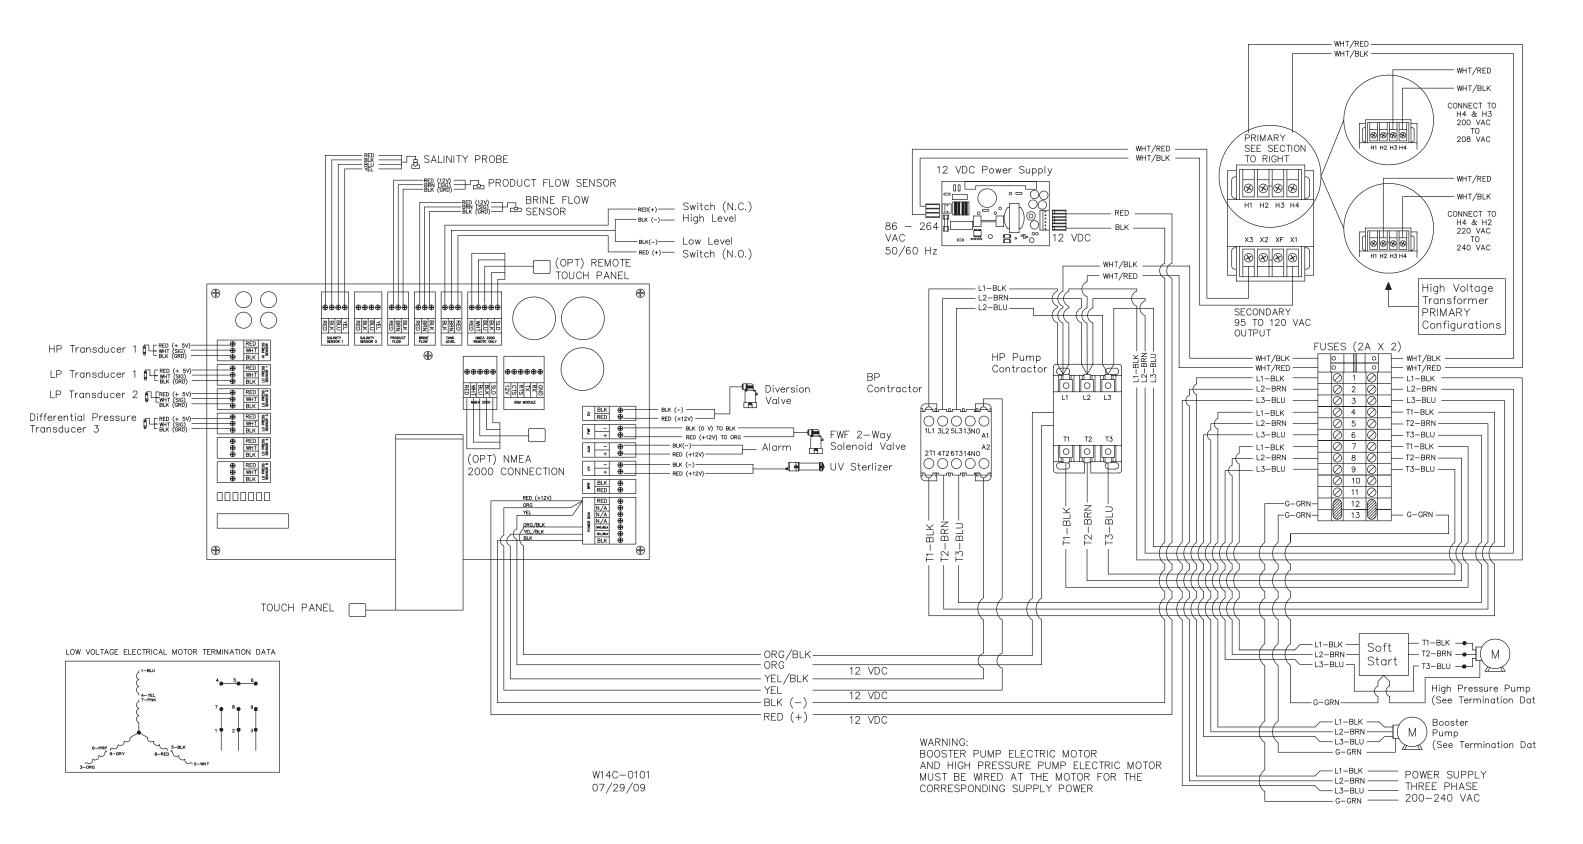


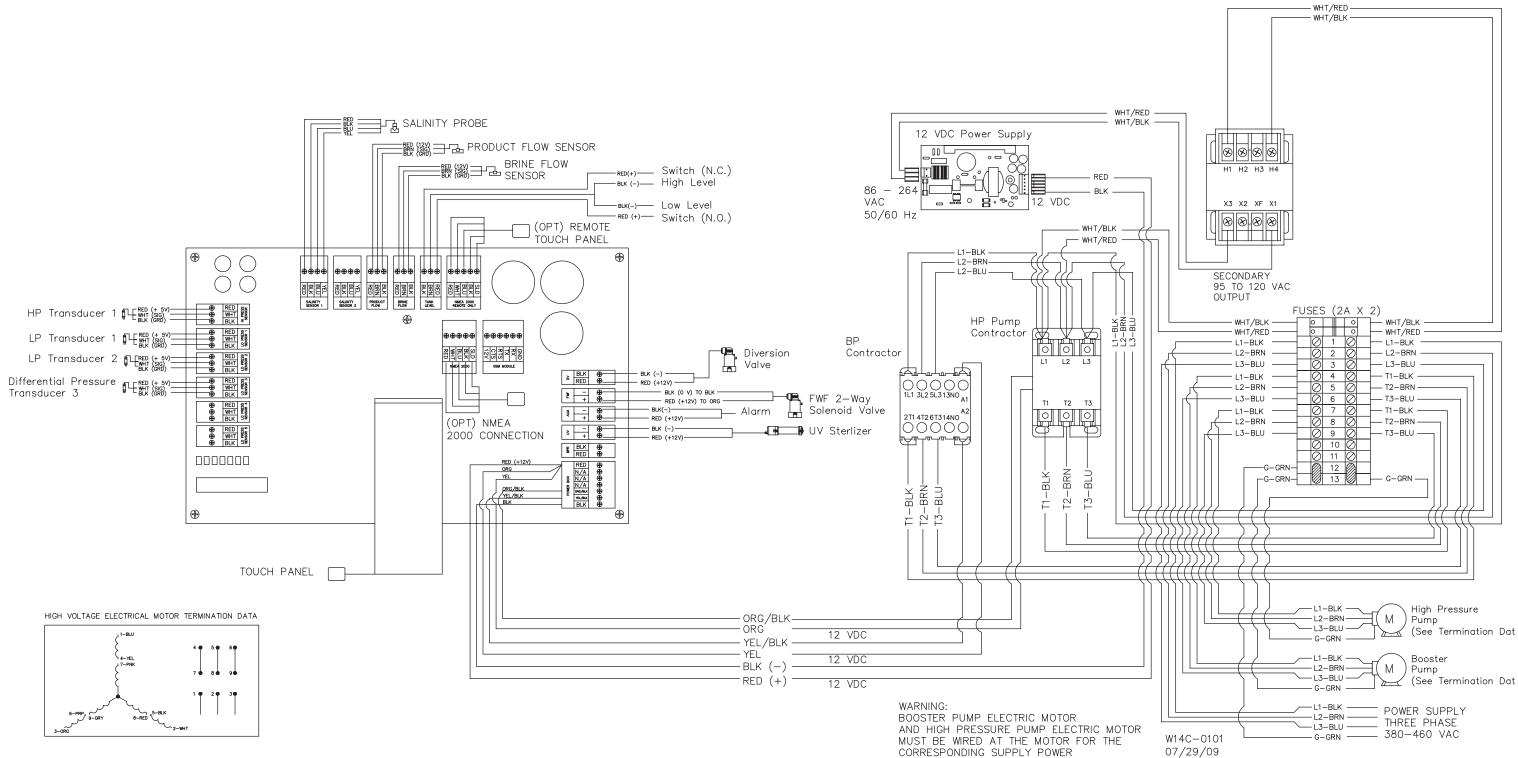

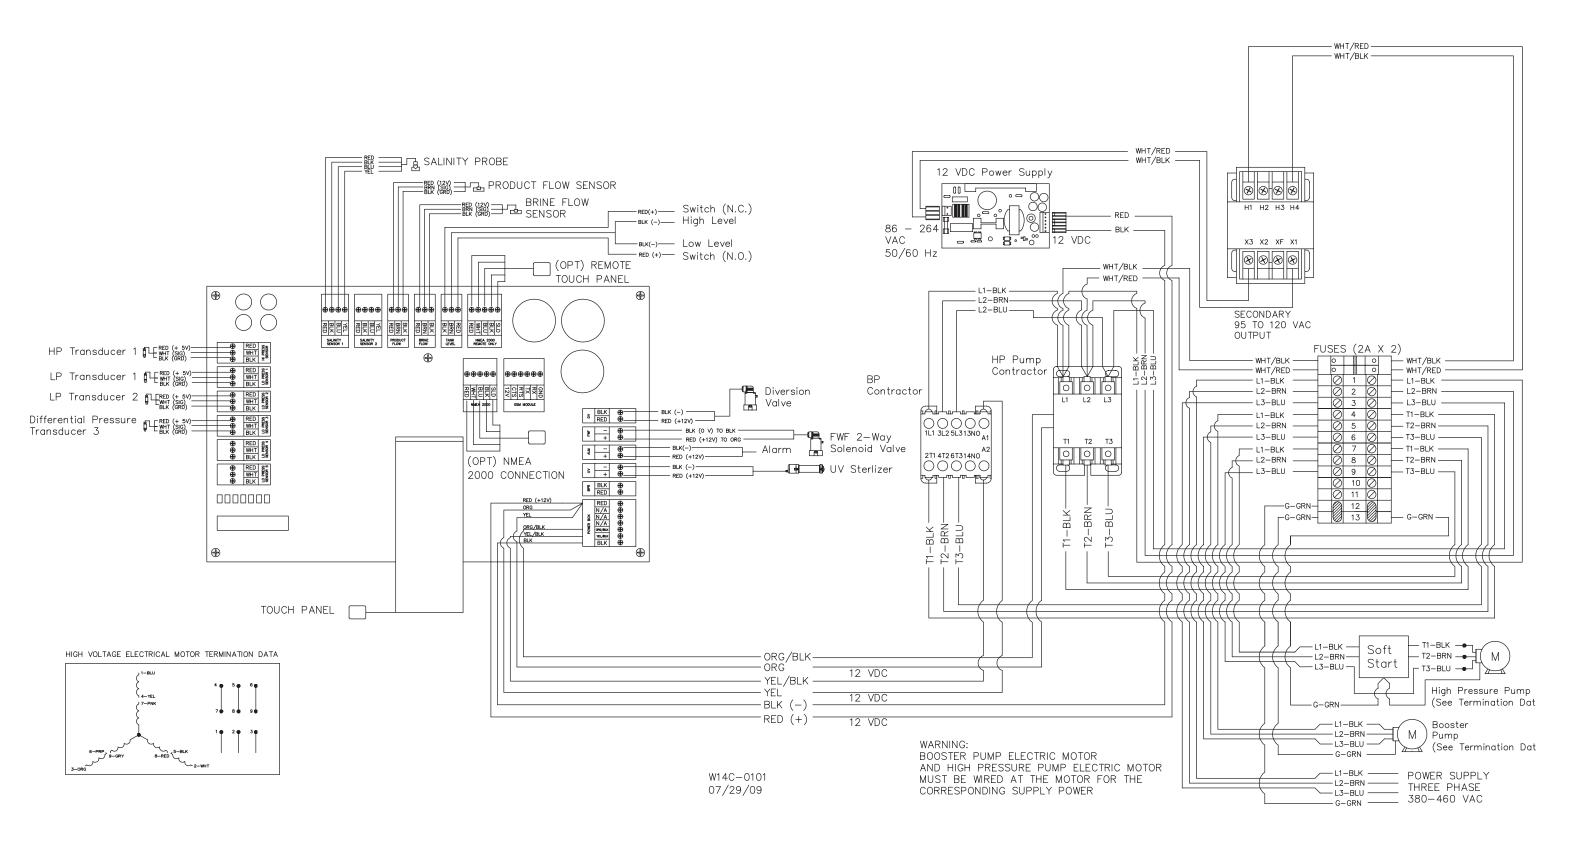

ELECTRICAL UPDATE AS OF 10/30/2017

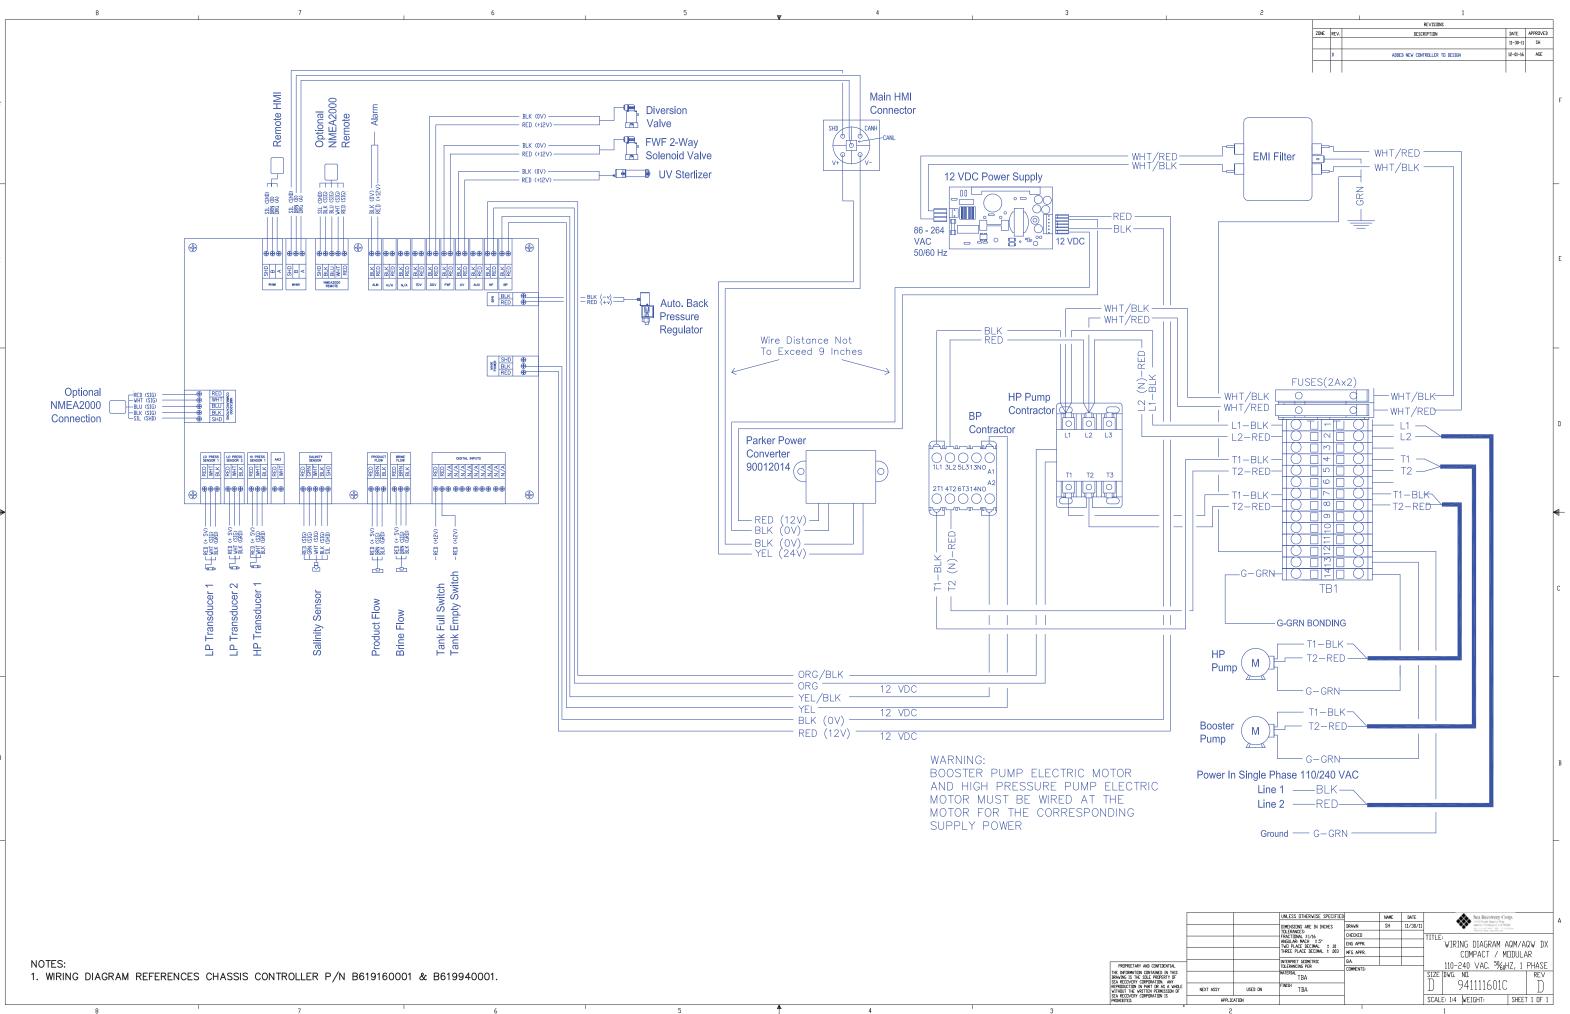

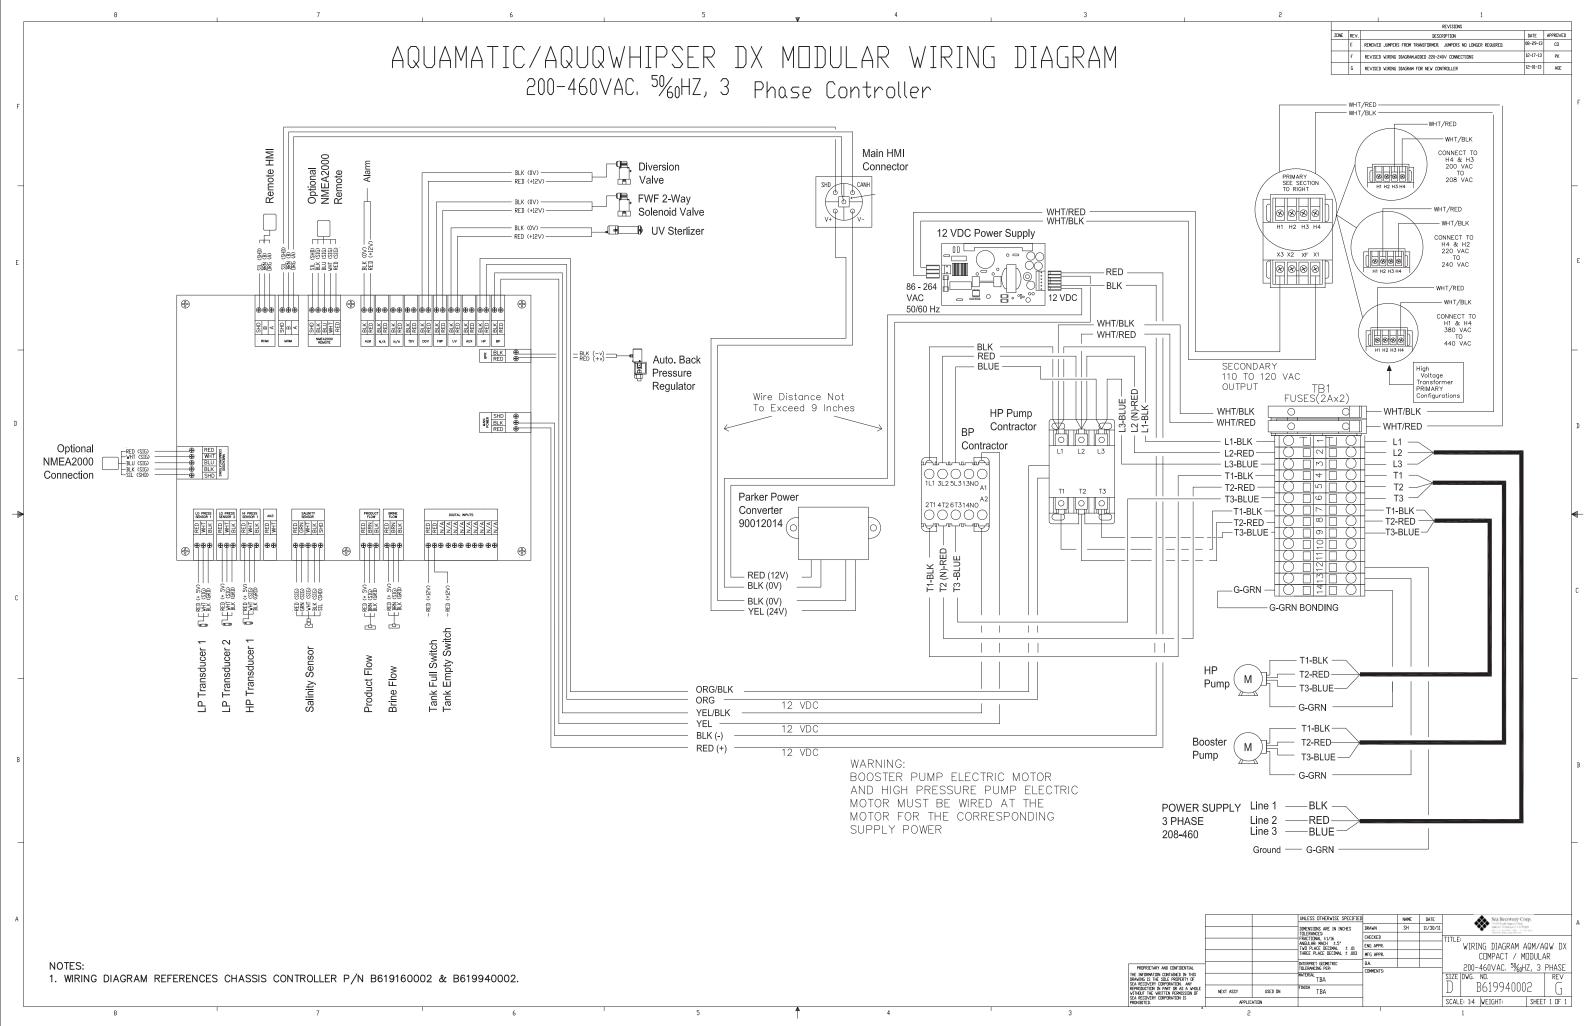



Part Number: B651930002